



智能大厦科技

Building Automation



Ir Dr. Sam C. M. Hui

Department of Mechanical Engineering

The University of Hong Kong

E-mail: cmhui@hku.hk


Aug 2025

Contents



- Basic concepts
- Control fundamentals
- System design
- System components
- Networking

Basic concepts

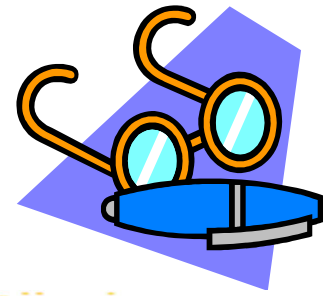


- Building Automation

- Use of automation & control systems to monitor and control building-wide systems, e.g. HVAC, lighting, alarms, and security access & cameras
 - Thermostats to control room temperature
 - Occupancy sensors to control lighting
 - Fire & smoke detectors
- Converging these systems into a single information technology (IT)-managed network infrastructure creates a *smart/intelligent building*




Basic concepts

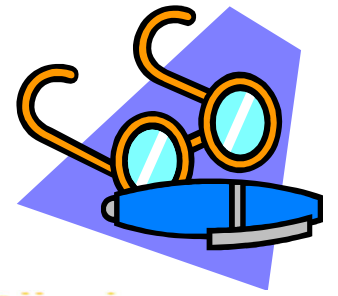


- **Building Automation Systems (BAS)** are centralized, interlinked, networks of hardware and software, which monitor and control the environment in commercial, industrial, and institutional facilities
- While managing various building systems, the BAS ensures the operational performance of the facility as well as the comfort and safety of building occupants

An example layout of a building automation system (BAS)

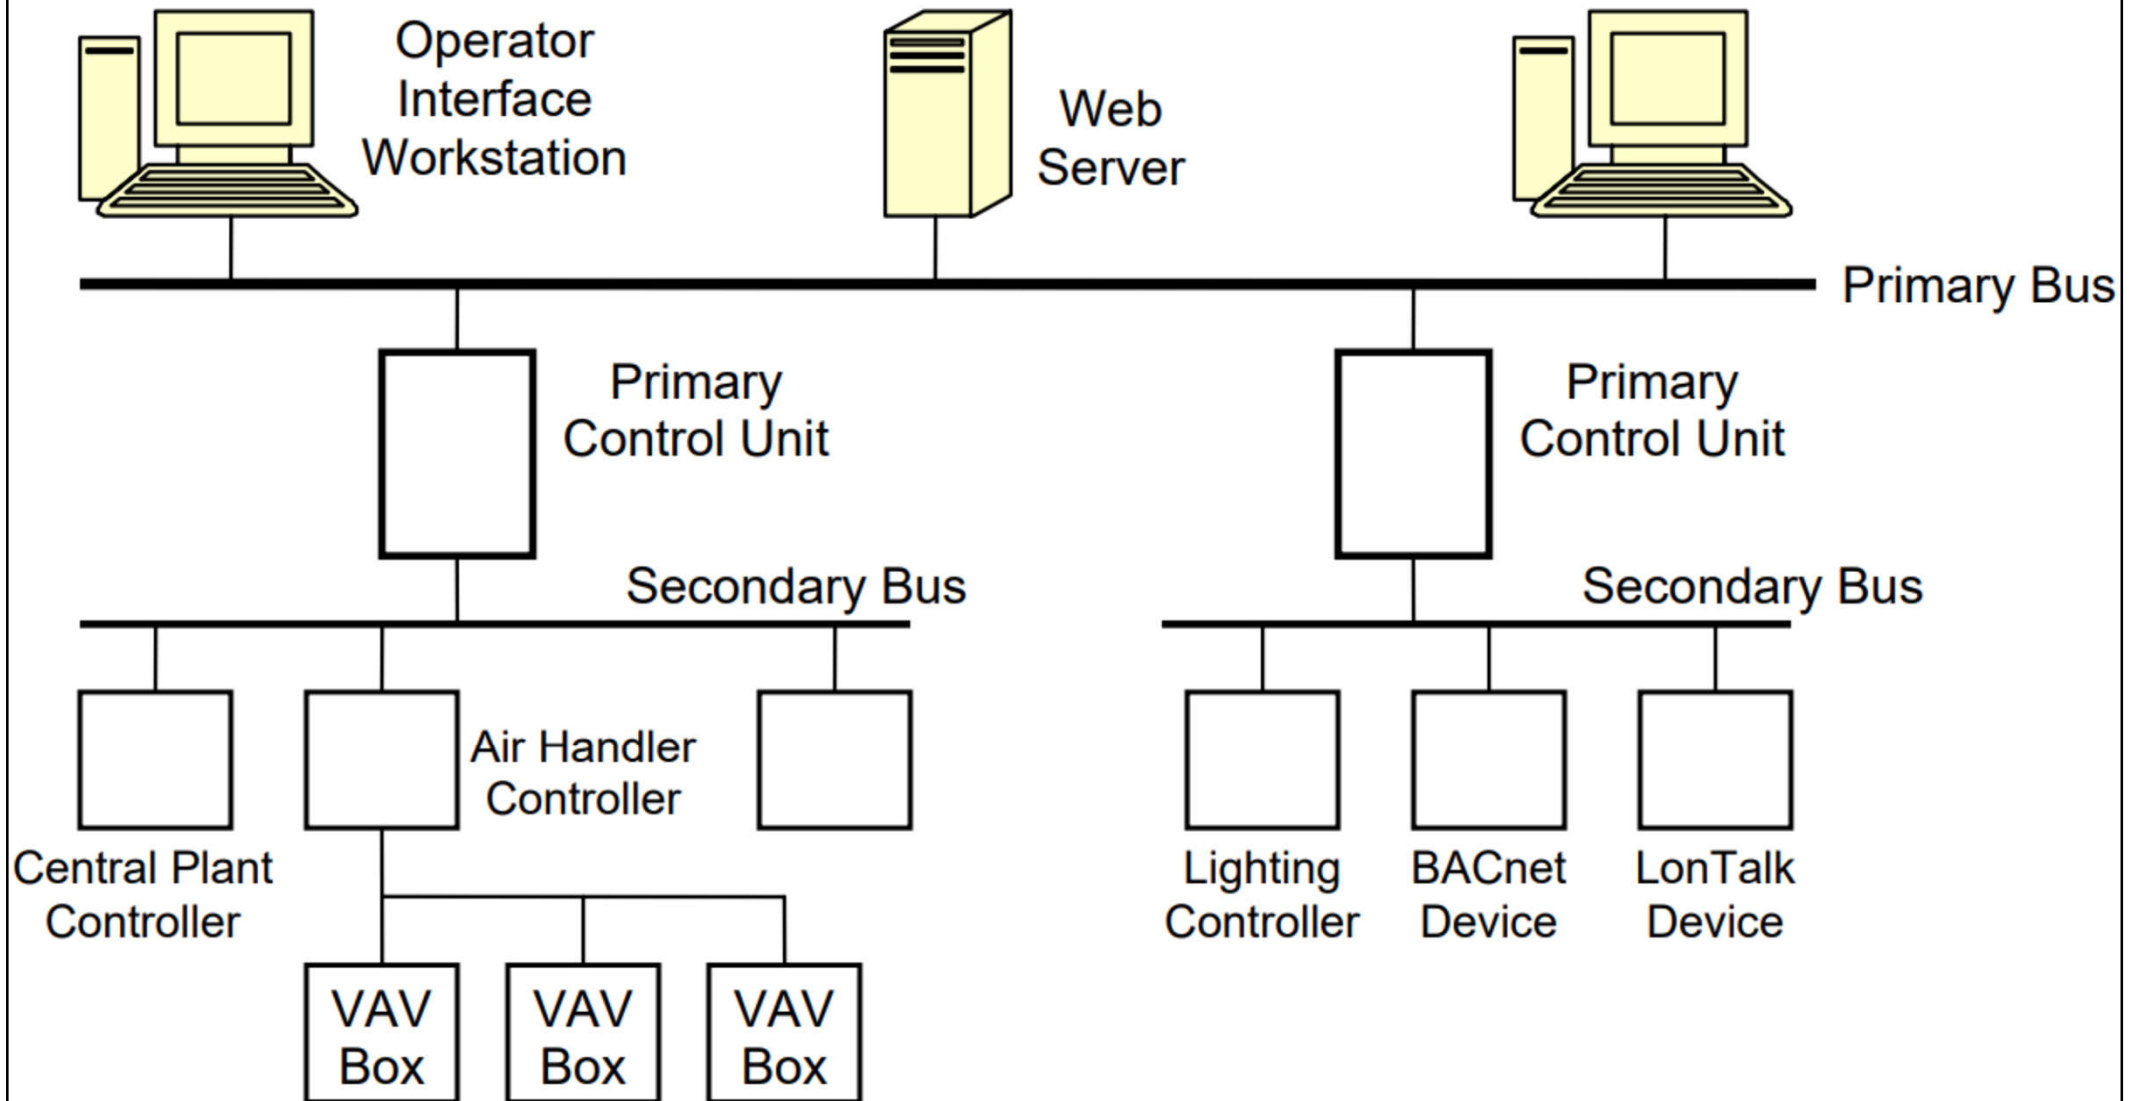

(VAV = variable air volume)


Basic concepts

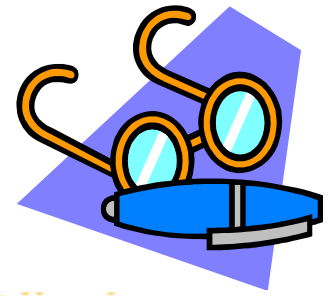

- Terminology
 - Building automation system (BAS)
 - Building automation & control system (BACS)
 - Building management system (BMS)
 - Building energy management system (BEMS)
 - Energy management system (EMS)
 - Central control and monitoring system (CCMS)
 - Direct digital control (DDC)
 - Intelligent building (IB)

A term coined by
HK Govt. depts.

Basic concepts

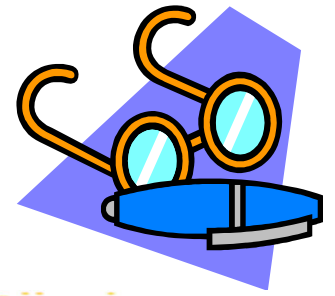

- Core functions of BAS:
 - Control (e.g. building's environment & systems)
 - Operation
 - Alert or sound alarms when needed
 - Operate system according occupancy & energy demand
 - Monitoring
 - Monitor & correct system performance
 - Management & analysis
 - Analyze & optimize data collected to provide real time feedback (e.g. trend logs) & documentation






Typical functions of building automation/management system (BAS/BMS)






Operator functions



Management functions








Processing functions






$$y = f(x)$$


Calculation



I/O functions (field devices)




Basic concepts

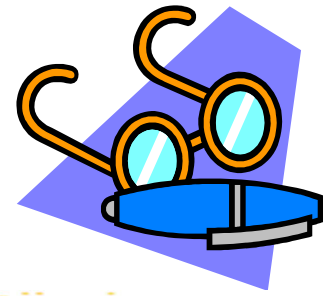

- Building services systems being controlled
 - **HVAC** (heating, ventilation & air-conditioning)
 - Fire services
 - Plumbing & drainage
 - Electrical installations
 - Lighting
 - Lifts & escalators
 - Security & communication
 - Special systems (medical gas, renewable energy)


Most important one

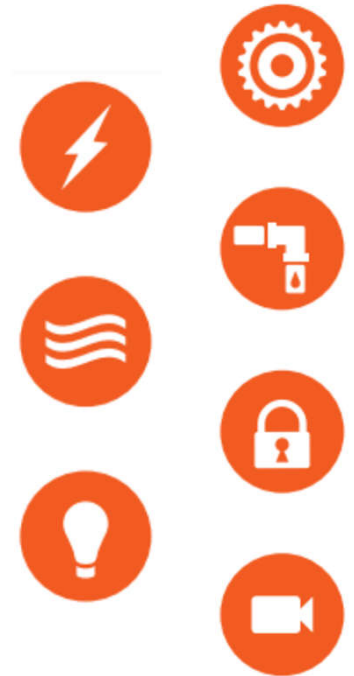


Where building automation system (BAS) are used?



Basic concepts

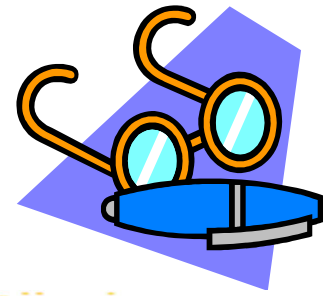


- Why use BAS?
 - Growing complexity of building systems
 - Demand for more efficient building operation
 - Need to save energy & operating costs
 - Need to increase flexibility & reliability
 - Improve indoor environment & productivity
- Connect BAS to major building equipment to
 - Control air conditioning & lighting to save energy
 - Monitor all equipment to improve efficiency of operations personnel & minimise equipment down time

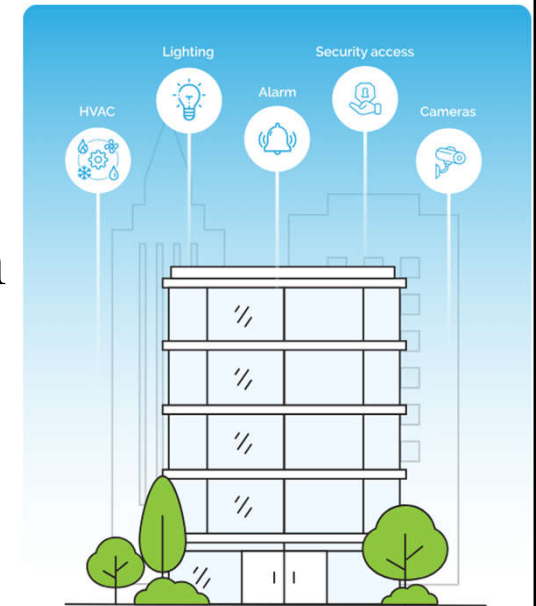

Benefits of Building Automation Systems

Lower energy cost

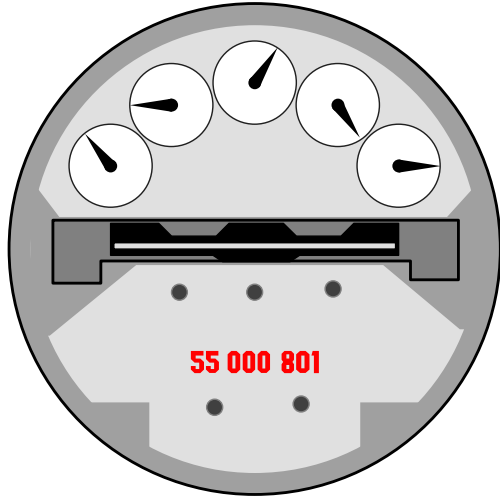


Lower operations cost




Increase flexibility



Ensure quality building environment

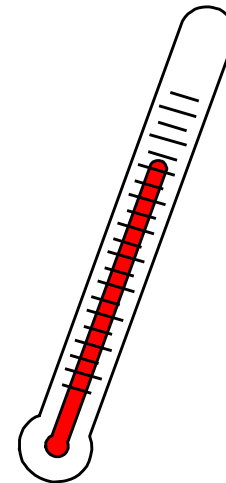

Basic concepts

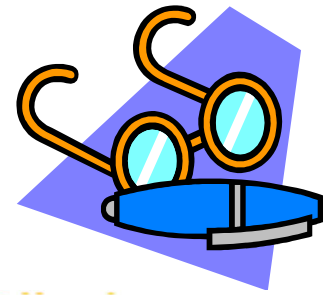


- Early development history

Influenced by computer & information technologies


- 1st generation (1950's)
 - Remote monitoring panels with sensors & switches (hard wire)
- 2nd generation (1960's)
 - Electronic low voltage circuits
- 3rd generation (1960's-1973)
 - Multiplexed systems with minicomputer stations
- 4rd generation (1983)
 - Microcomputer-based systems
- 5th generation (1987)
 - Direct digital control (DDC) with microprocessor & software

Nowadays, BAS/BMS involves knowledge of many disciplines.

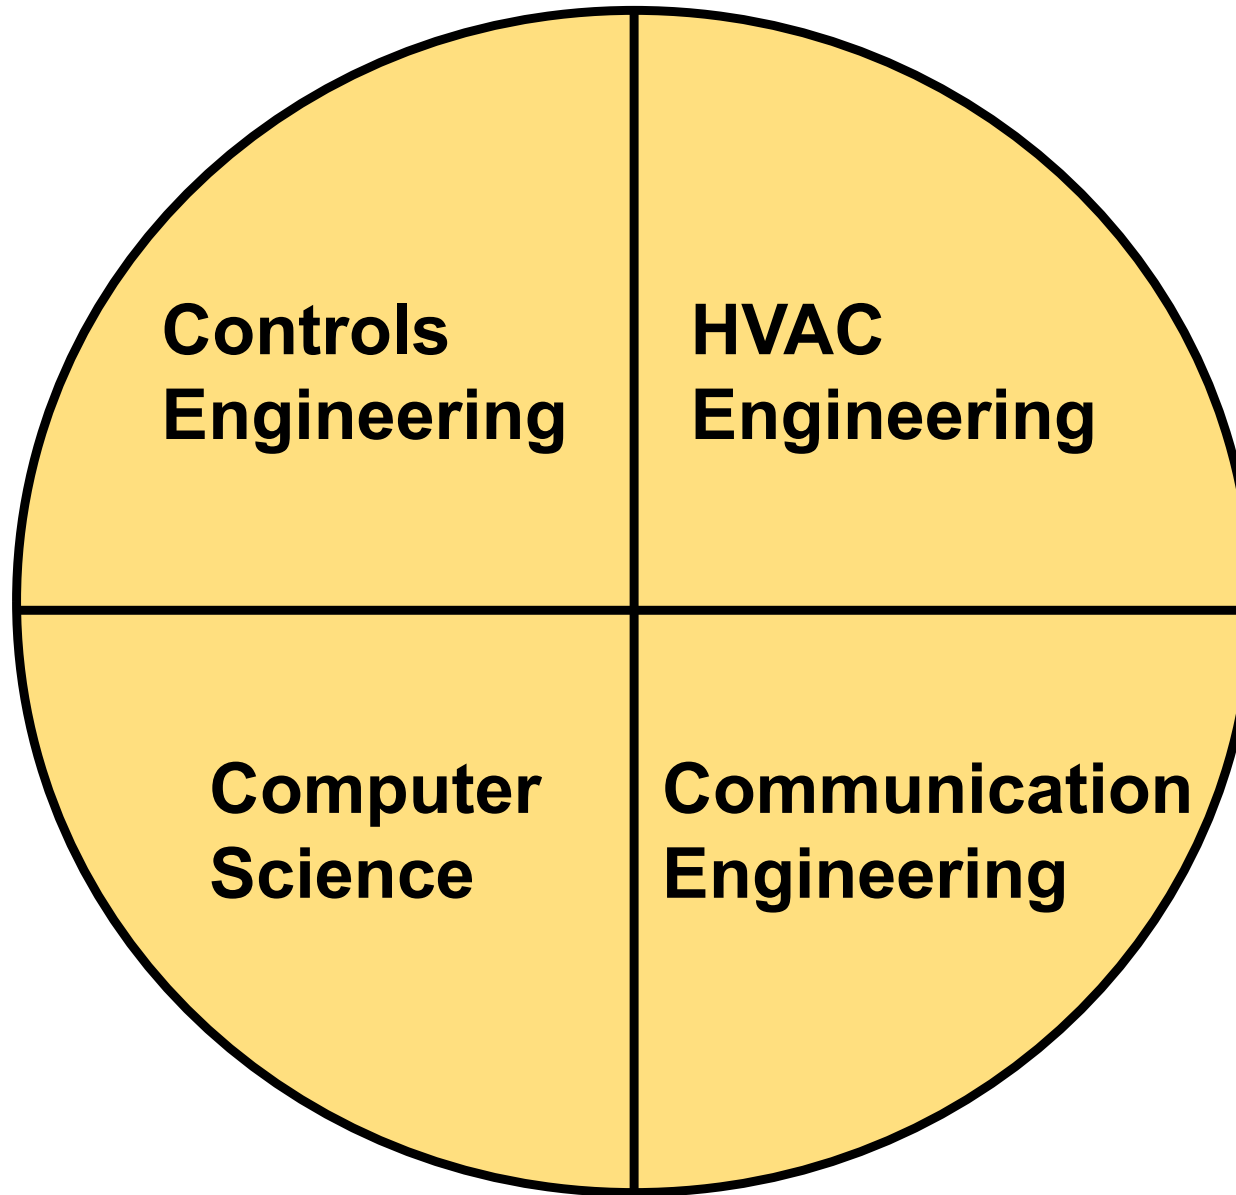

Keyword: “Communicate”


Basic concepts

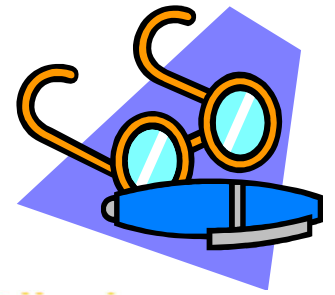


- The future of (smart) building automation systems
 - Internet of Things (IoT) technologies
 - Internet Protocol (IP) based devices + wireless
 - Connectivity + Integration
 - Advanced fault detection & diagnostics
 - Data analytics, machine learning, artificial intelligence
 - Open BAS platforms
 - Software As A Service (SaaS), cloud-hosted solutions
 - Smart grid integration




Basic concepts

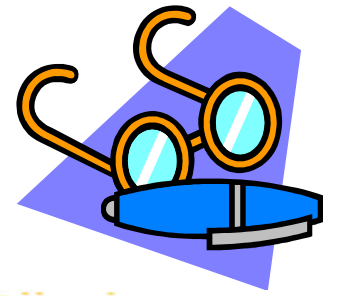

- Benefits of smart building automation
 - Integrated systems
 - Enhanced energy efficiency
 - Employee satisfaction and retention
 - IoT and real-time data collection
 - AI-driven predictive building solutions
 - Remote monitoring
 - Occupant comfort and productivity
 - Advanced security systems
 - Data-driven insights

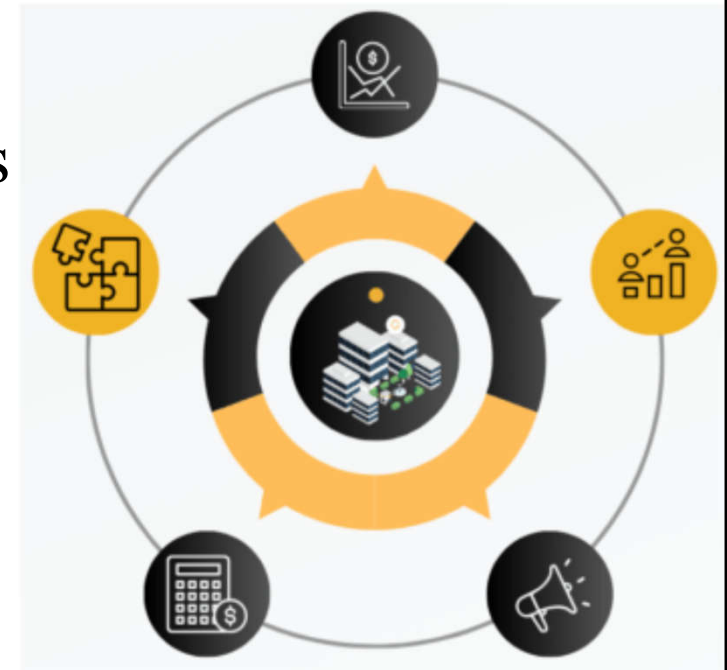

Basic concepts

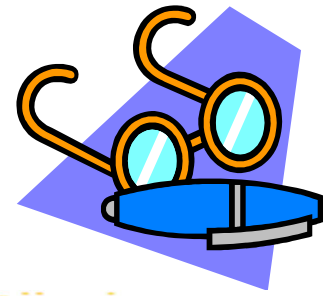

- What makes smart building automation successful?
 - Detect: The foundation of smart building automation
 - Diagnose: The analytical bridge to action
 - Improve: The actionable response for optimal performance



Control fundamentals




- Basic definitions and terms:
 - Analogue:
 - Continuously variable (e.g. a valve controlling water from off to full flow)
 - Digital:
 - A series of on and off pulses arranged to convey information
 - Controlled variable:
 - The quantity or condition that is measured & controlled, e.g. temperature, pressure, relative humidity, and flow

Control fundamentals



- Basic definitions and terms: (cont'd)
 - Setpoint:
 - The value (desired control point) set at the controller
 - Throttling range: (in a proportional controller)
 - The control point range through which the controlled variable must pass to move the final control element through its full operating range
 - Deadband:
 - Range of controlled variable in which no corrective action is taken


Basic concepts and terms of proportional control

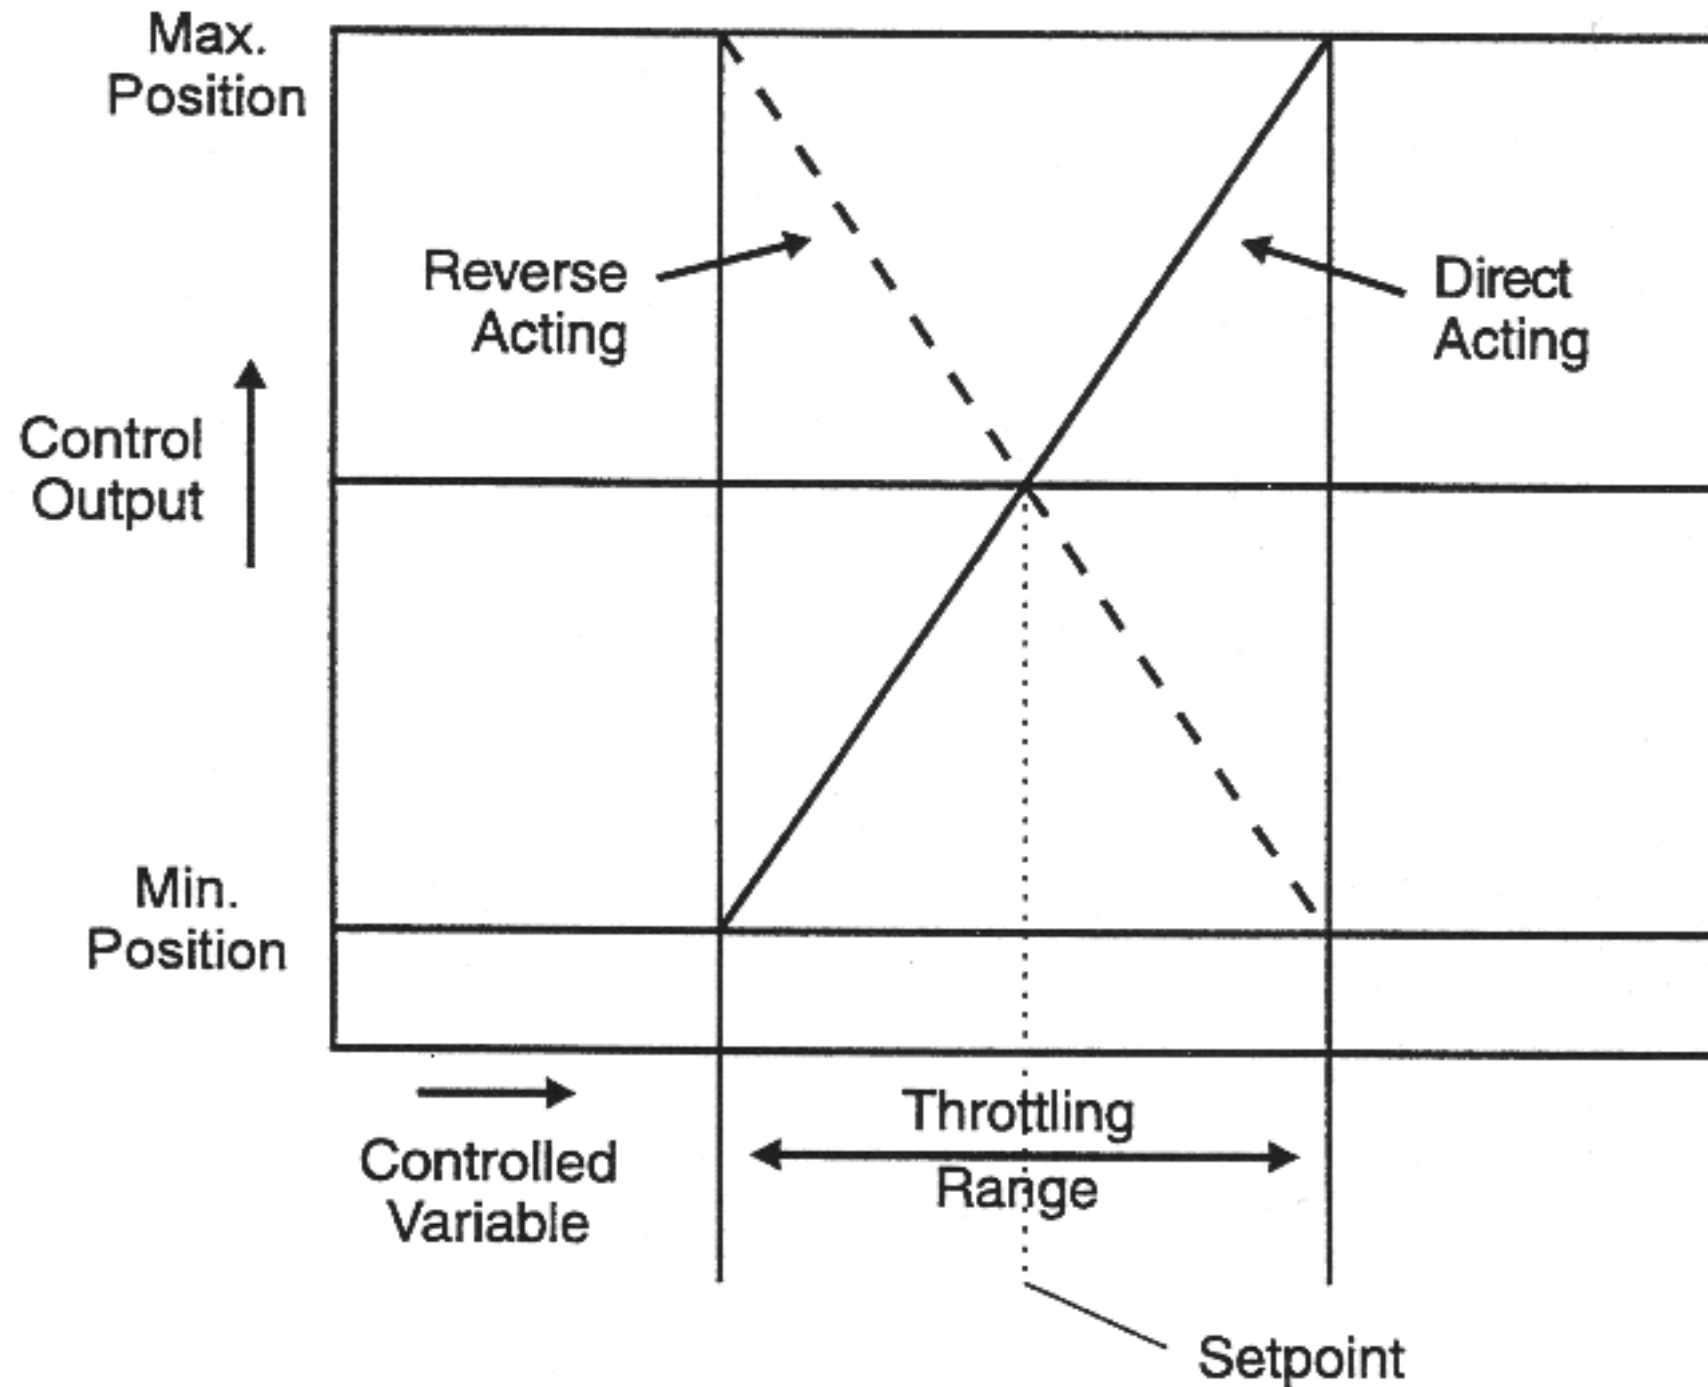

Control fundamentals



- Basic definitions and terms: (cont'd)
 - Controller:
 - A device that senses changes in the controlled variable (or receives input from a remote sensor) and derives the proper correction output
 - Automatic control system:
 - A system that reacts to a change or imbalance in the variable it controls by adjusting other variables to restore the system to the desired balance




Video: Basics of Building Control System Part-1| Building Management System Training | BMS System (11:20) <https://youtu.be/hqq3wlhPHXw>


Control fundamentals




- Basic elements
 - Sensor
 - Measure some variables, e.g. temperature
 - Controller
 - Process & compute an output signal
 - Controlled device
 - Act to change the output of the load
- Typical situation for BAS
 - Close loop systems (w/ feedback loop)

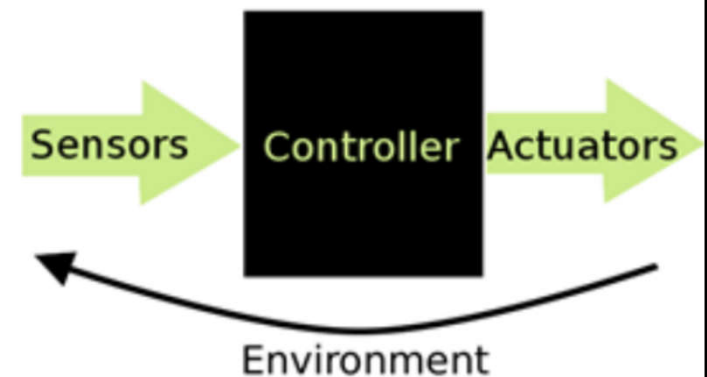


Basic elements of a feedback control loop

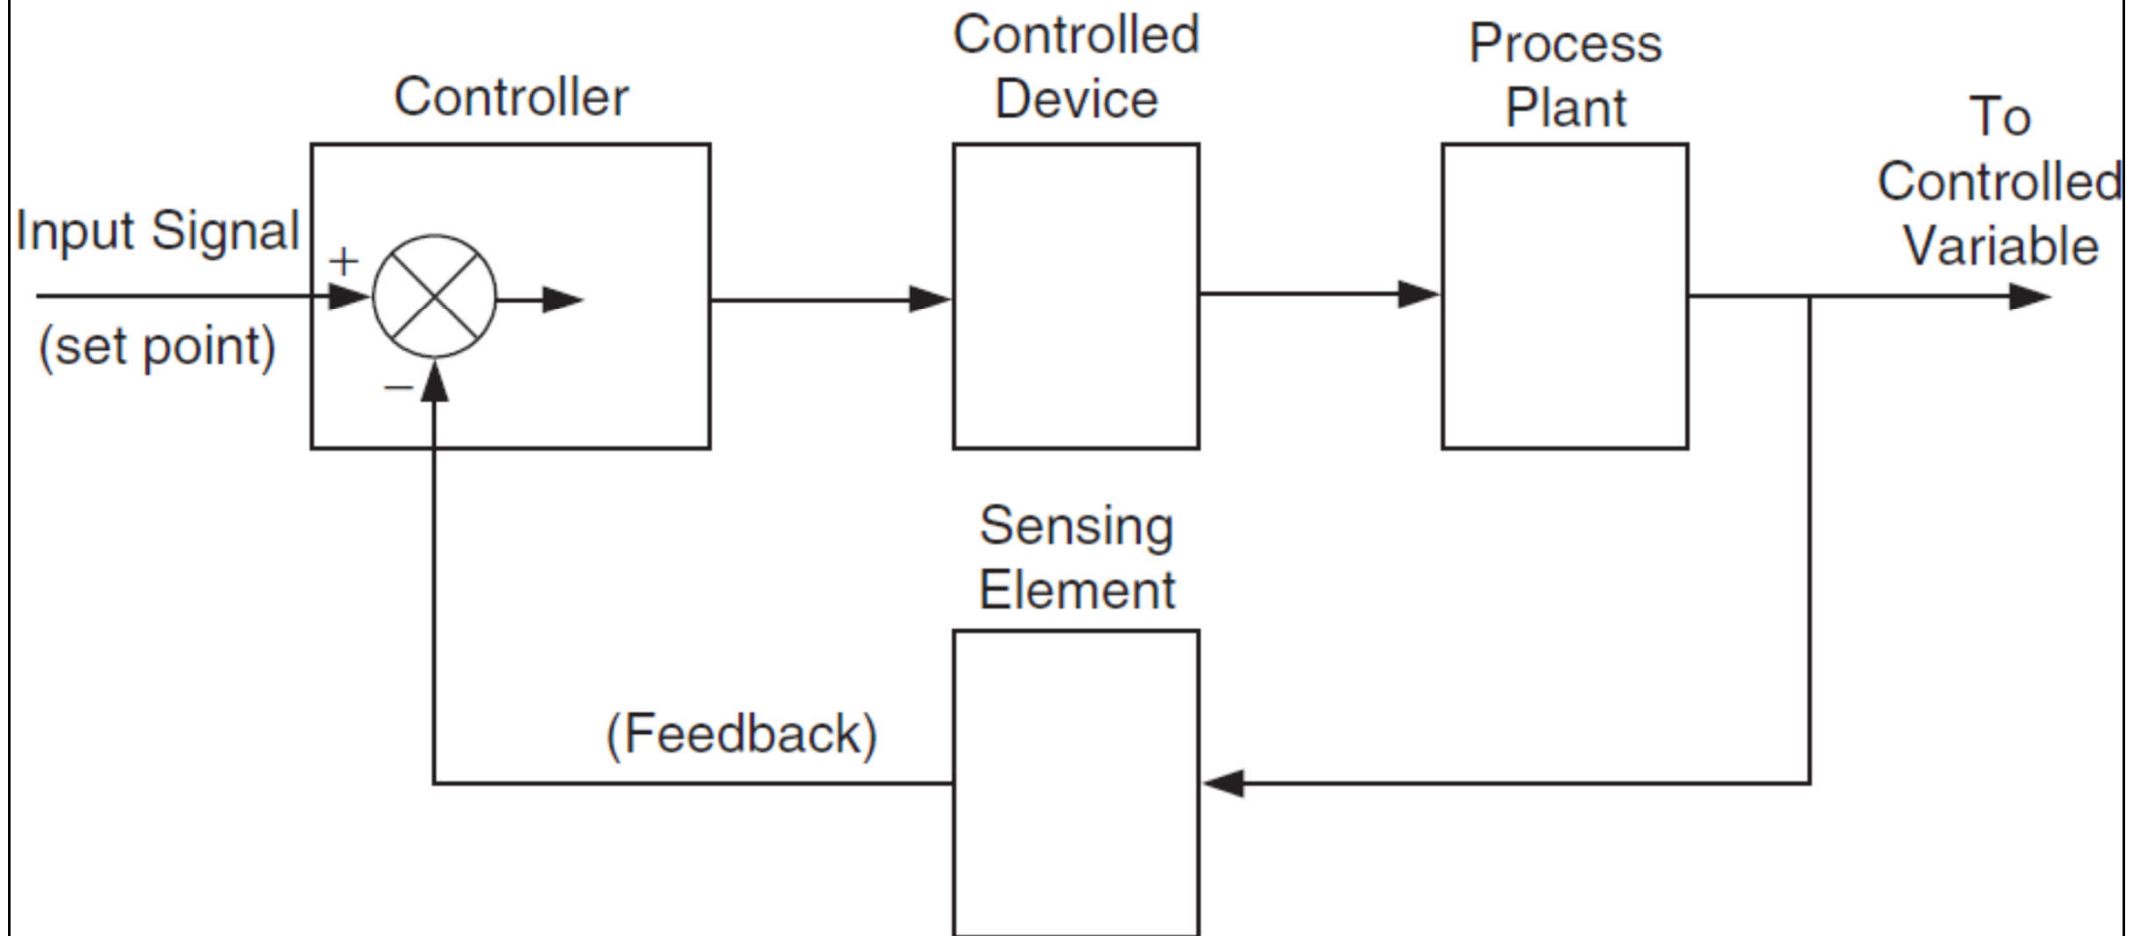


Basic two-position (ON/OFF) control

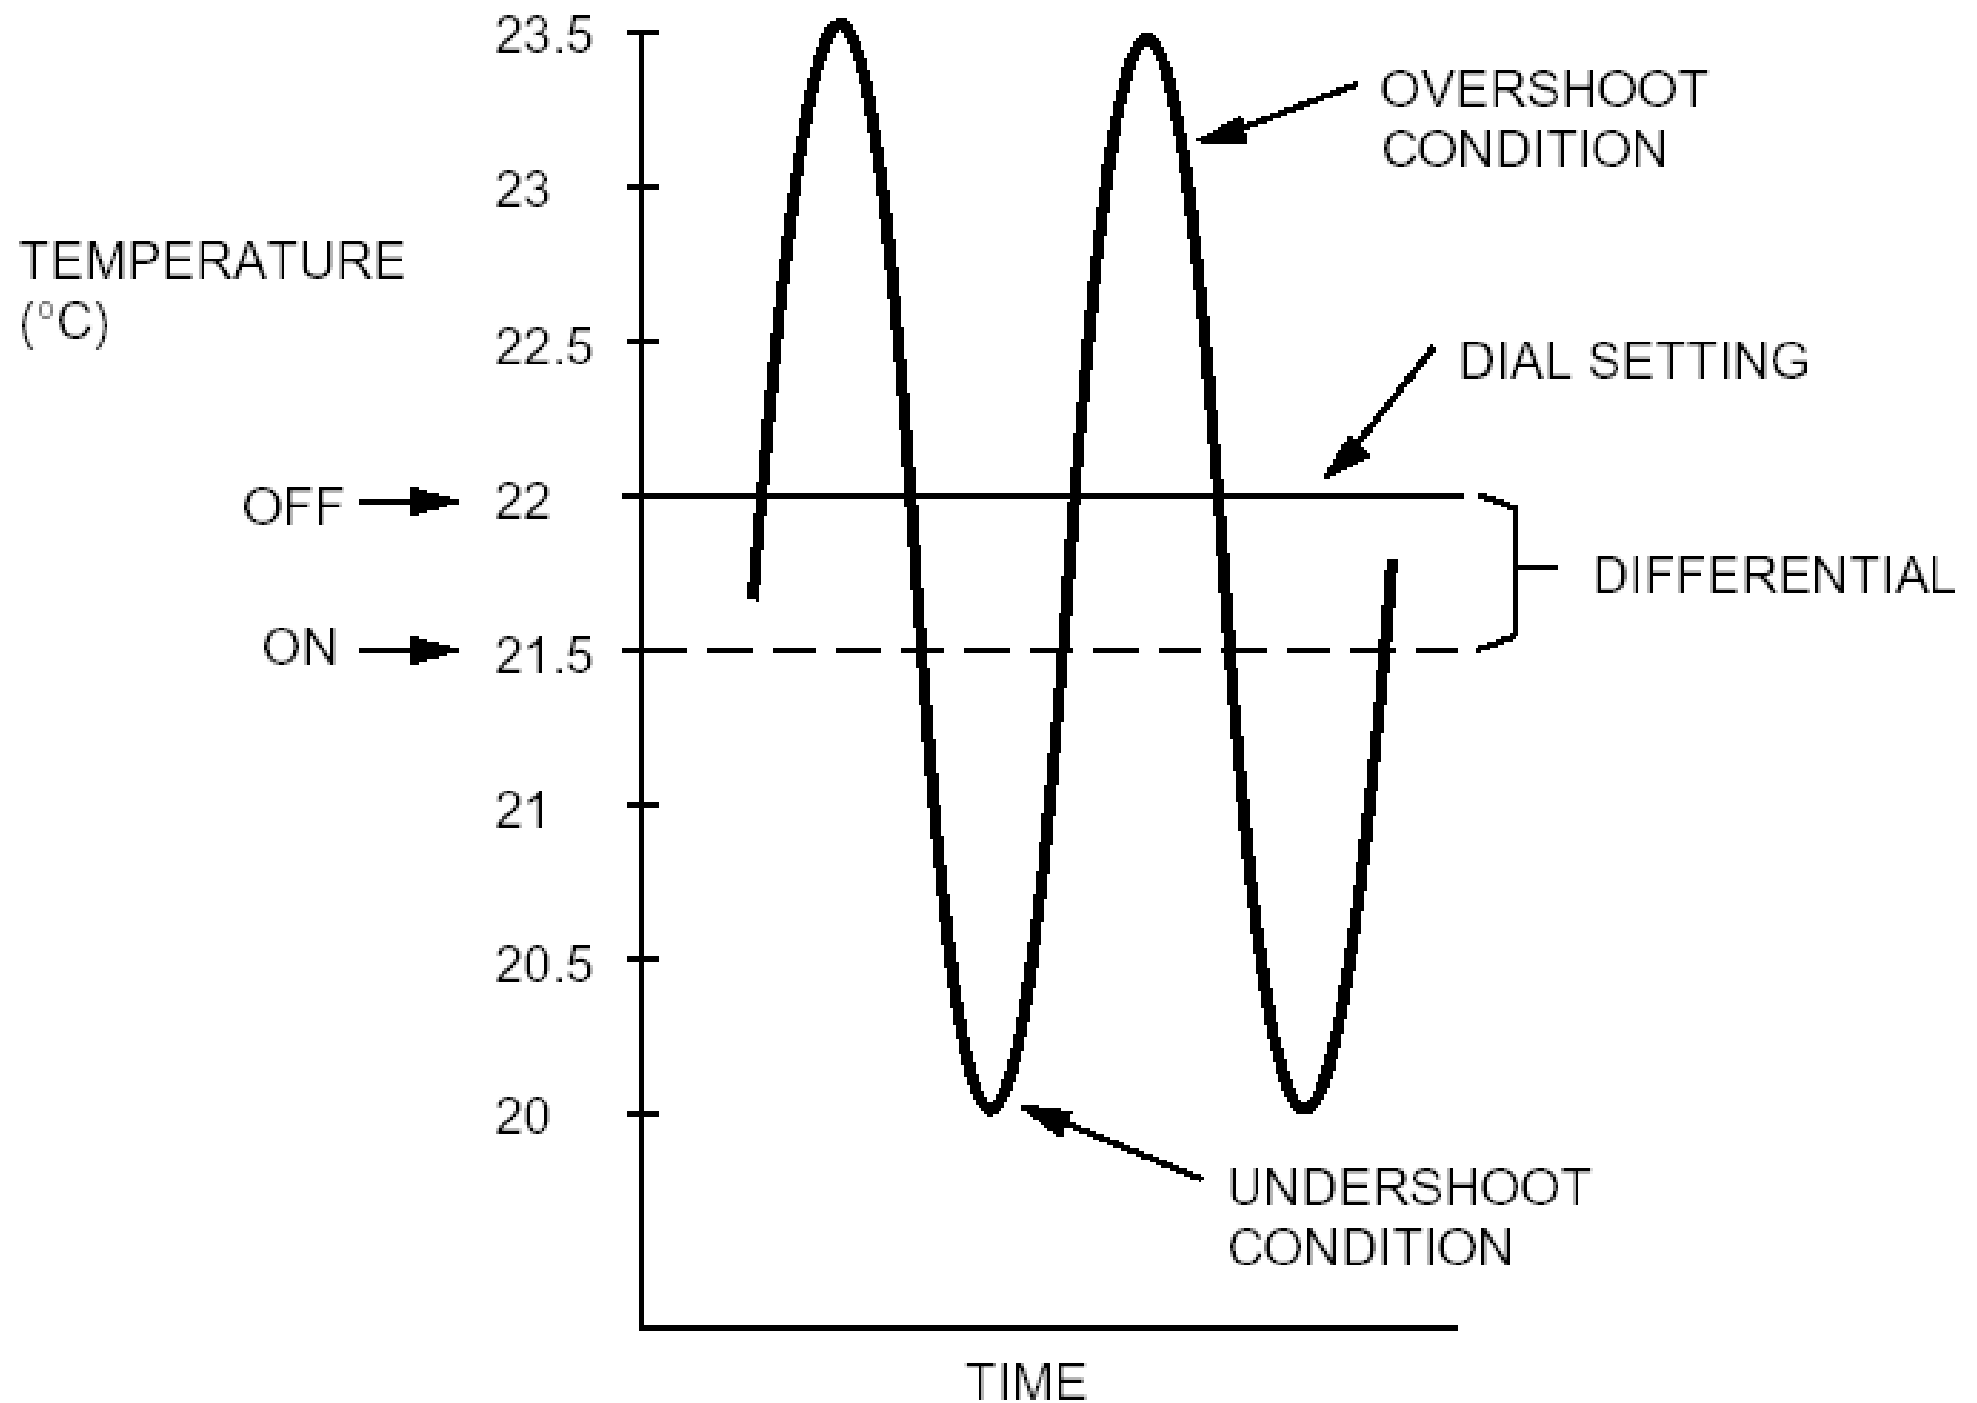


Proportional, integral and derivative (PID) control

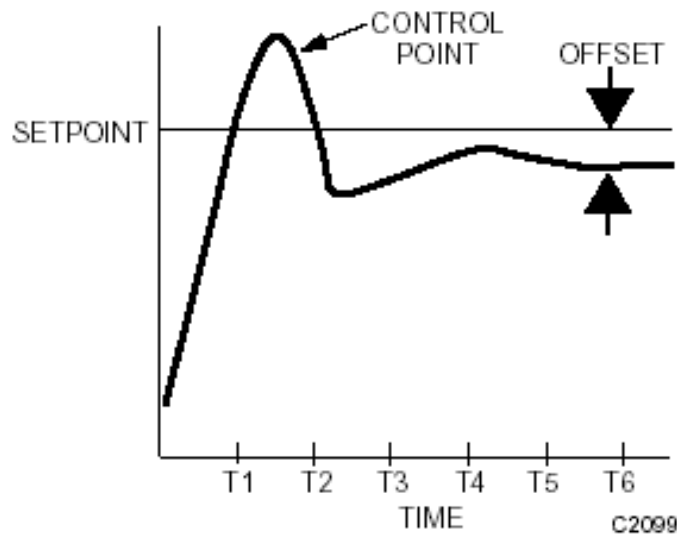

Proportional Control

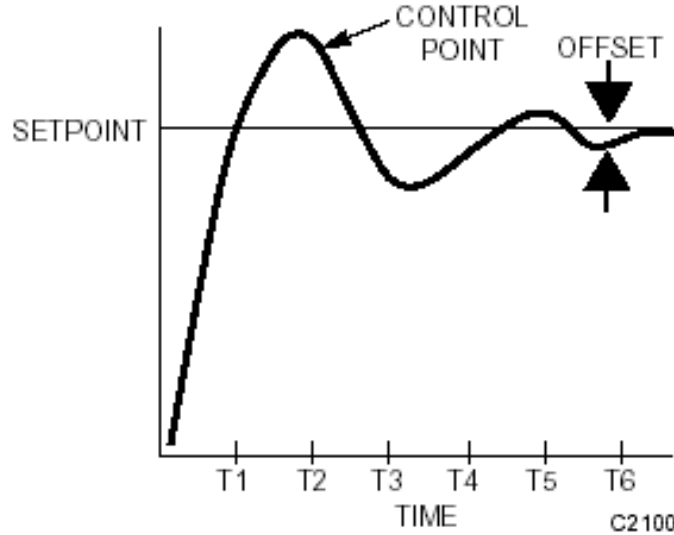

Proportional-Integral
(PI) Control

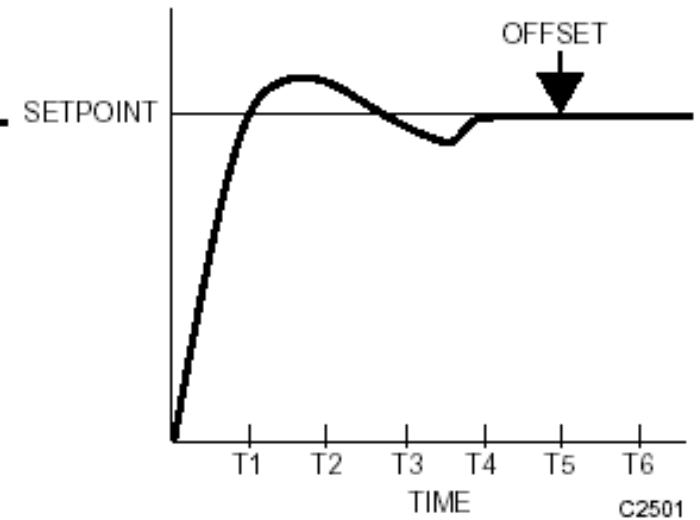

Proportional-Integral-
Derivative (PID) Control

$$V = \underbrace{KE}_{\text{Proportional}} + \underbrace{\frac{K}{T_I} \int E dt}_{\text{Integral}} + \underbrace{KT_D \frac{dE}{dt}}_{\text{Derivative}} + M$$

Proportional Integral Derivative

Control fundamentals



- Pneumatic controls
 - Traditional form of control used in buildings
 - Pneumatic controllers, sensors & actuators
 - Electronic devices may be integrated
- Direct digital control (DDC)
 - Entered the HVAC industry in late 1980's
 - A programmable microprocessor as controller
 - 'Direct' = microprocessor is directly in the control loop
 - 'Digital' = control is accomplished by the digital electronics

Control fundamentals




- Common control methods:
- 1) Pneumatic – apply compressed air or pressurized gases to create mechanical control
- 2) Electric – use electrical devices (e.g. relays, time clocks, thermostats, actuators)
- 3) Electronic – use electronic devices
- 4) Direct digital control (DDC) – apply microprocessor-based, network distributed controllers

System design



- Typical procedure for a BAS project
 - Initial concept
 - Information retrieval
 - Candidate buildings & system selection
 - Field survey
 - Technical design
 - Prepare contract documents
 - Contract & tendering
 - Installation, commissioning & training
 - Acceptance, operation & maintenance



Carried out by
consultants, control
companies &
HVAC contractors

Steps involved in implementing a BAS/BMS

01 Planning

02 Hardware installation

03 Software installation


04 System integration

05 Testing & commissioning

06 Training & documentation




Levels of control in building automation system

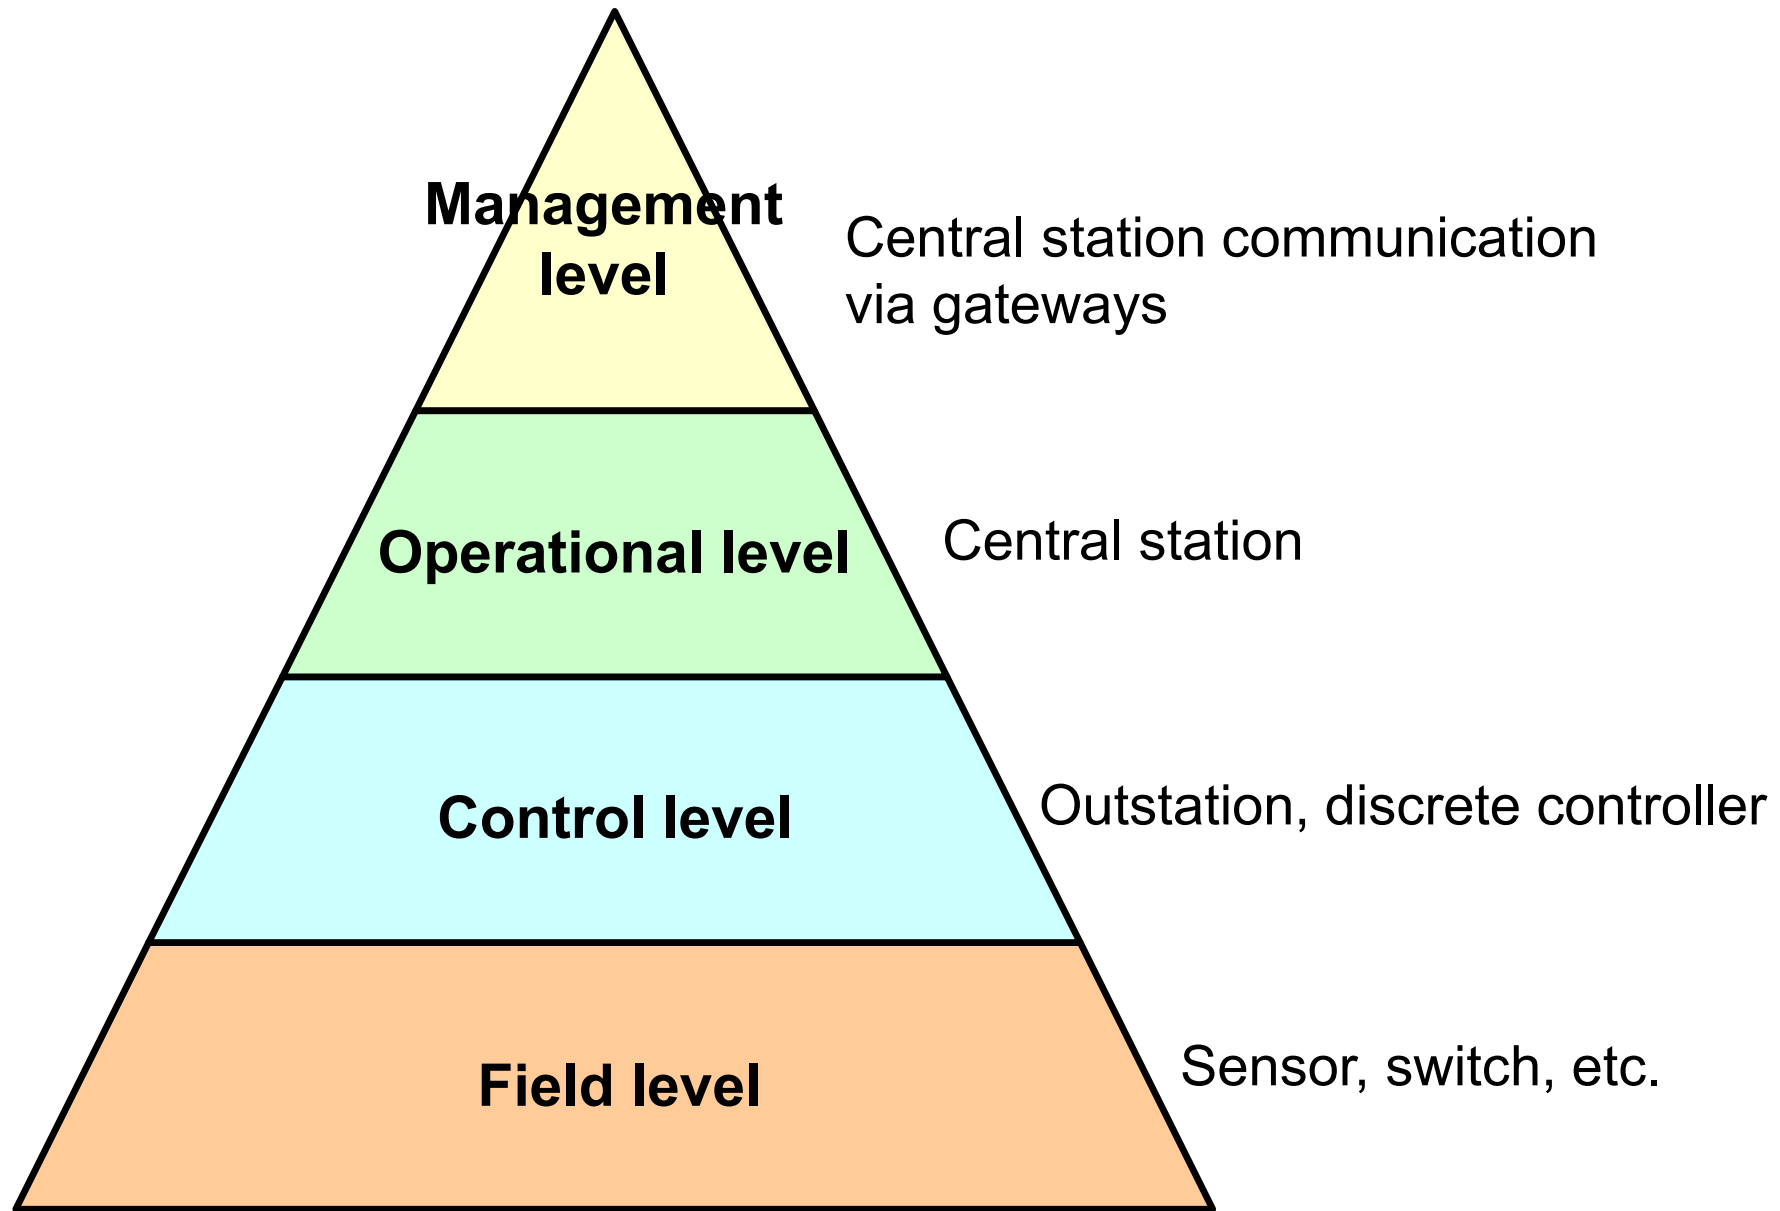


User interaction with BAS/BMS

Level	Operator	Function
Management level	Facilities manager	Reporting
	System administrator	Energy monitoring & targeting; Off-line data analysis
Operations level central supervisor	Non-technical personnel (security, caretaker)	Response to alarm messages and instructions
	System operator	Rescheduling, parameter adjustment, monitoring
	Specialist engineer	Reprogramming, fault finding, expansion
Service tools	Specialist engineer	Monitoring, reconfiguration, fault finding
System level outstation	Non-technical personnel	Some local control of conditions
	Specialist engineer	Parameter adjustment, reprogramming, fault finding
Zone level local control	Occupants	Set point adjustment

Example of system architecture for building management system

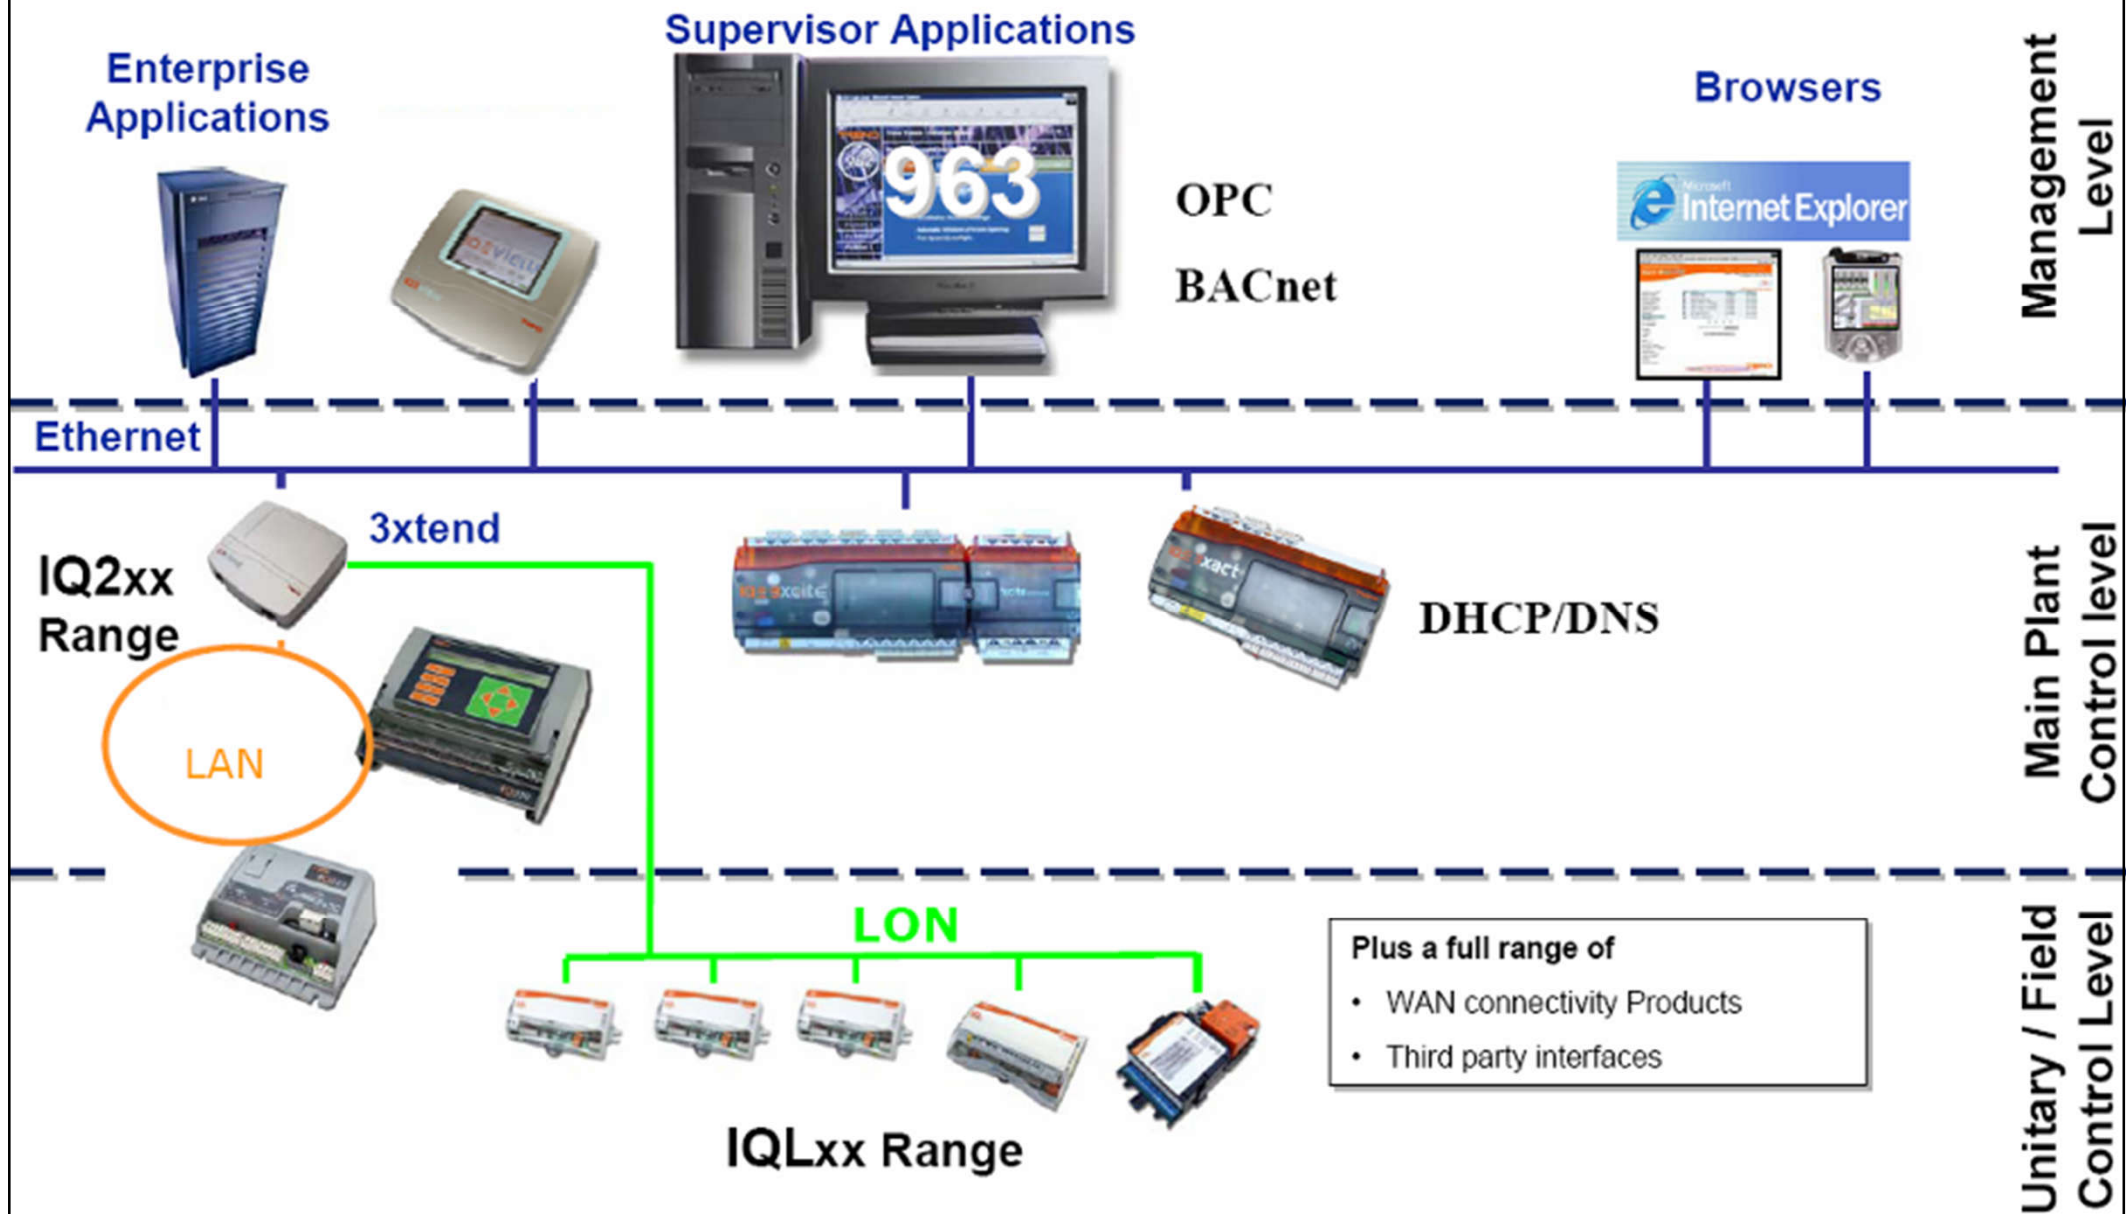


Three-layer building automation system (BAS) architecture

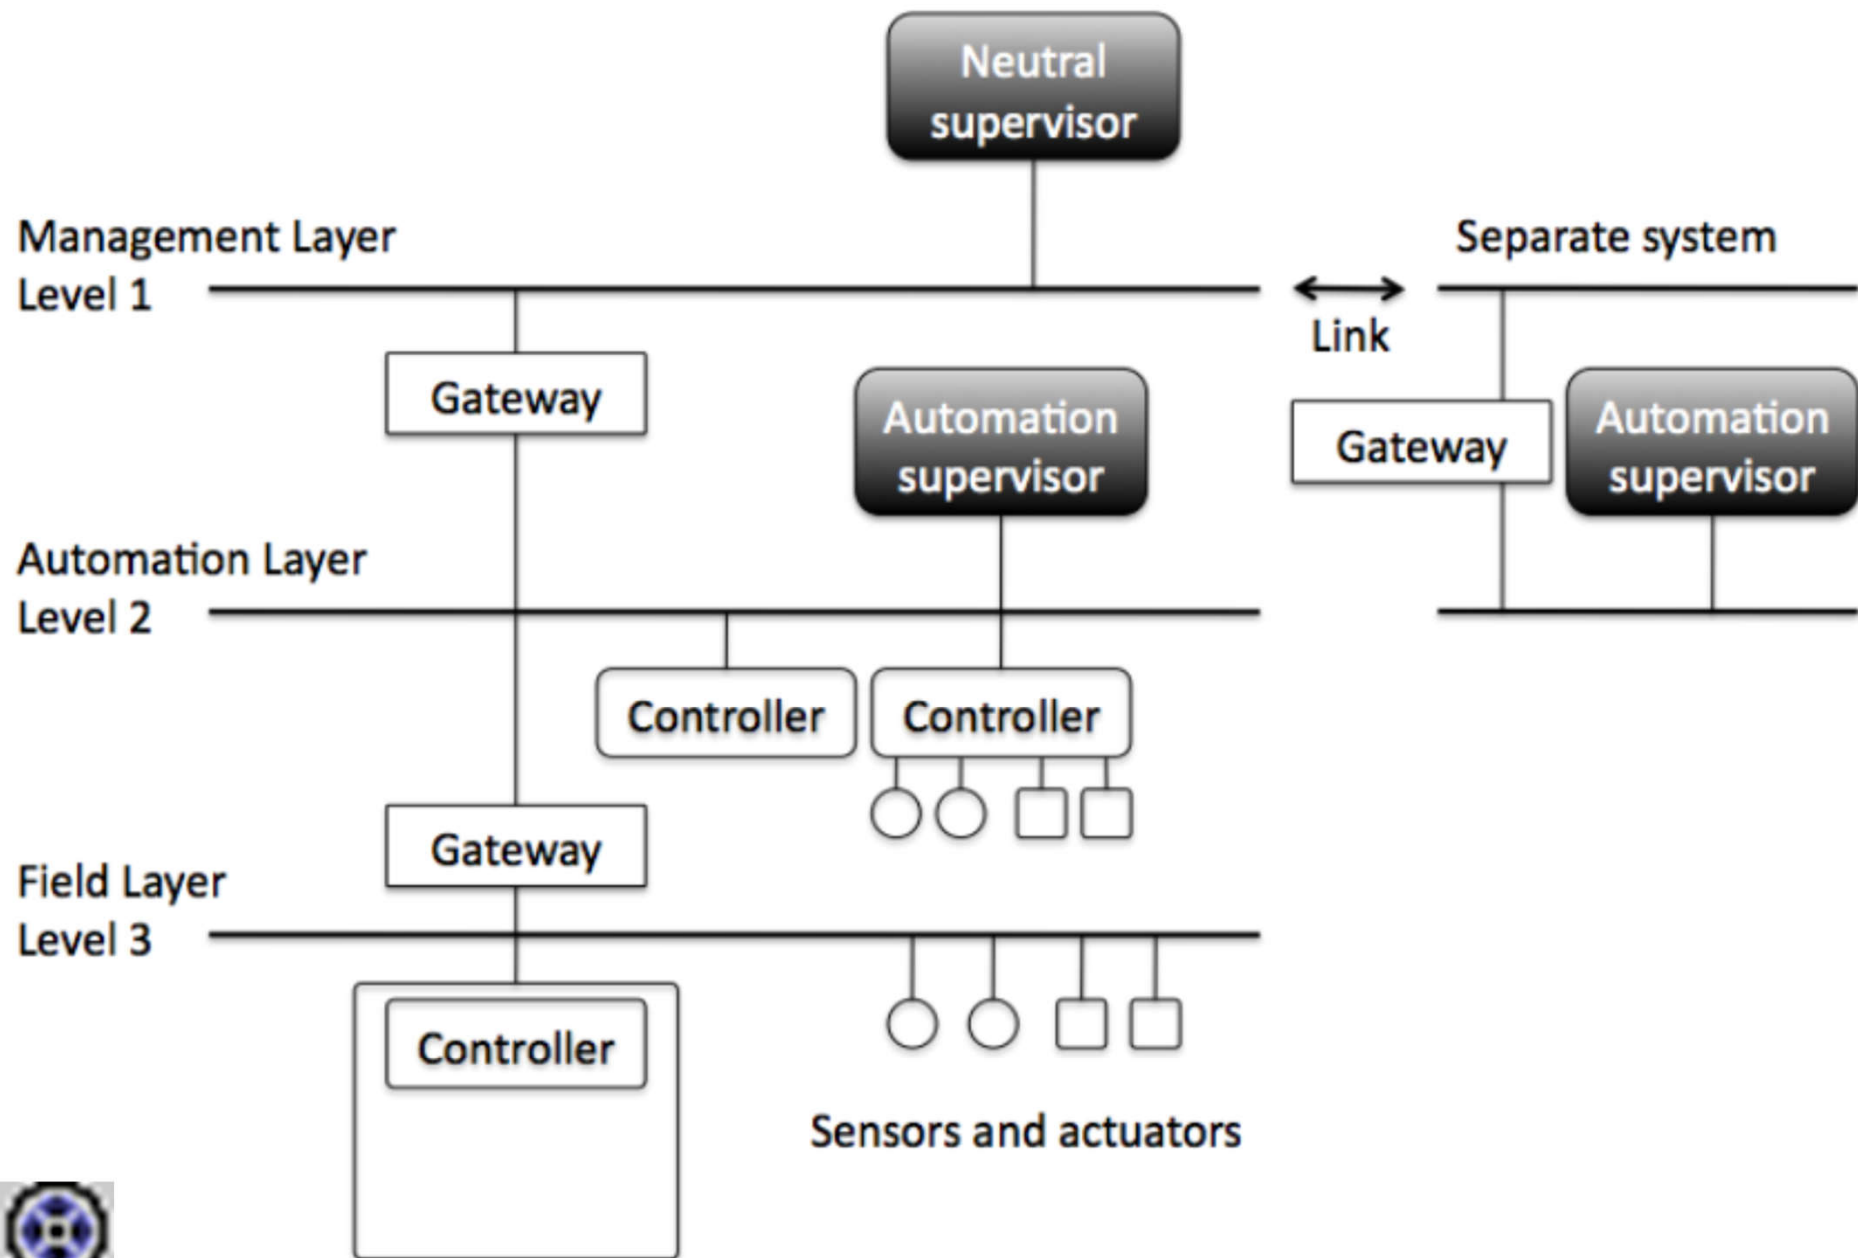

Video: Intro to Building Automation System Architecture (11:26)

<https://youtu.be/mQi40A9uIaE>

Examples of virtual control graphic for building automation system

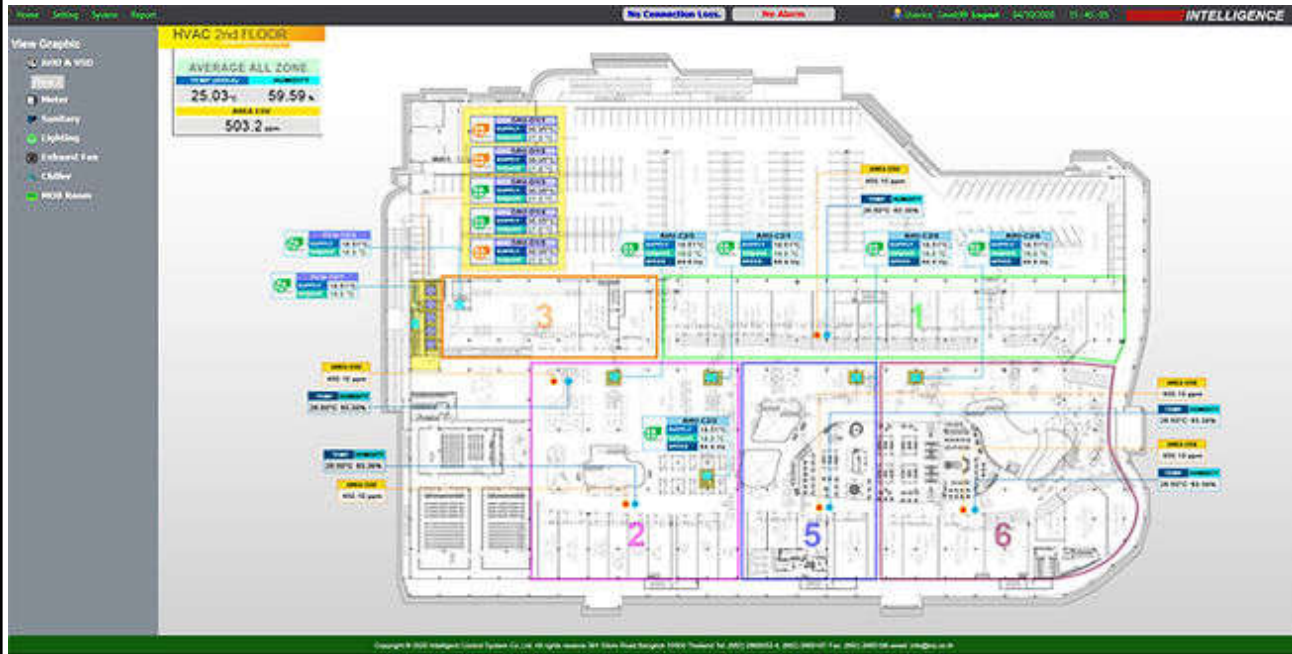

System : AHU & VSD
Date : 20/11/2017 - 20/11/2017
Time : 00:00 - 23:59
Sampling : 1 Minute

Device

1: AHU-1/1
↓

2: AHU-1/2
↓

3: AHU-1/3
↓

Supply Temp

↓

↓


↓

Load Data

Line Chart	Table	Create Group Dialog		
			XLS	
Datetime	AHU-1/1 Supply Temp	AHU-1/2 Supply Temp	AHU-1/3 Supply Temp	
2017-11-20 00:00:00	26.69	26.32	26.9	
2017-11-20 00:01:00	26.69	26.32	26.83	
2017-11-20 00:02:00	26.69	26.38	26.85	
2017-11-20 00:03:00	26.67	26.31	26.85	
2017-11-20 00:04:00	26.63	26.34	26.87	
2017-11-20 00:05:00	26.67	26.34	26.87	
2017-11-20 00:06:00	26.61	26.34	26.89	
2017-11-20 00:07:00	26.58	26.25	26.94	
2017-11-20 00:08:00	26.58	26.27	26.96	
2017-11-20 00:09:00	26.59	26.32	26.92	
2017-11-20 00:10:00	26.54	26.29	26.94	
2017-11-20 00:11:00	26.61	26.29	26.87	
2017-11-20 00:12:00	26.54	26.27	26.87	
2017-11-20 00:13:00	26.59	26.27	26.92	
2017-11-20 00:14:00	26.58	26.36	26.94	
2017-11-20 00:15:00	26.59	26.29	26.89	
2017-11-20 00:16:00	26.63	26.31	26.94	
2017-11-20 00:17:00	26.63	26.36	26.87	


⏮
⏪
1
2
3
4
5
6
7
8
9
10
...
⏩
⏭

www.3pvalgetz.com
 1 - 18 of 144

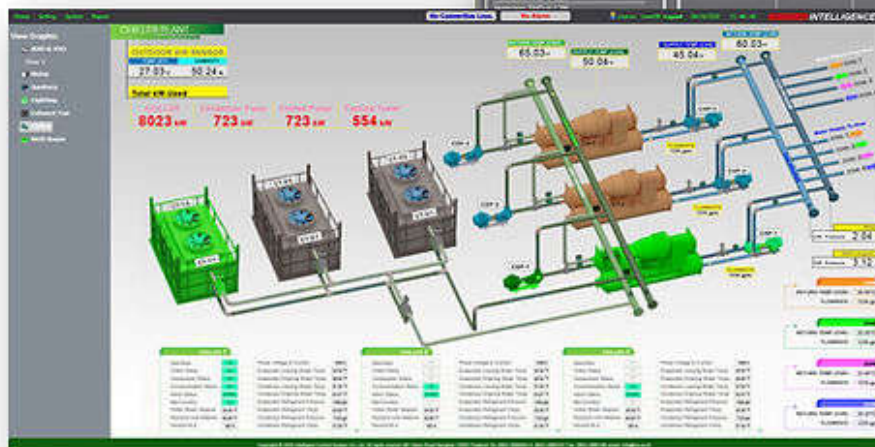


(Source: <https://www.ics.co.th/bas>)

An example of building automation system (BAS) graphic interface

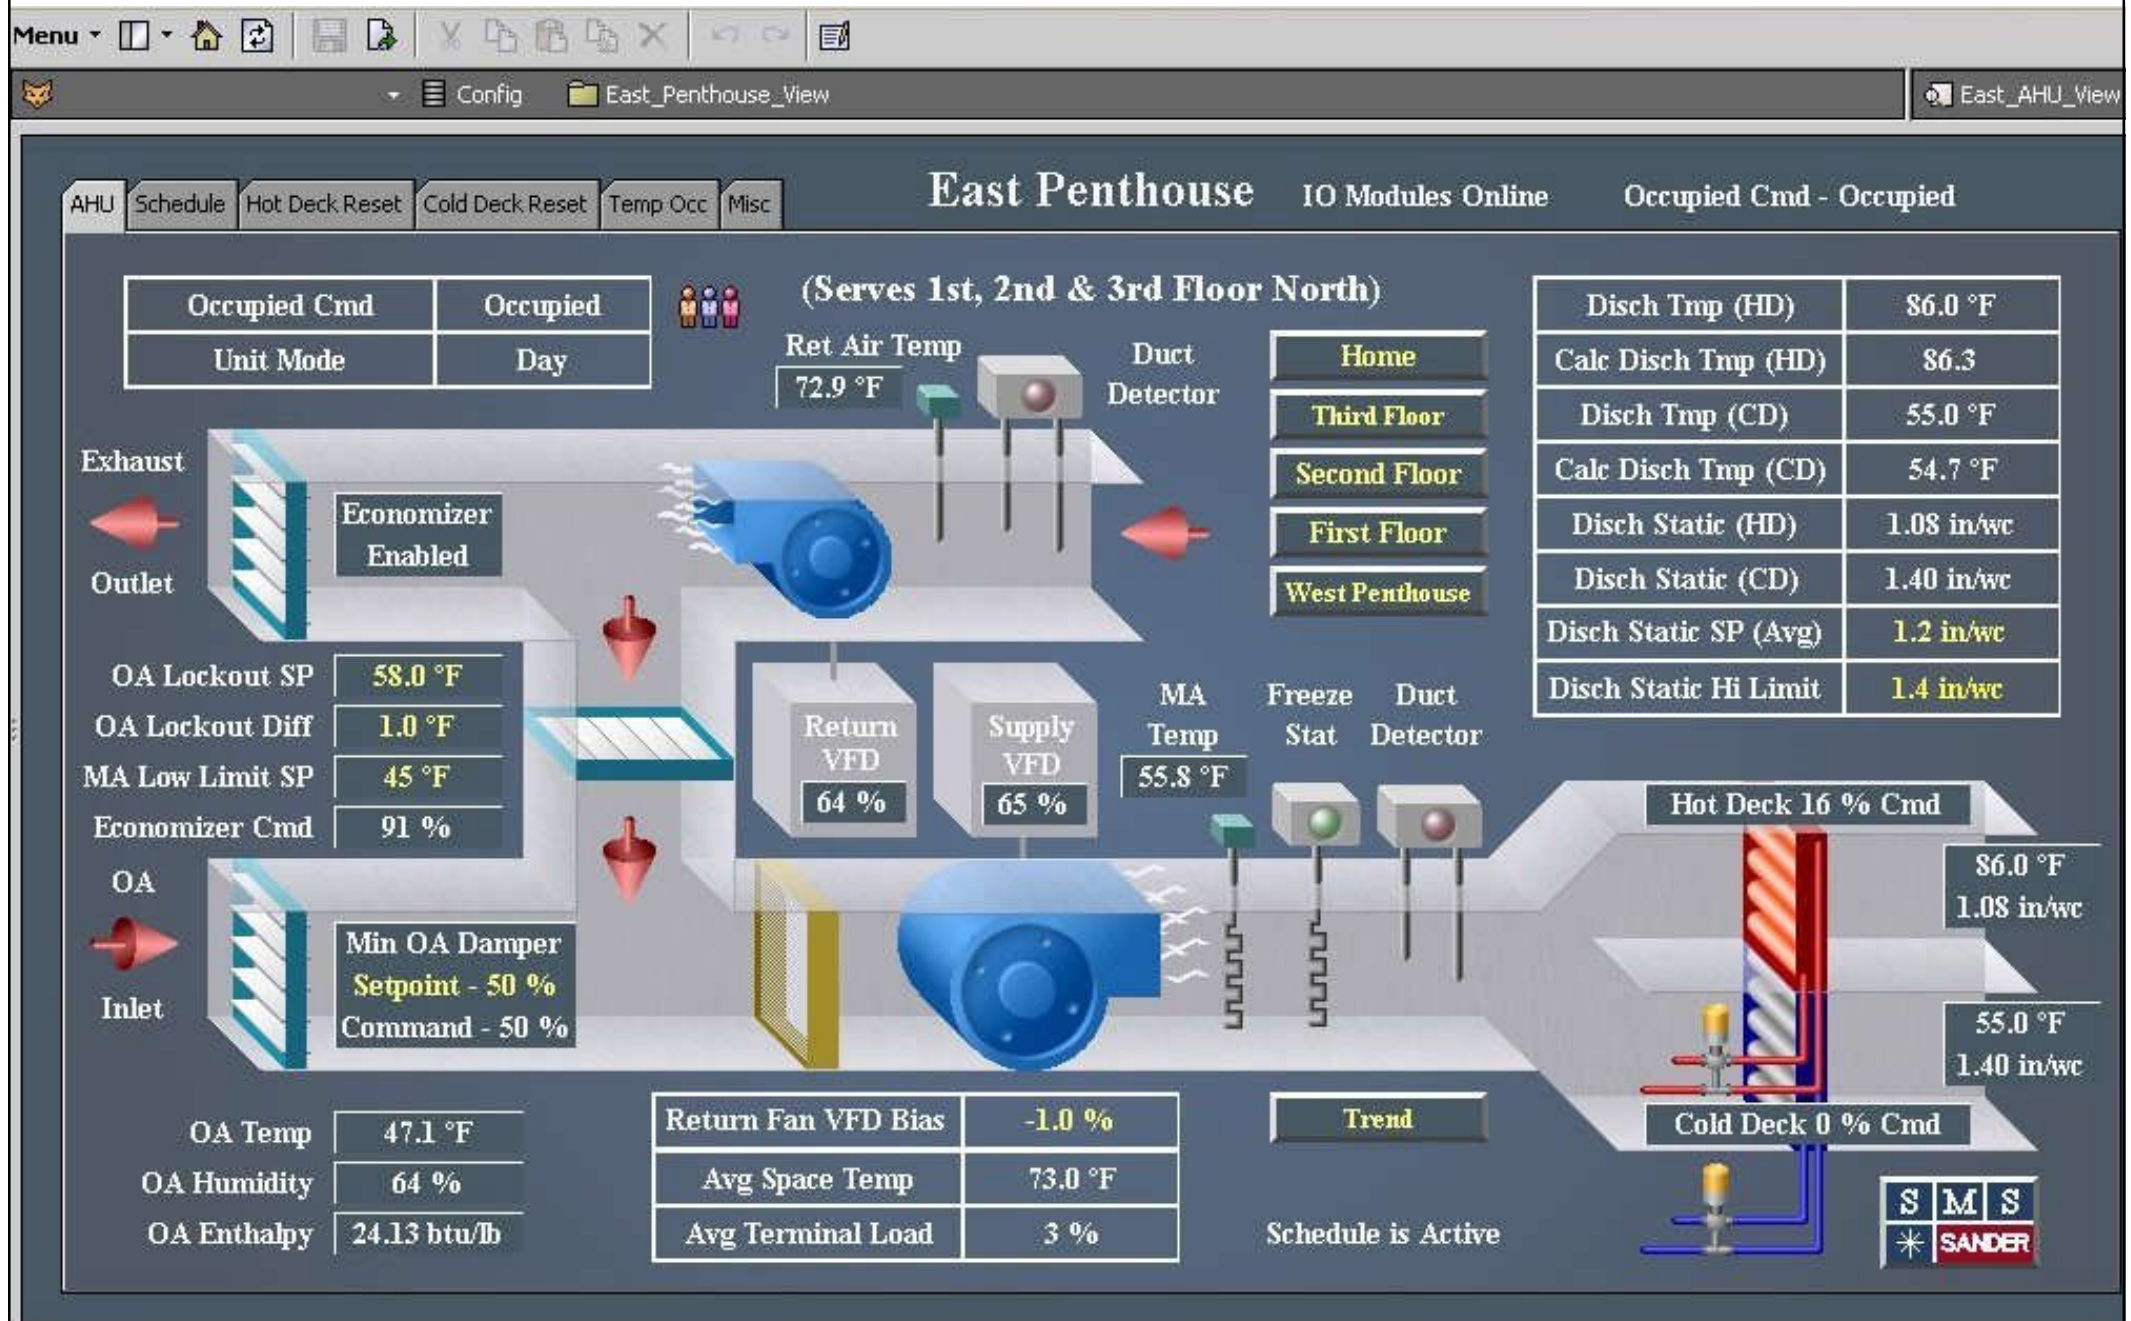

Sample of chilled water loop system graphic

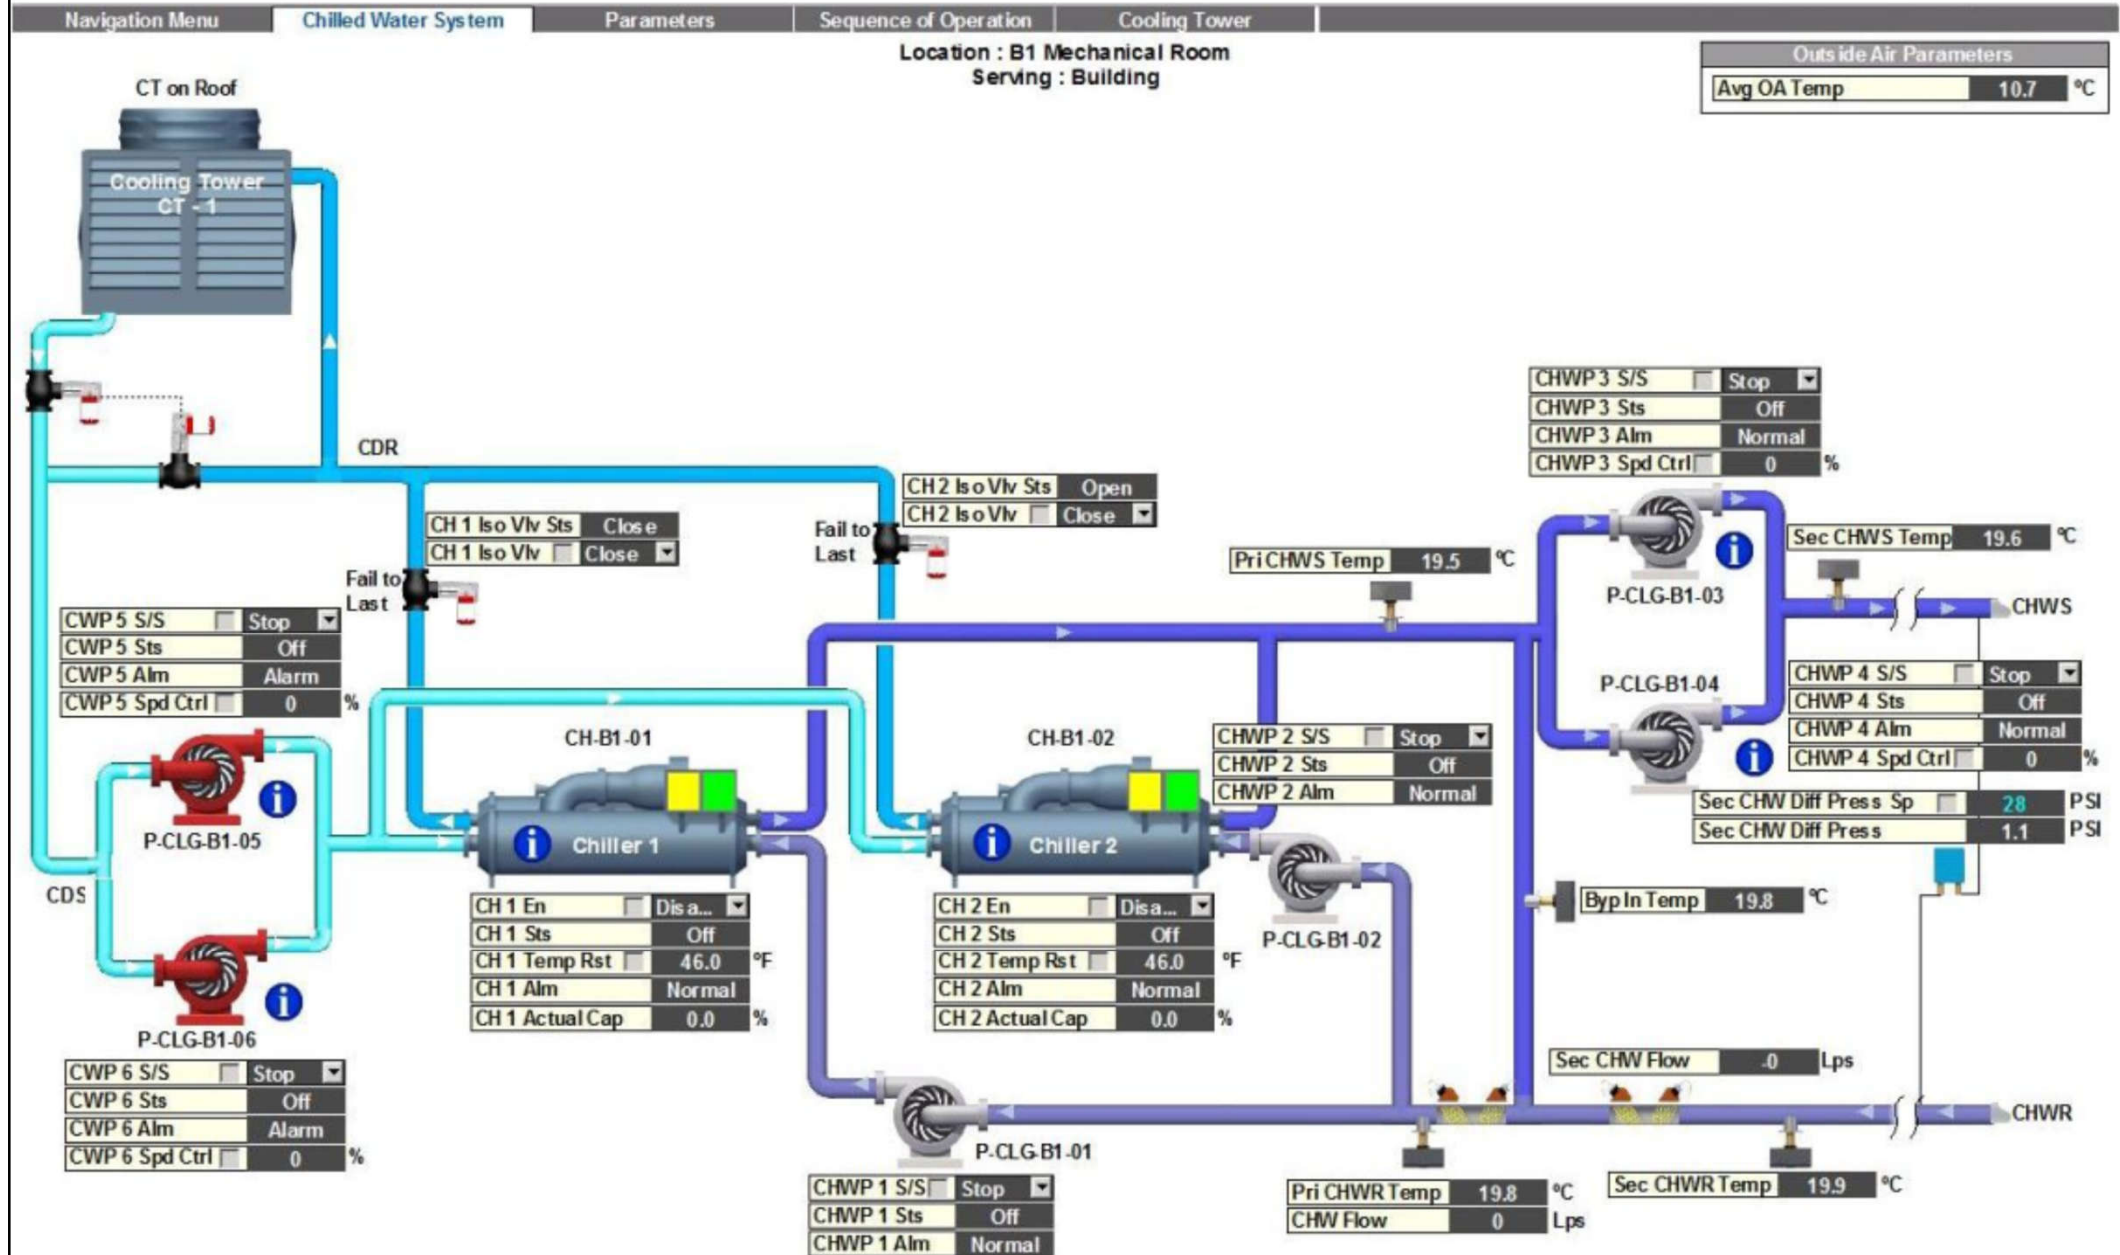

System design



- BAS documentation
 - 1. Functional Description (FD)
 - Details the configuration of the BAS/BMS
 - Overview of the building services systems, sub-systems & other related parts
 - Describes in detail each of the BAS/BMS control strategies & sequences of operation
 - Documents interaction between each part of the system

System design




- BAS documentation (cont'd)
 - 2. Point Schedules
 - Detail all connected devices & their point type
 - Critical for planning & system engineering
 - 3. Control System Drawings
 - Should include a network architecture drawing
 - Detail the physical wiring connections to controllers
 - Useful for fault finding & establishing spare capacity

Importance of system documentation

Point Description	DI	DO	AI	AO	HLI	Comments
Chiller HLI					2	Modbus Connection to Chiller
Chiller enable		2				
Chiller run status	2					
Chiller fault status	2					
CHW Pump start / stop		2				At MSSB
CHW Pump run status	2					
CHW Pump speed control				2		Direct to VSDs
CHW Flow temperature			2			
CHW return temperature			1			
CHW system pressure			1			
CHW bypass valve				1		
Tenant Cooling Tower Fans Start / Stop		2				
Tenant Cooling Tower Fans Status	2					
Tenant Cooling Tower Fans Speed				2		
Tenant Cooling Tower Spray Start / Stop		2				
Tenant Cooling Tower Spray Status	2					
Tenant CCW System Pressure			1			
Tenant CCW Pump start / stop		2				
Tenant CCW Pump run status	2					
Tenant CCW Pump speed control				2		
Tenant CCW Flow temperature			1			
Tenant CCW return temperature			1			
Totals	12	10	7	7	2	

- ▶ DI – Digital Inputs
- ▶ DO – Digital Outputs
- ▶ AI – Analogue Input
- ▶ AO – Analogue Output
- ▶ HLI – High Level Interface

- ▶ BMS Drawings show device details and wiring connections

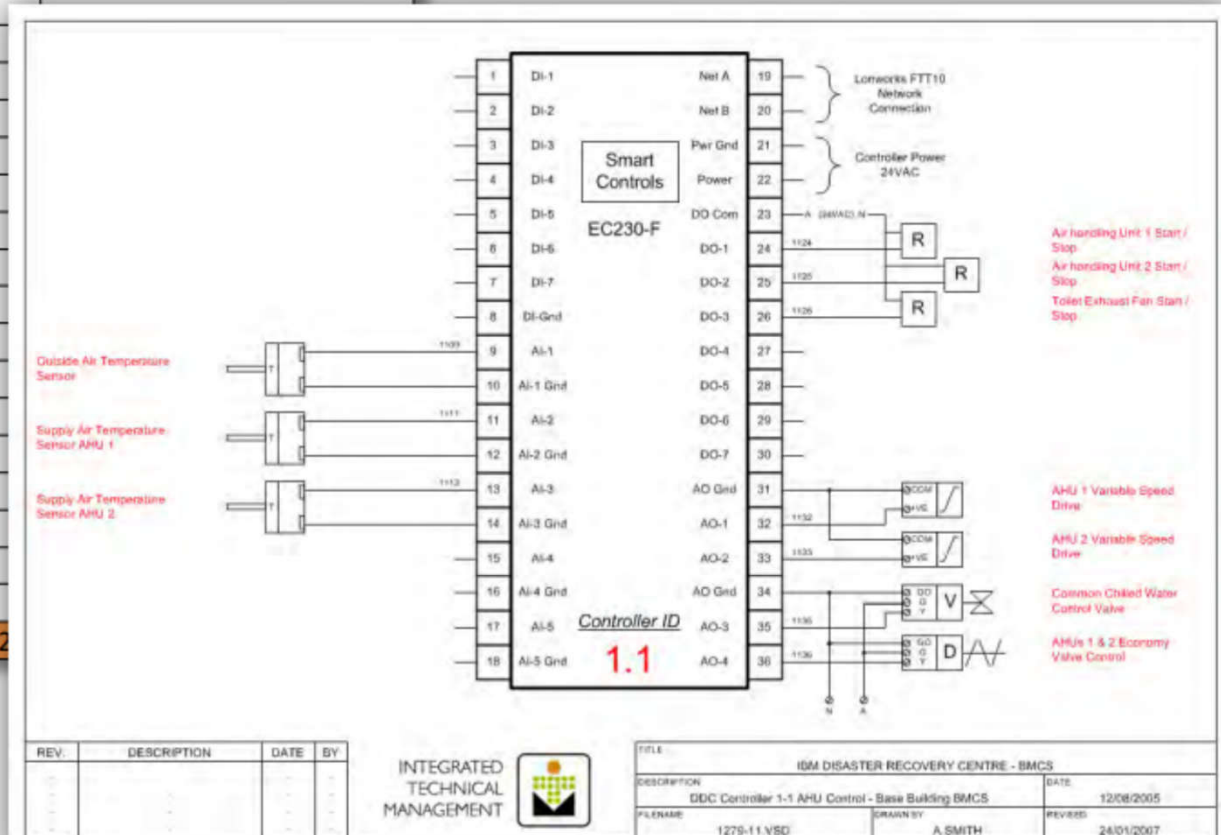

System design



- System maintenance
 - The building owner should act as its administrator managing BAS access rights
 - The BAS should be maintained with an appropriate level of servicing
 - As with any software driven system, data & files should be backed up on a regular basis
 - Critical components should be identified & checked at regular intervals

System design



- System maintenance (cont'd)
 - BAS functions e.g. trend data, reports & alarms can be used to perform maintenance by exception
 - Maintenance should be approached as the performance of the controlled system not individual components, i.e. AHU or chiller plant
 - While the BAS equipment vendor should be utilised to maintain the critical components, other suitably qualified technicians can be utilised for field equipment

System design



- BAS lifecycle considerations
 - Considerations:
 - Check equipment production cycle status
 - Select hardware with proven record (avoid beta)
 - Check for level of software & hardware support
 - Check for forward compatibility policy
 - Equipment Lifecycle:
 - BAS/BMS field controllers – 15 to 20 years
 - Field devices – 15 to 20 years
 - BAS/BMS computer hardware – 3 to 5 years
 - BAS/BMS software – Major releases 3 to 5 years






System components

- BAS system architecture
 - Define how well the many systems in the building work together
 - Indicate the design or set of relations between the parts of a system
 - A four-layer concept adopted by manufacturers:
 - 1. Application
 - 2. Supervisory
 - 3. Field Controller
 - 4. Input/Output

Four layers of modern building automation system (BAS) architecture

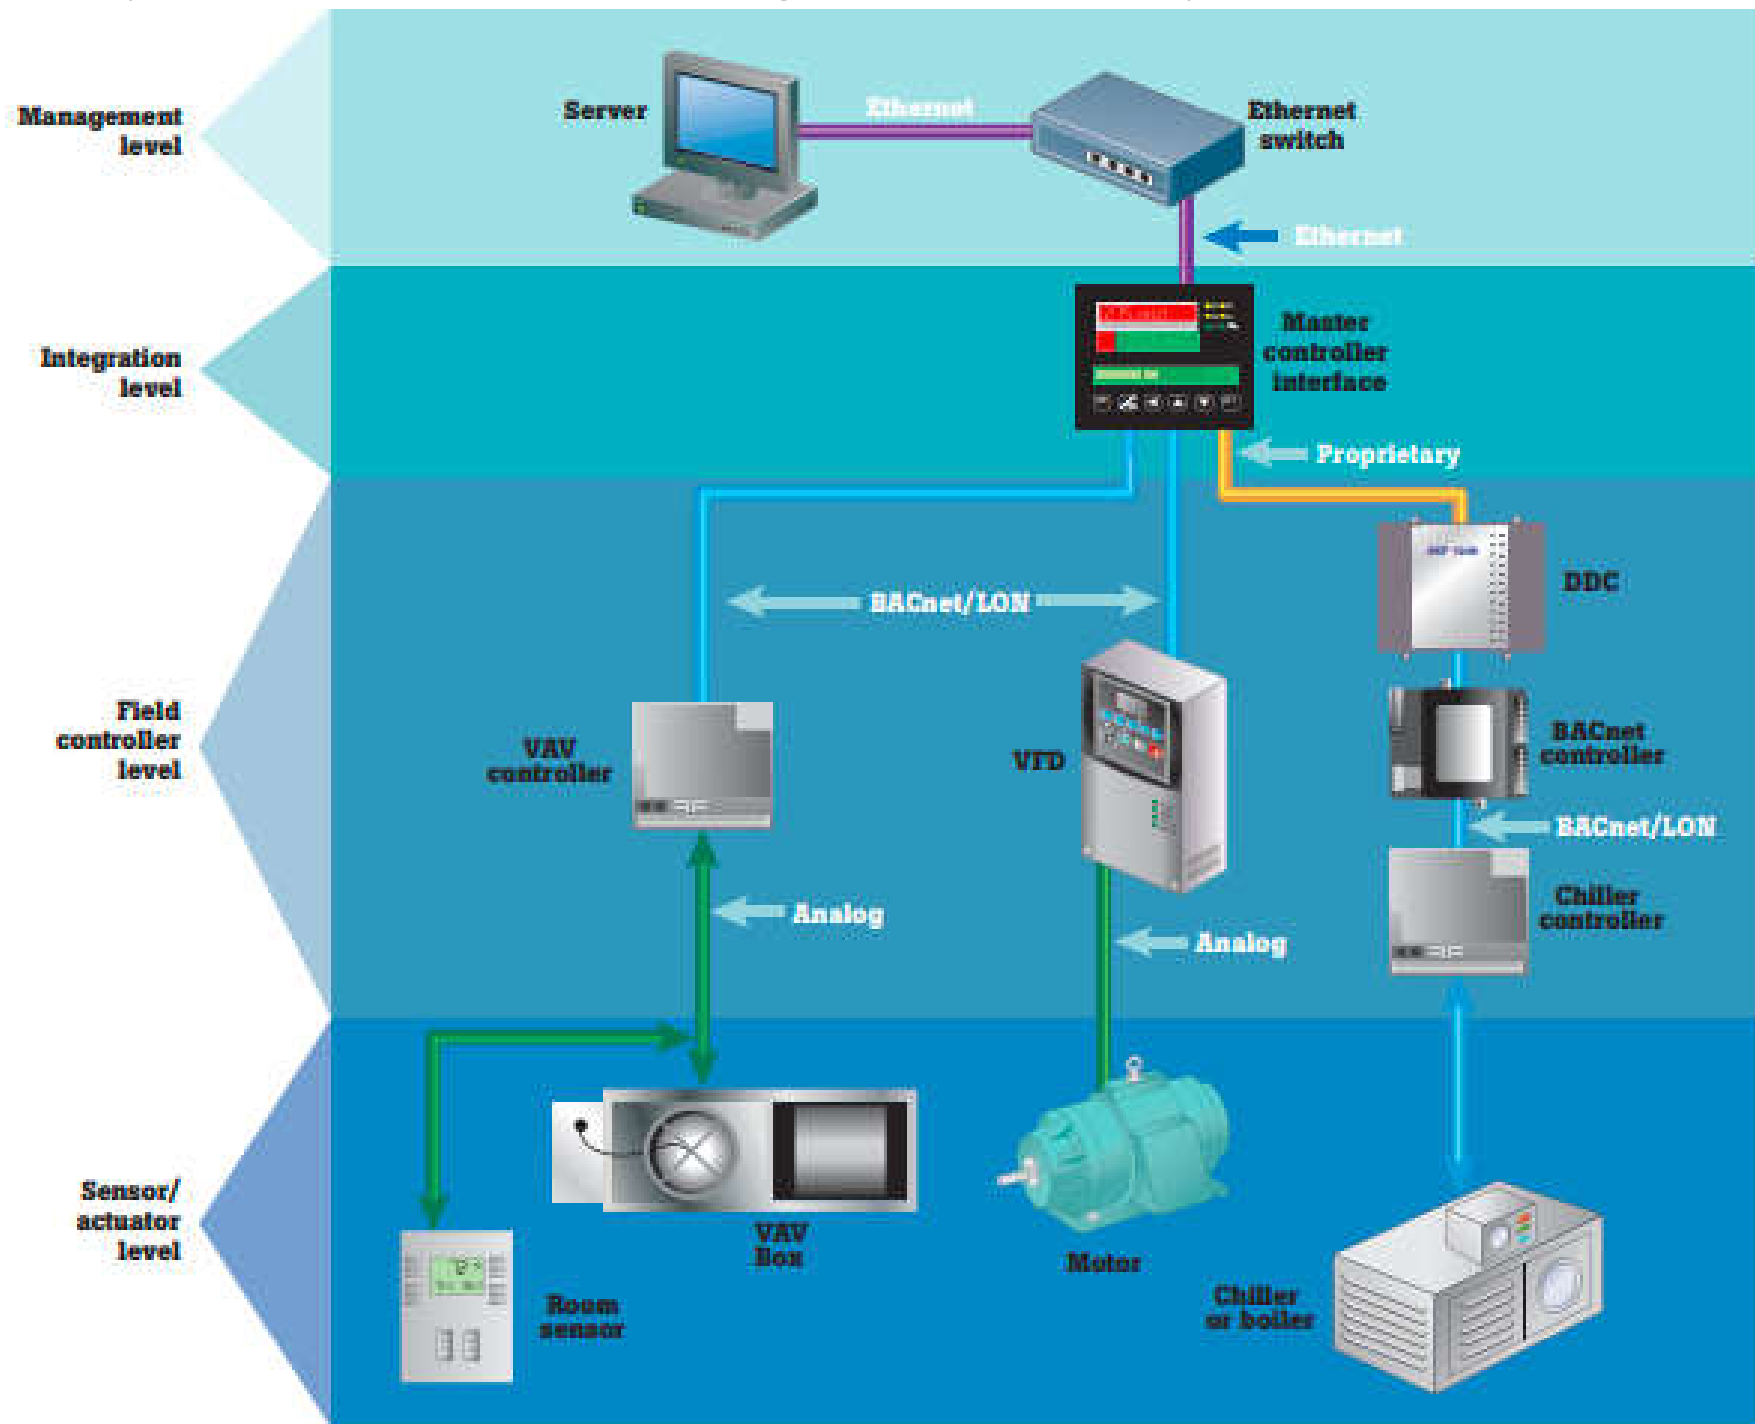




System components


- Four tiers of BAS:
 - Tier 1 Enterprise Level – BAS workstation, control centre
 - Tier 2 Building Level – Building BAS panels & routers
 - Tier 3 Equipment Level – Main equipment of systems
 - Tier 4 Sensors & control devices

Four tiers of building automation system (BAS)

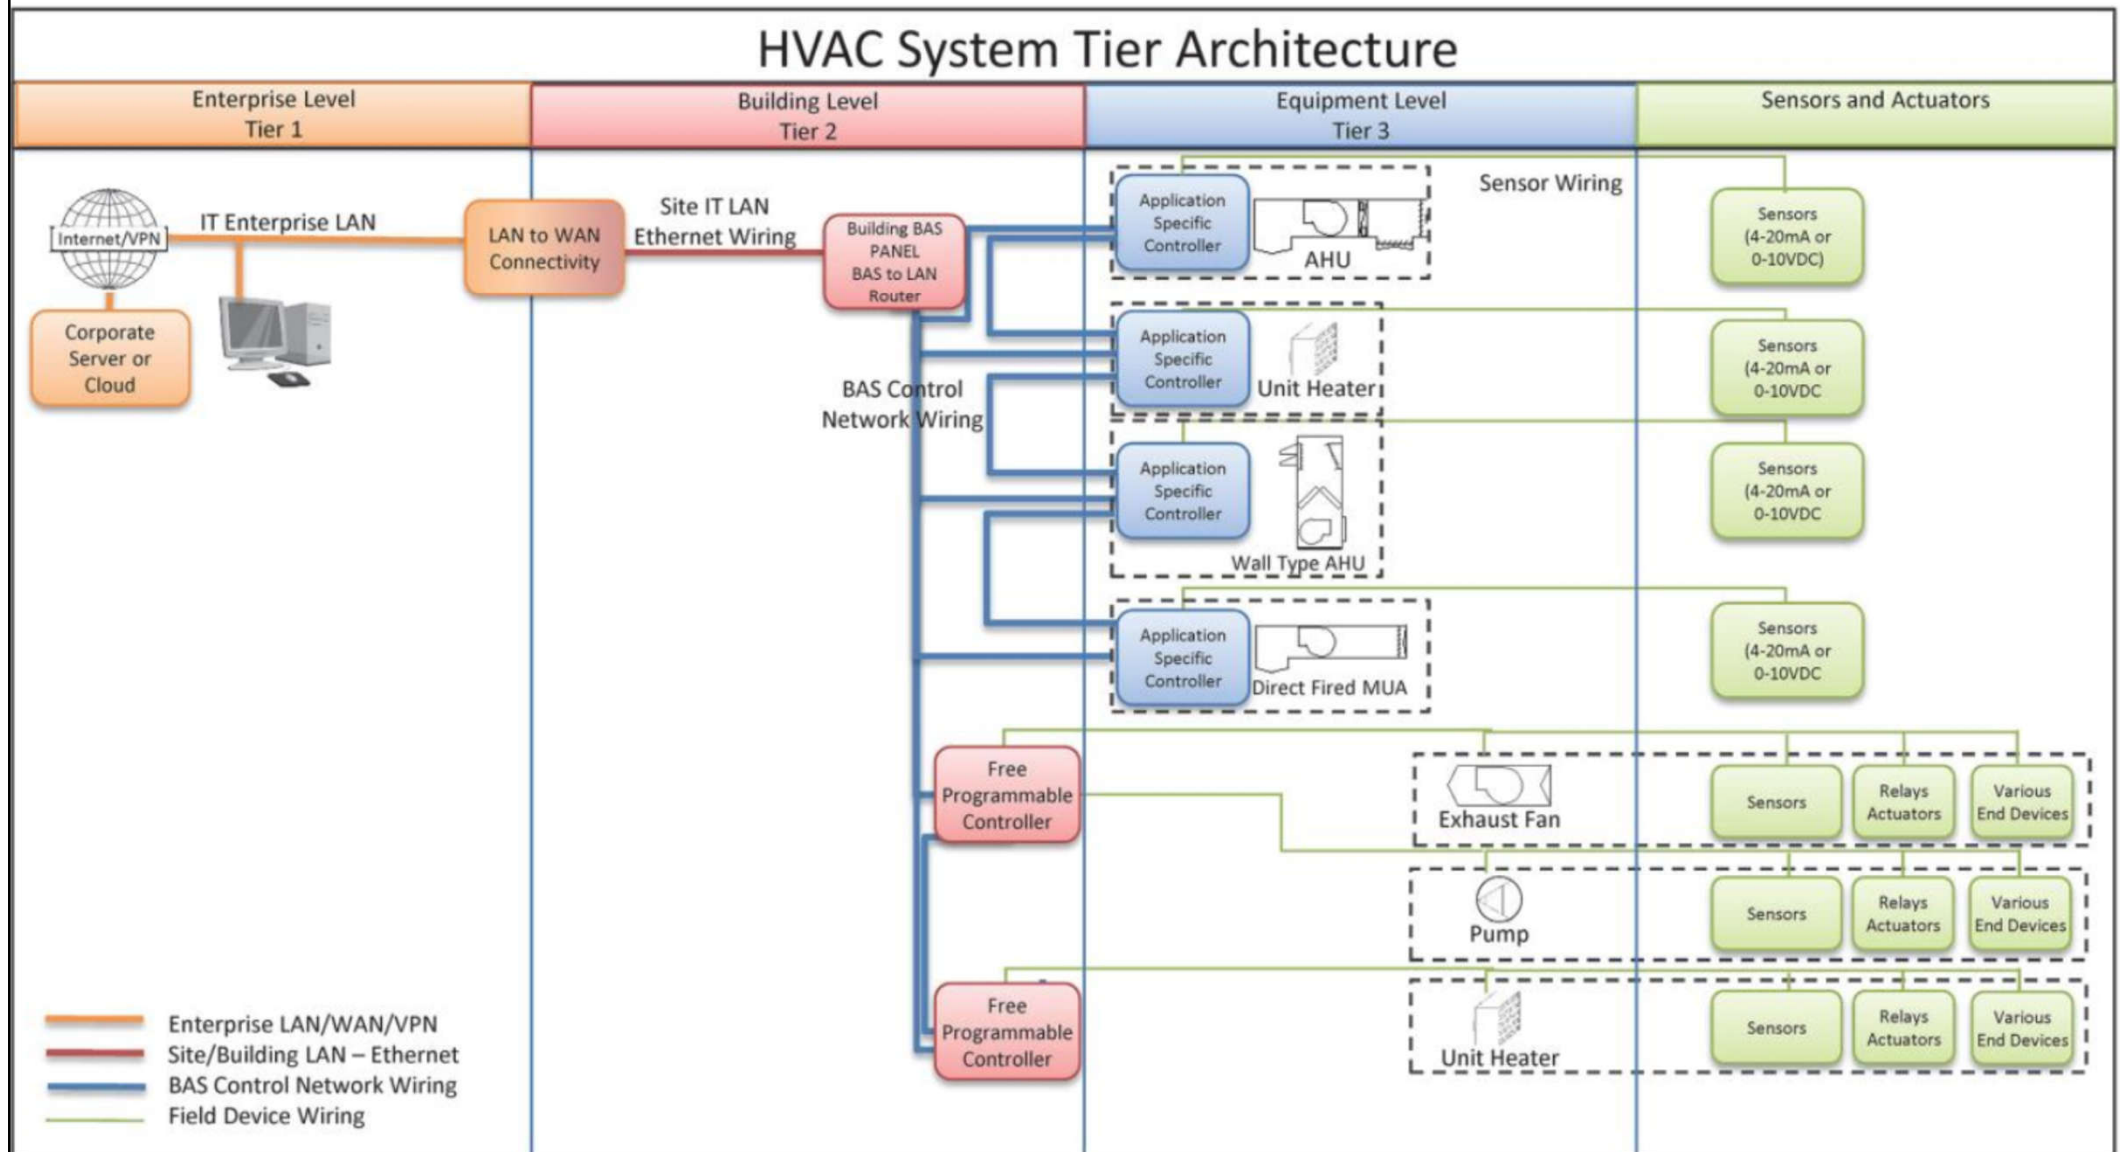


Building automation system hardware and software stack

Hardware

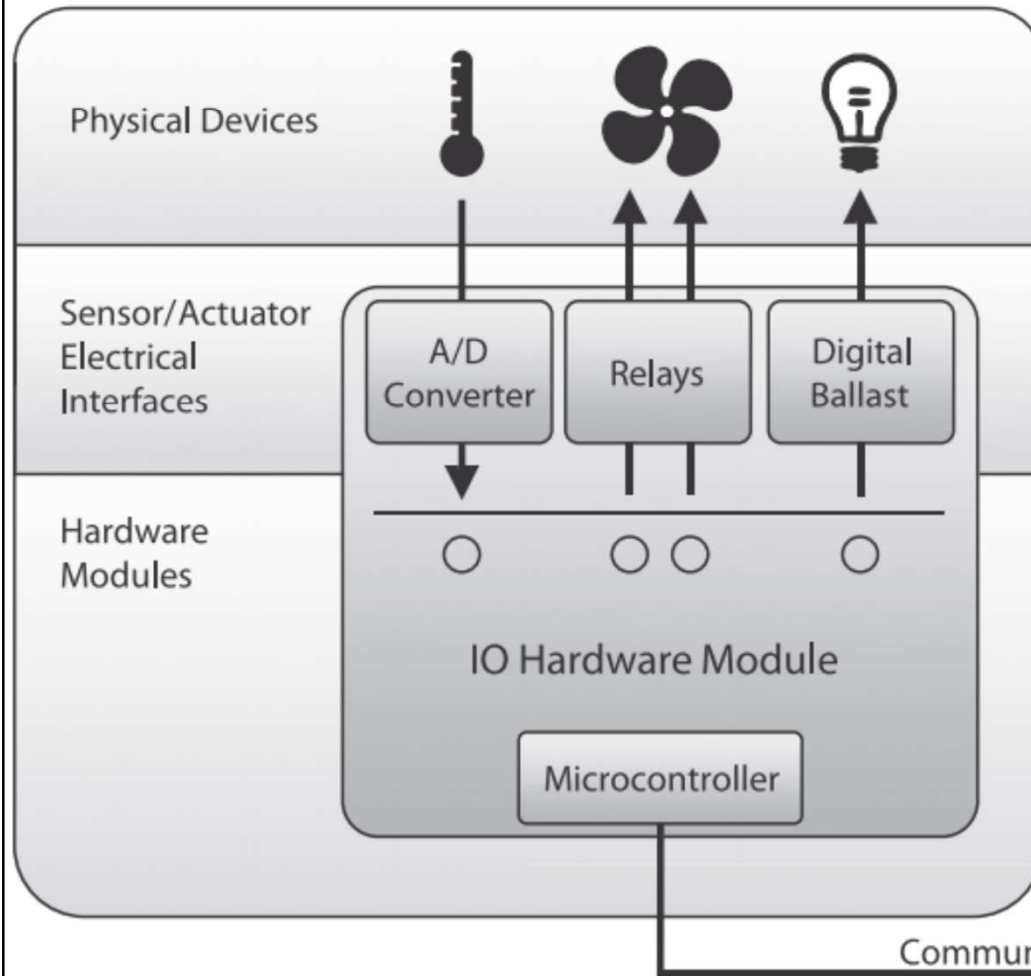


Software

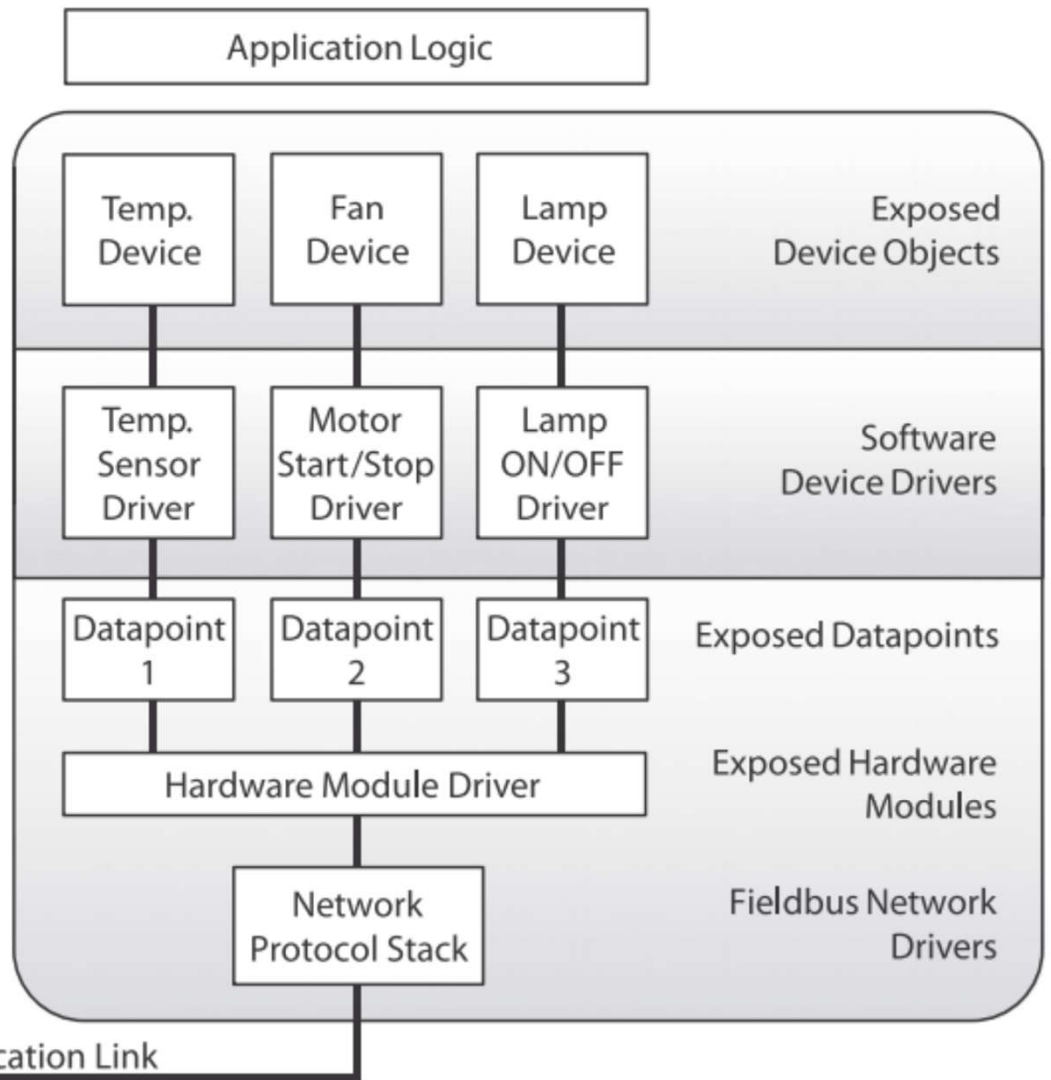




System components

- Typical components of BAS:
 - Sensors (e.g. temperature, humidity, lighting level)
 - Controllers (the “brain” of BAS)
 - Output devices (e.g. actuators & relays, to carry out commands from controllers)
 - Communication protocols (specific language understood by the system components to modify settings or execute commands)
 - Terminal interface (e.g. user interface, workstations)

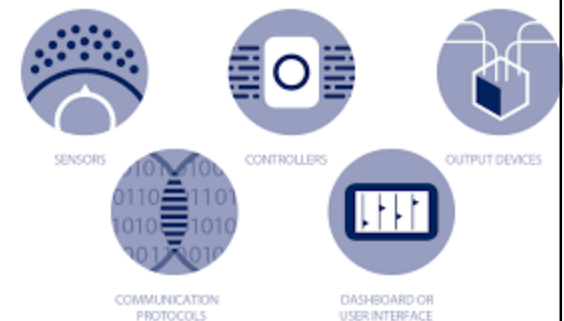


Typical BAS system components – field devices

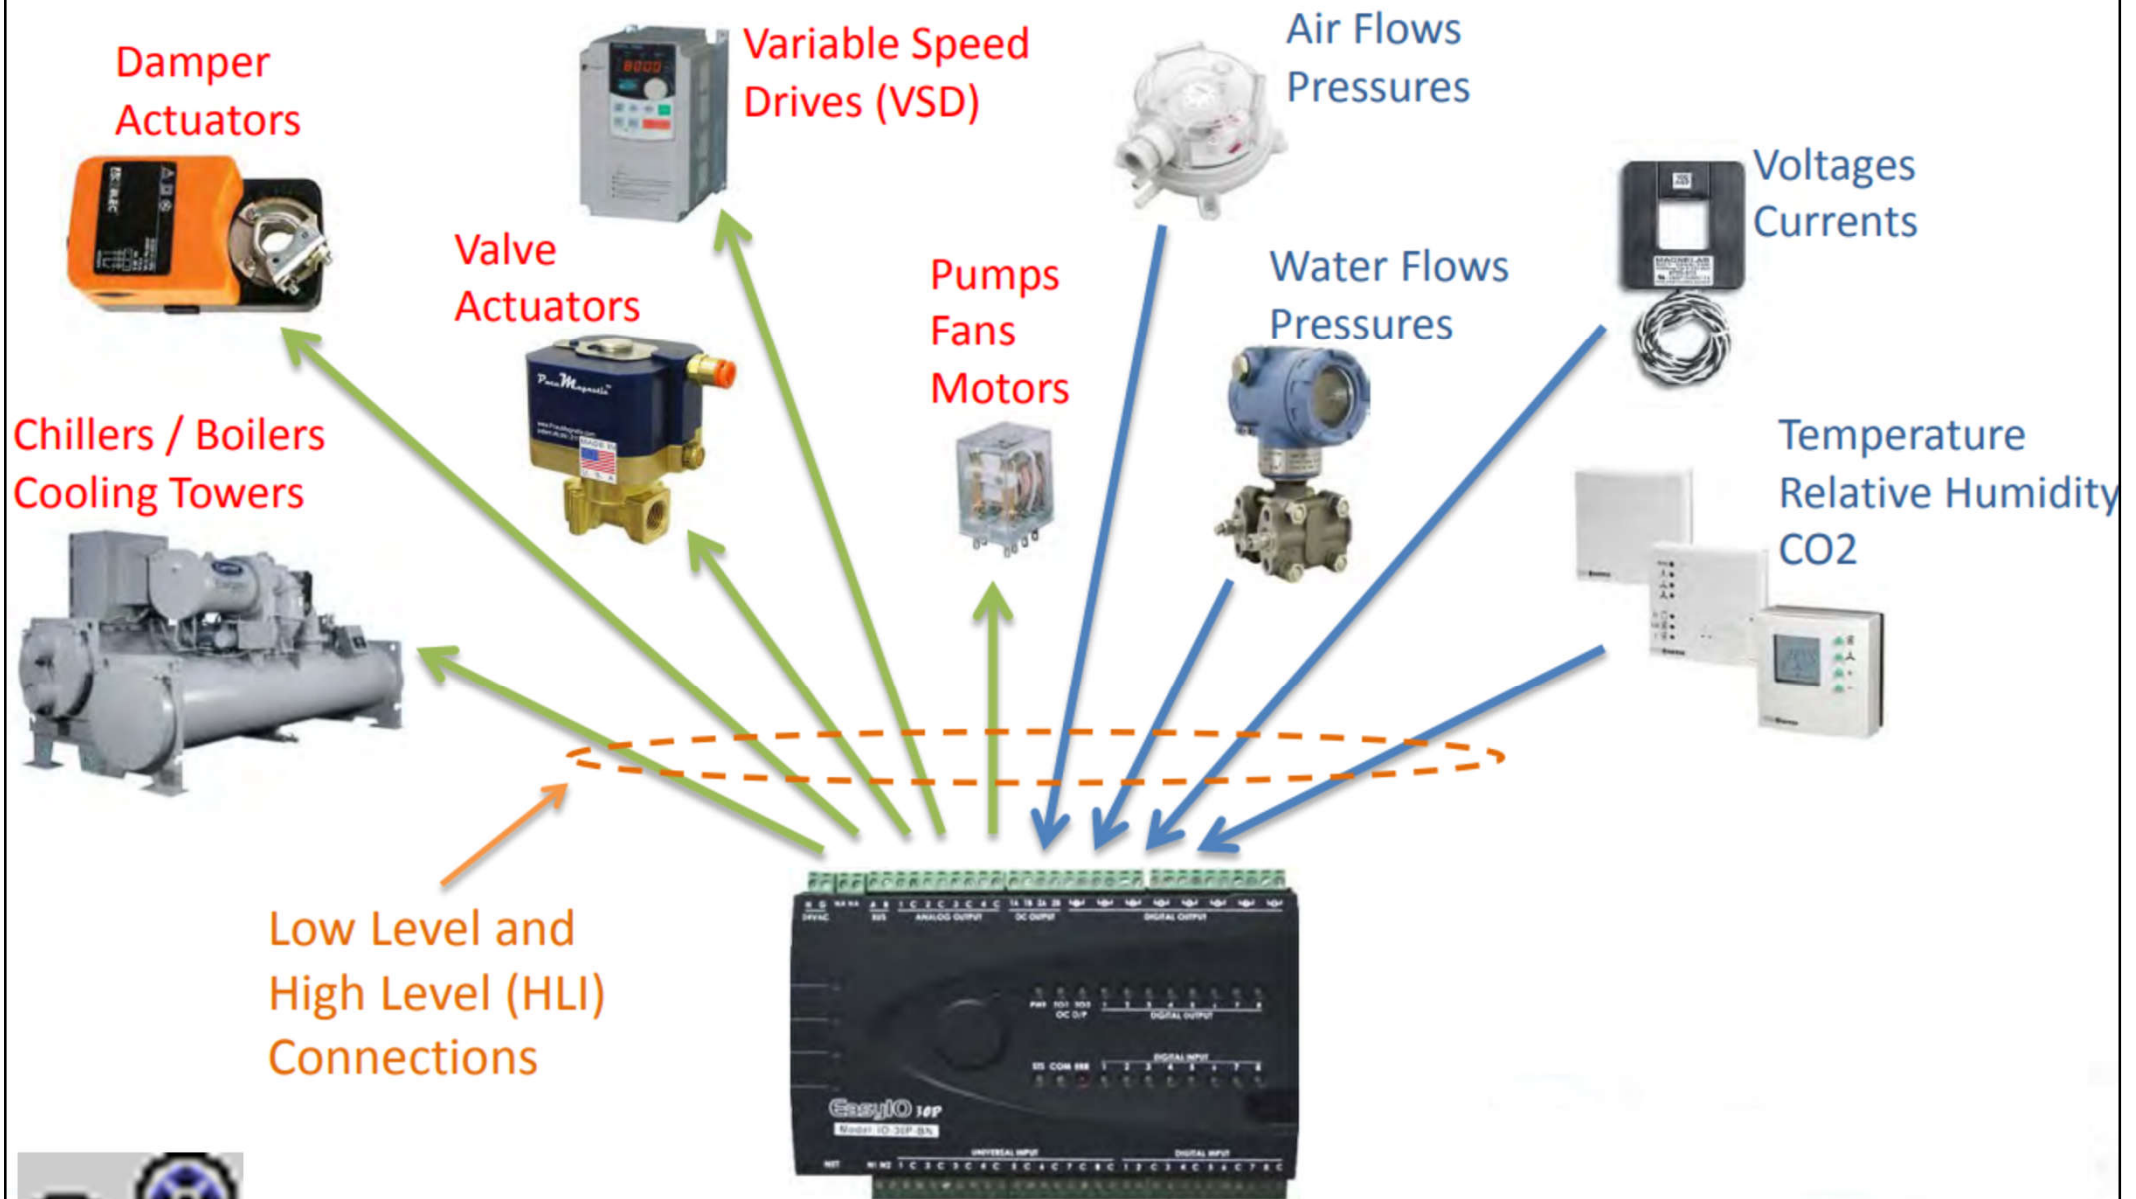

Video: Building Automation Systems (BAS) Operations (2:06)


<https://youtu.be/ByrysZAwoPI>

Typical building automation system (BAS) topology

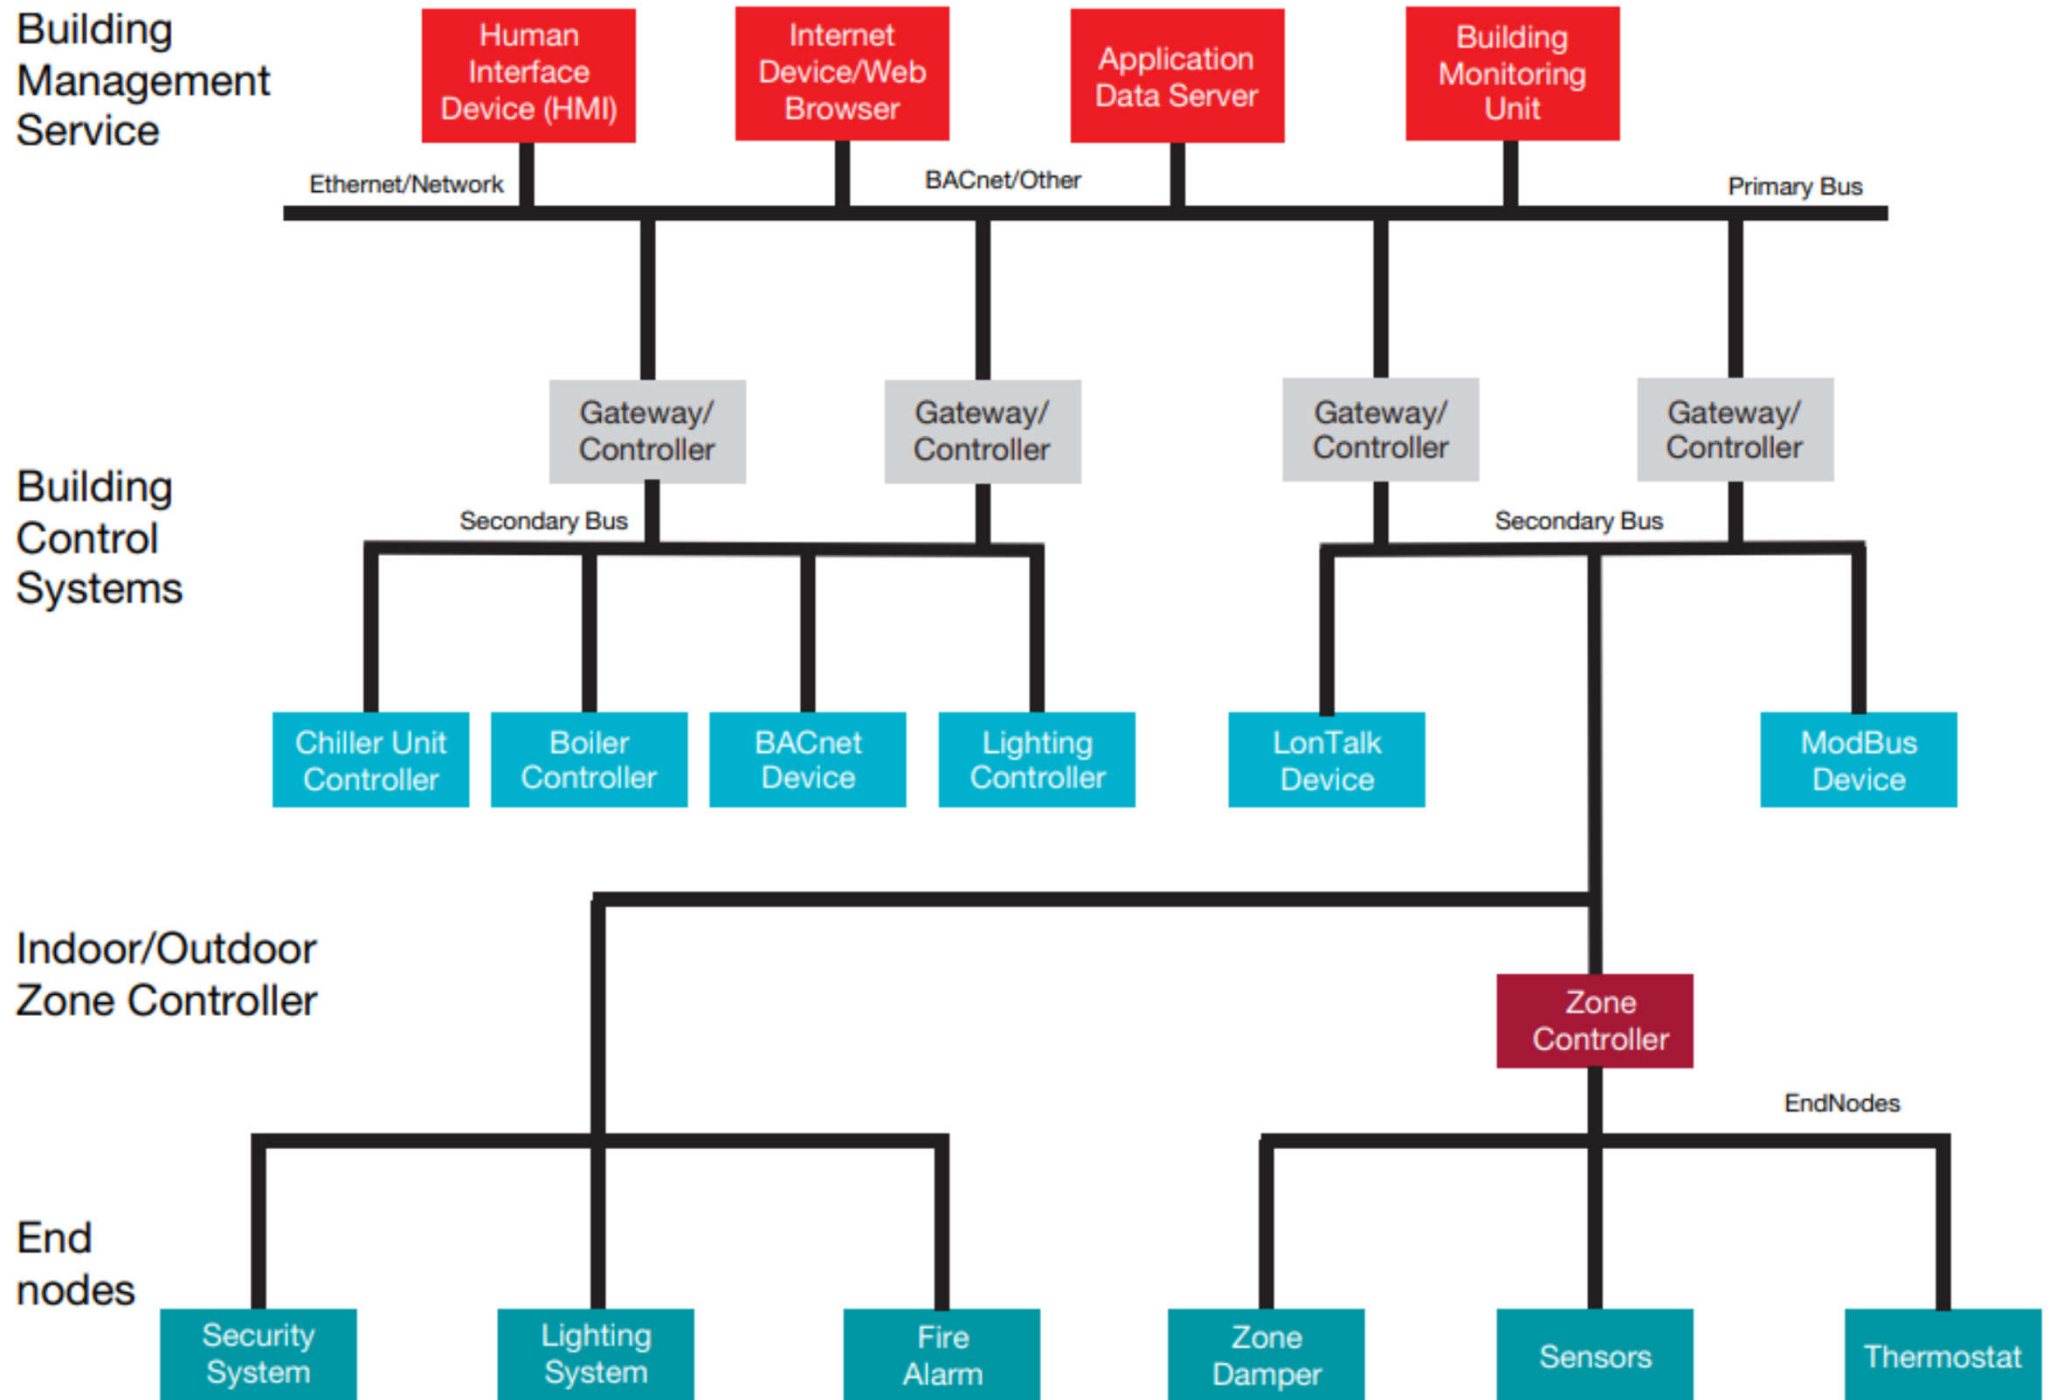


Simplified Open Systems Interconnection (OSI) model for BAS


OSI Model

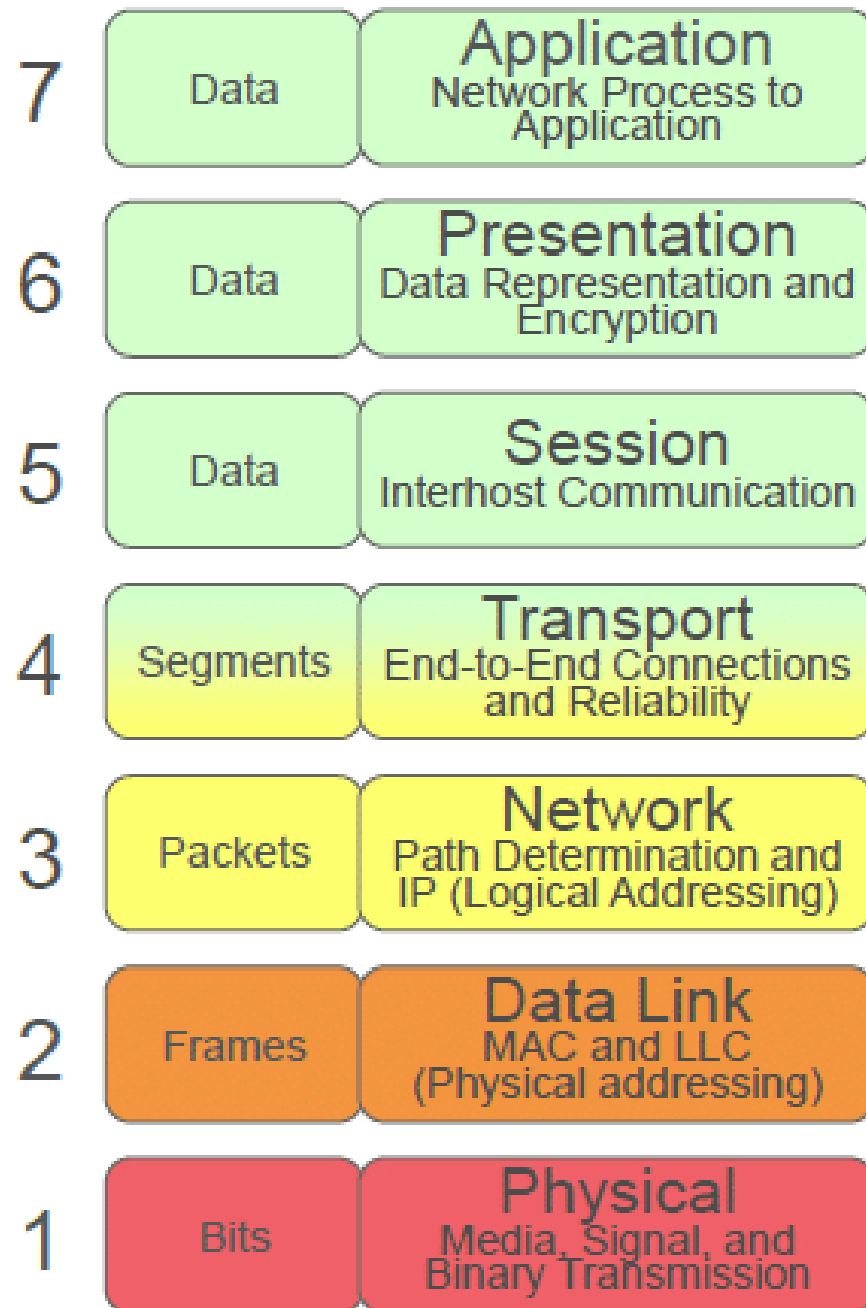

Simplified OSI Model

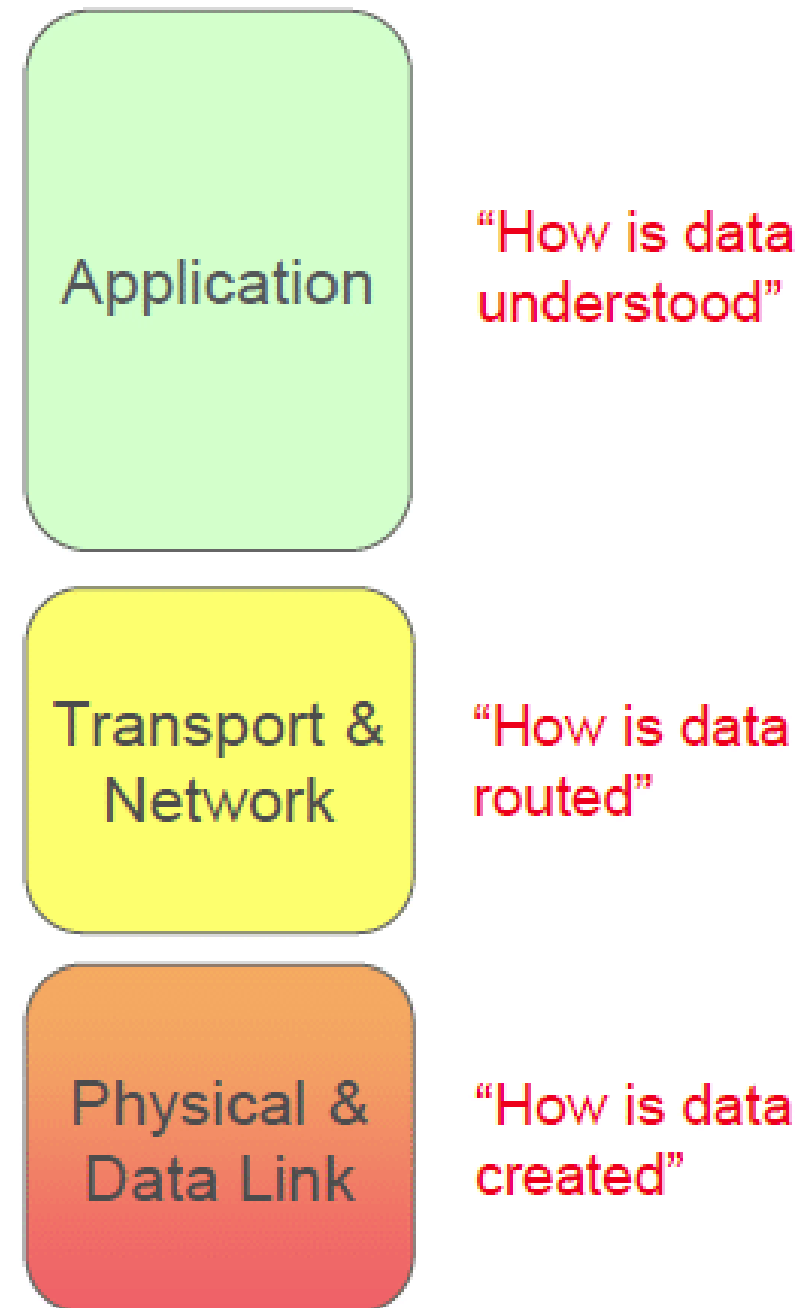

Automated Buildings Evolution

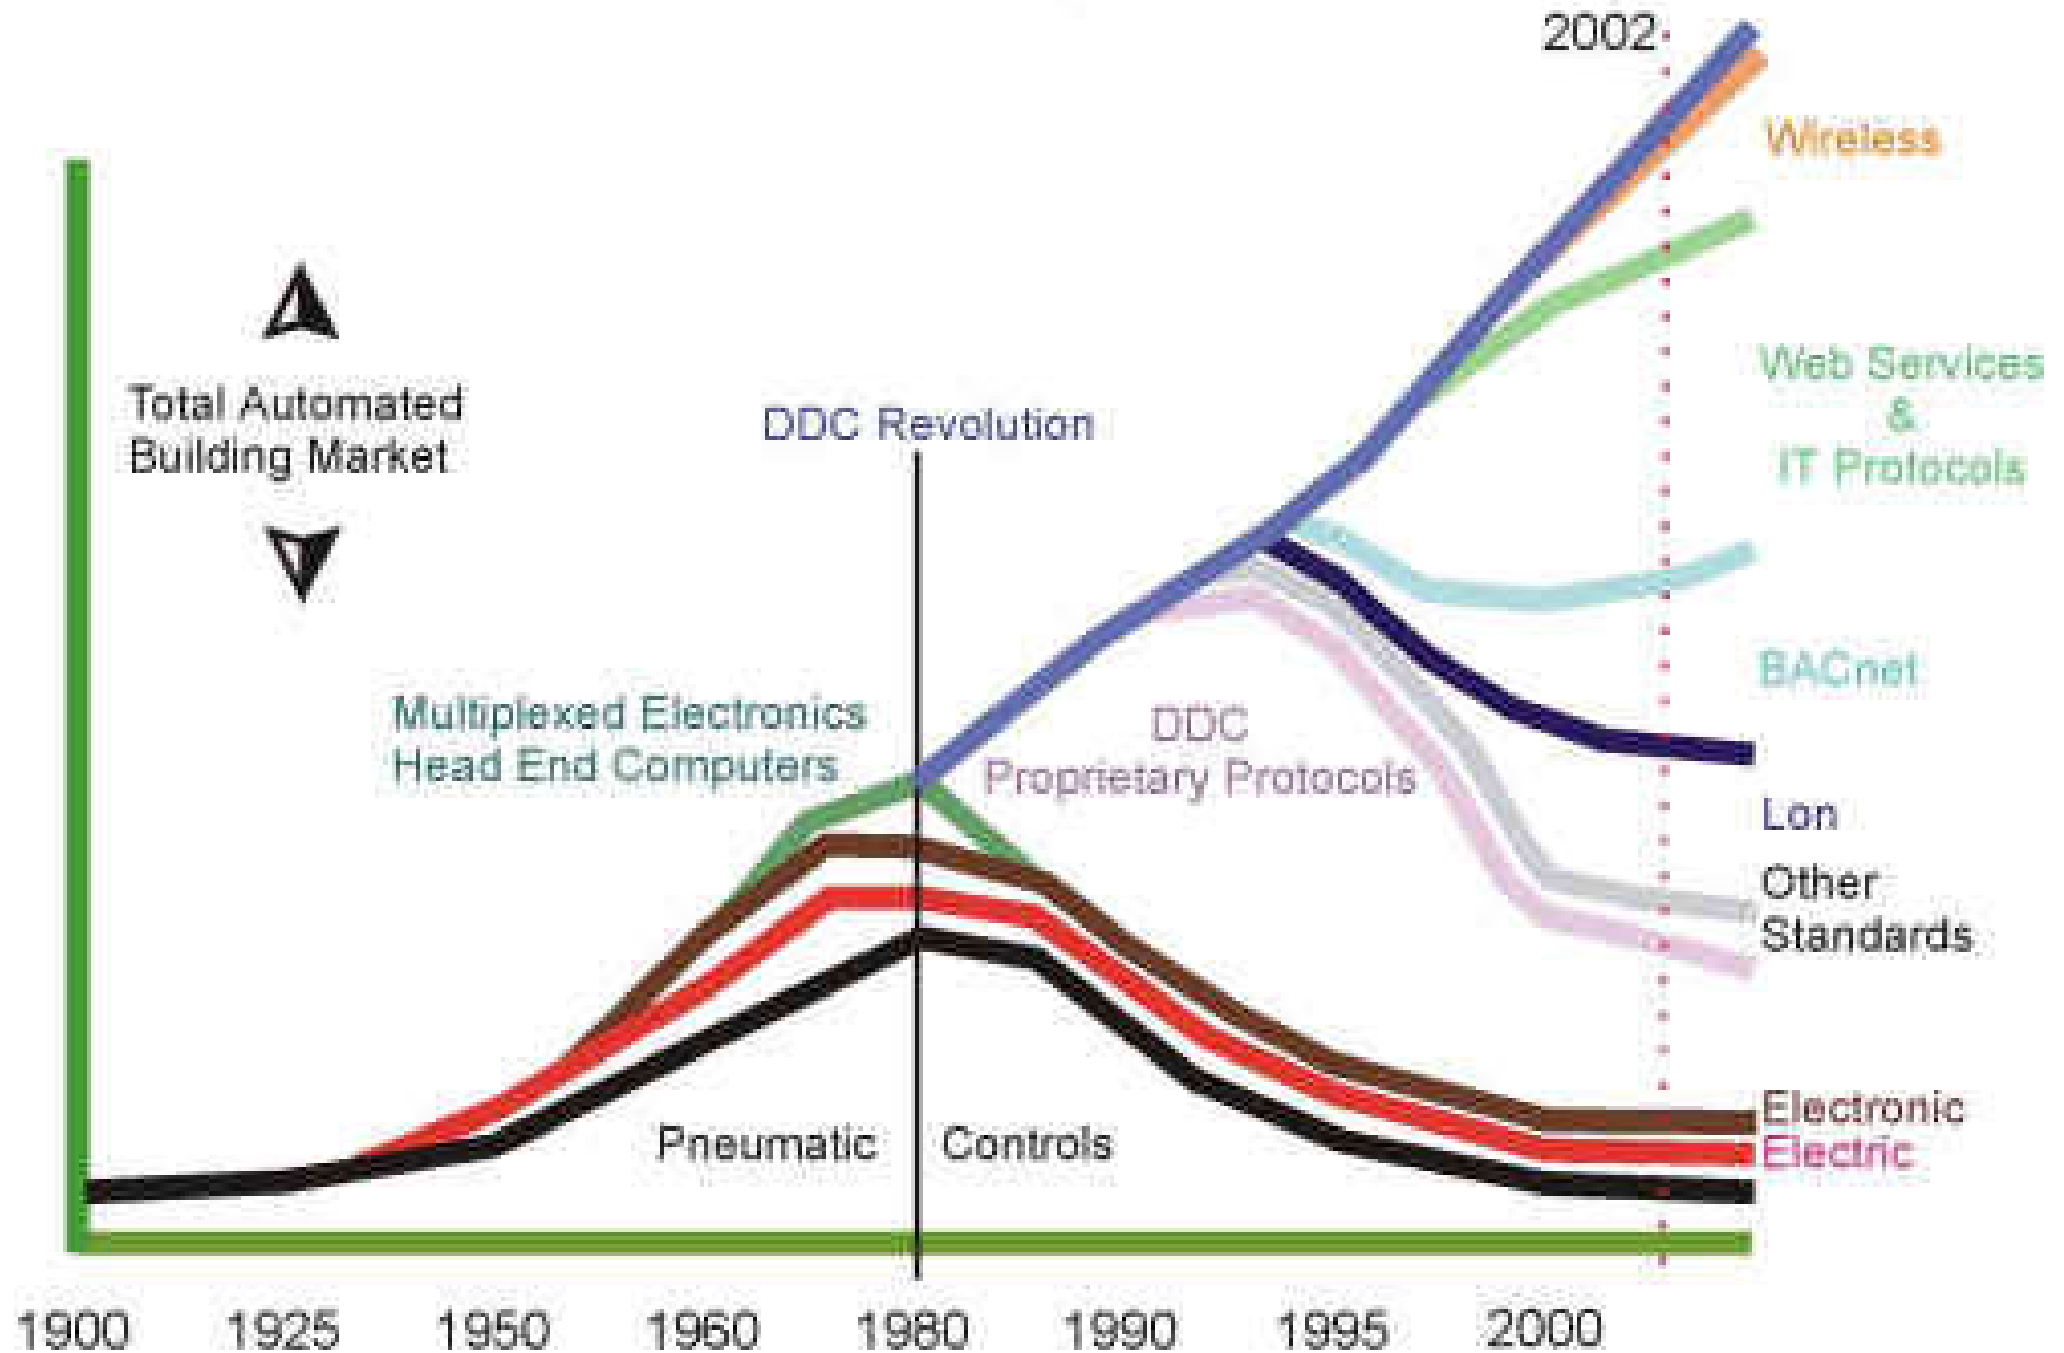

Networking




- History of building automation (BA)
 - Early 1600s: Invention of the thermostat
 - 1884: Invention of the modern light switch
 - Early 20th century: Homes go electric
 - Around 1925: Invention of the heat regulator
 - 1960s: Networking of buildings
 - 1969: The advent of digital control
 - 1979/1980: BA goes digital DDC, high-speed data transfer
 - 1986: Building information modelling (BIM)
 - 1987 and 1990: The advent of non-proprietary standards
 - 1998/1999: Global networking (The Internet & Wi-Fi)

Networking



- History of building automation (BA) (cont'd)
 - 2005: Home automation gains momentum in Germany
 - 2007: Smartphones propel a great leap forward
 - 2008: Building automation joins the cloud (cloud-based services)
 - 2009: Wireless control of lighting
 - 2010: Always on the go, always online
 - 2014: Text-to-speech (TTS) technology
 - 2016: The Internet of Things (IoT) networks building technology
 - 2018: A “brain” for buildings
 - 2020: Turnkey artificial intelligence (AI) & intelligent video techno.
 - The near future: A boom in cloud-based services

An example of BAS topologies with Cloud

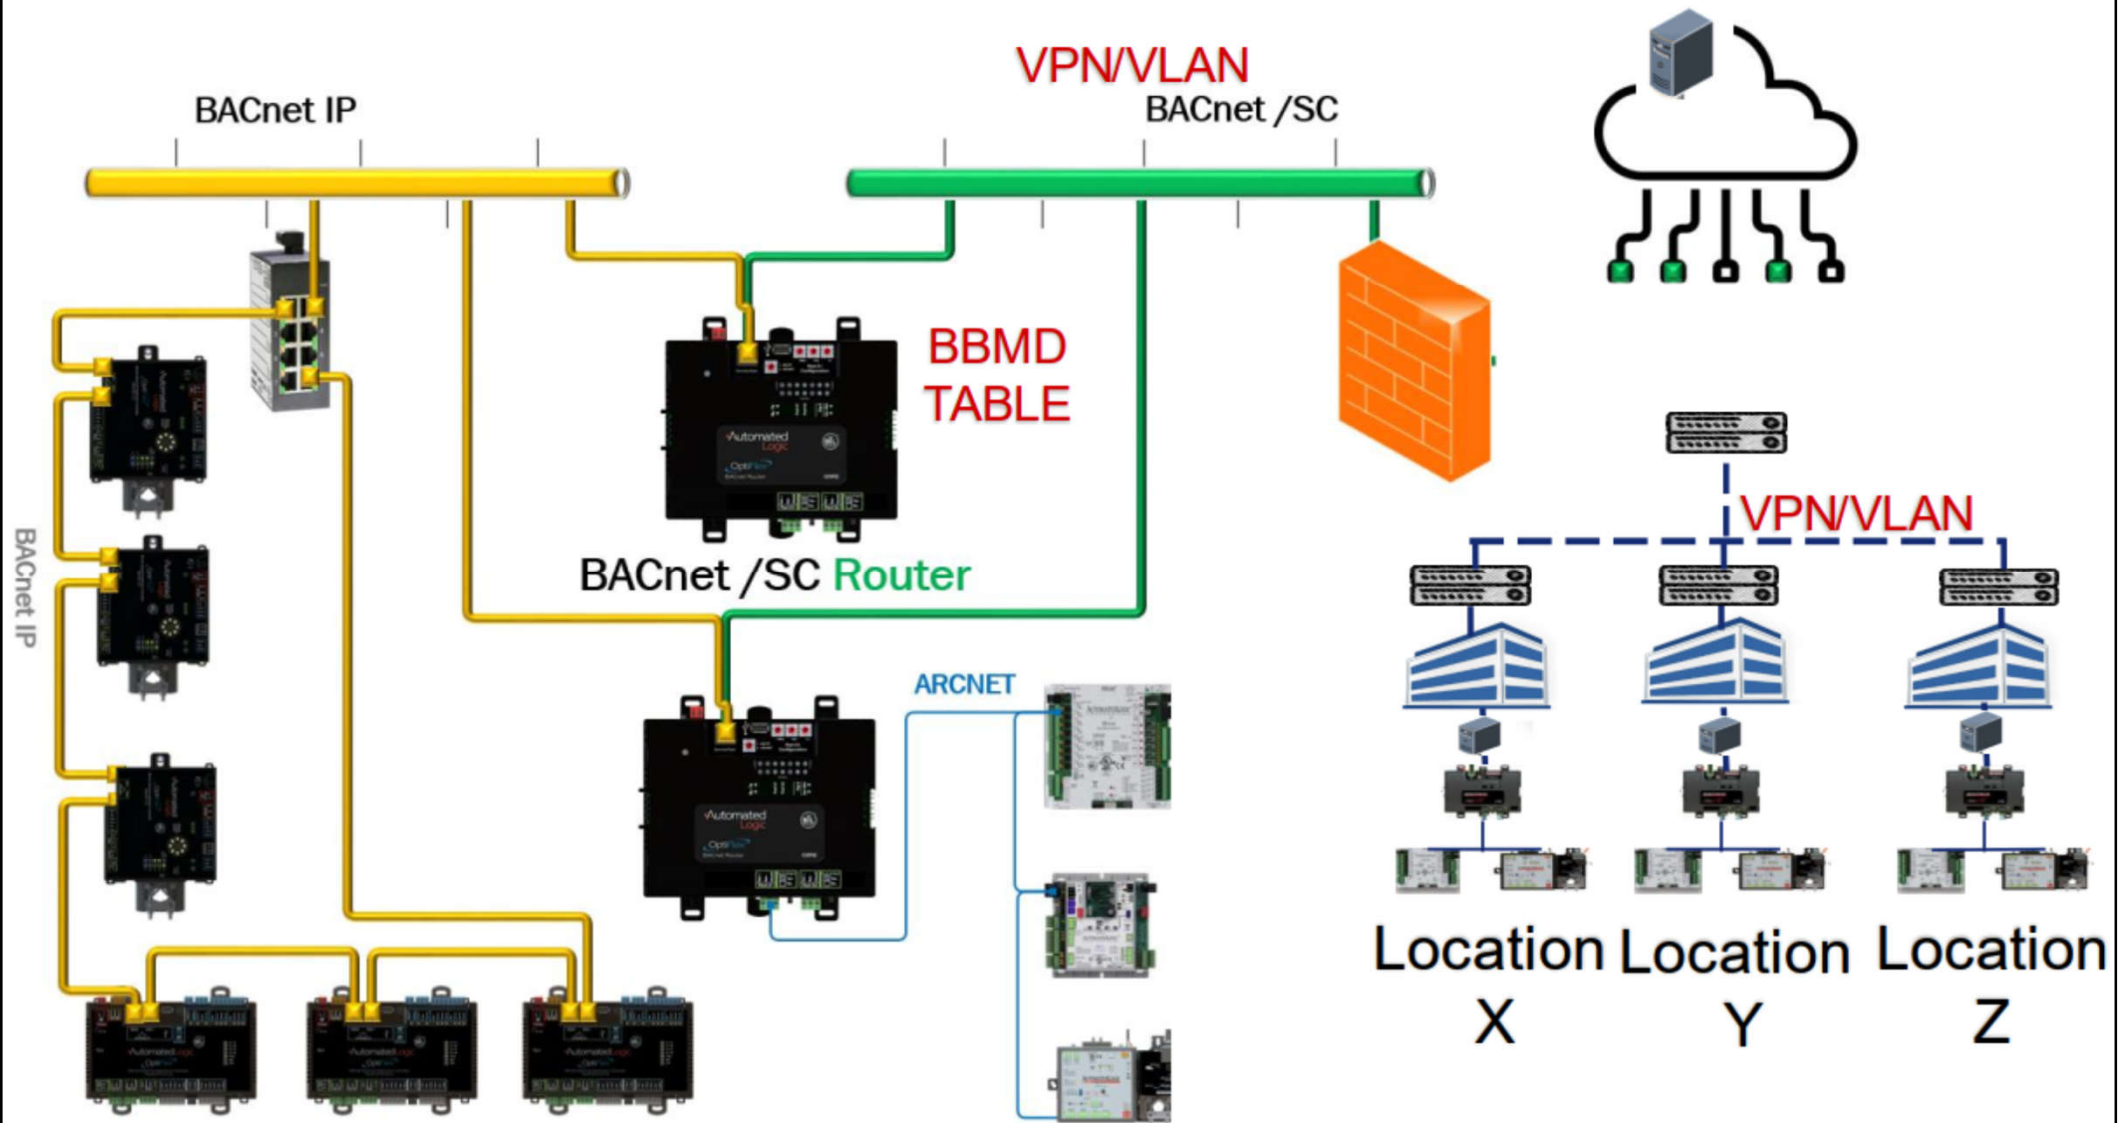

BACnet = Building Automation and Control Networks


IP = Internet Protocol

SC = Secure Connect


VLAN = virtual local area network

VPN = virtual private network


The need to integrate different sub-systems of BAS

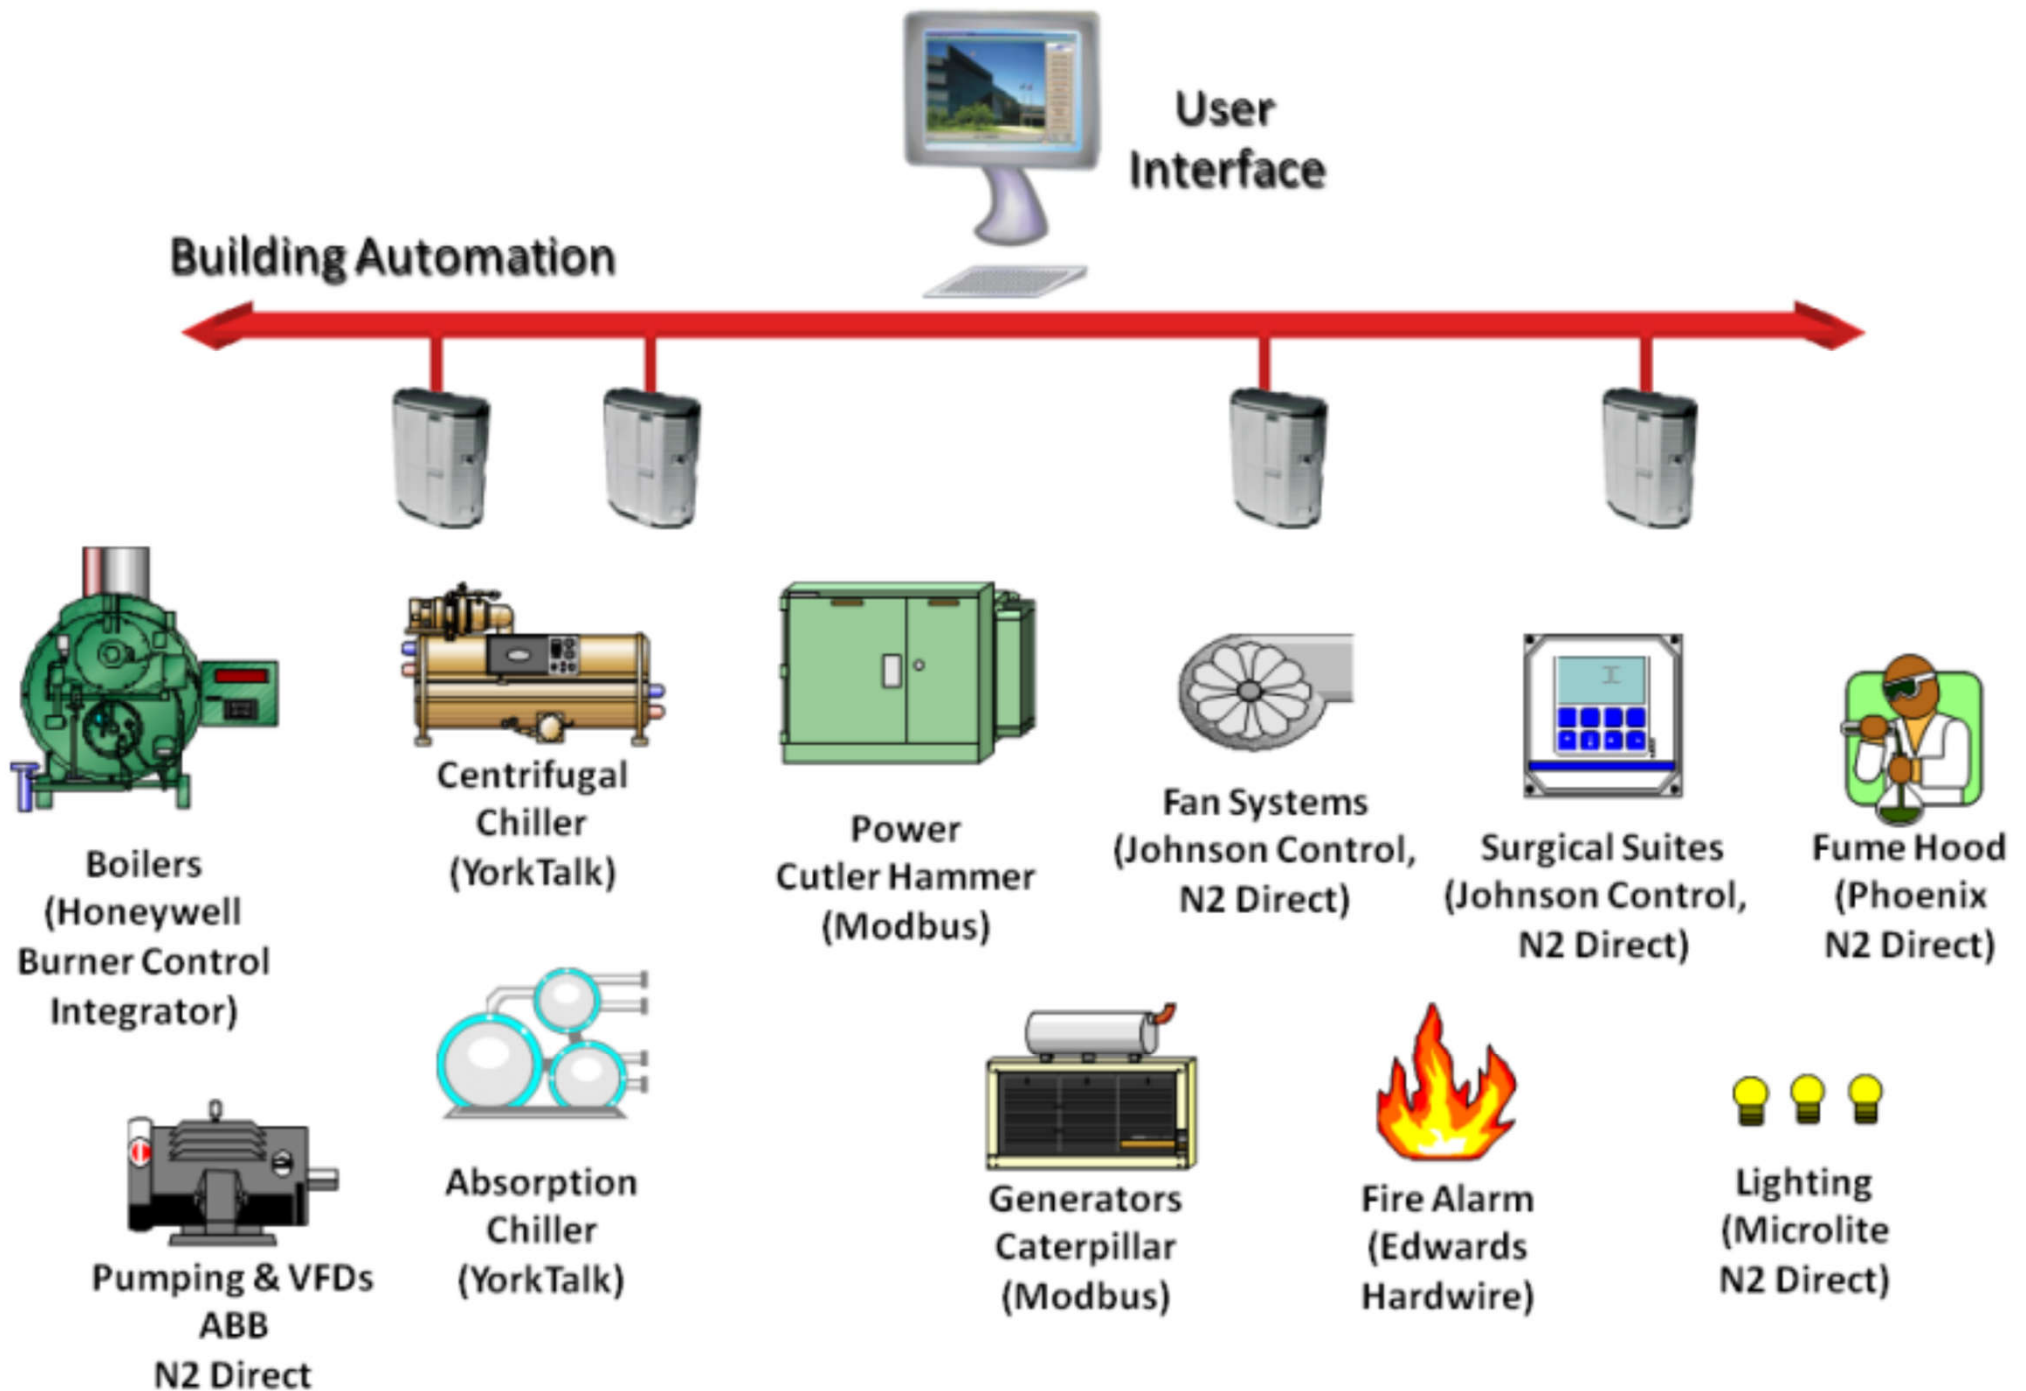


Controls and information technology (IT) integration hierarchy

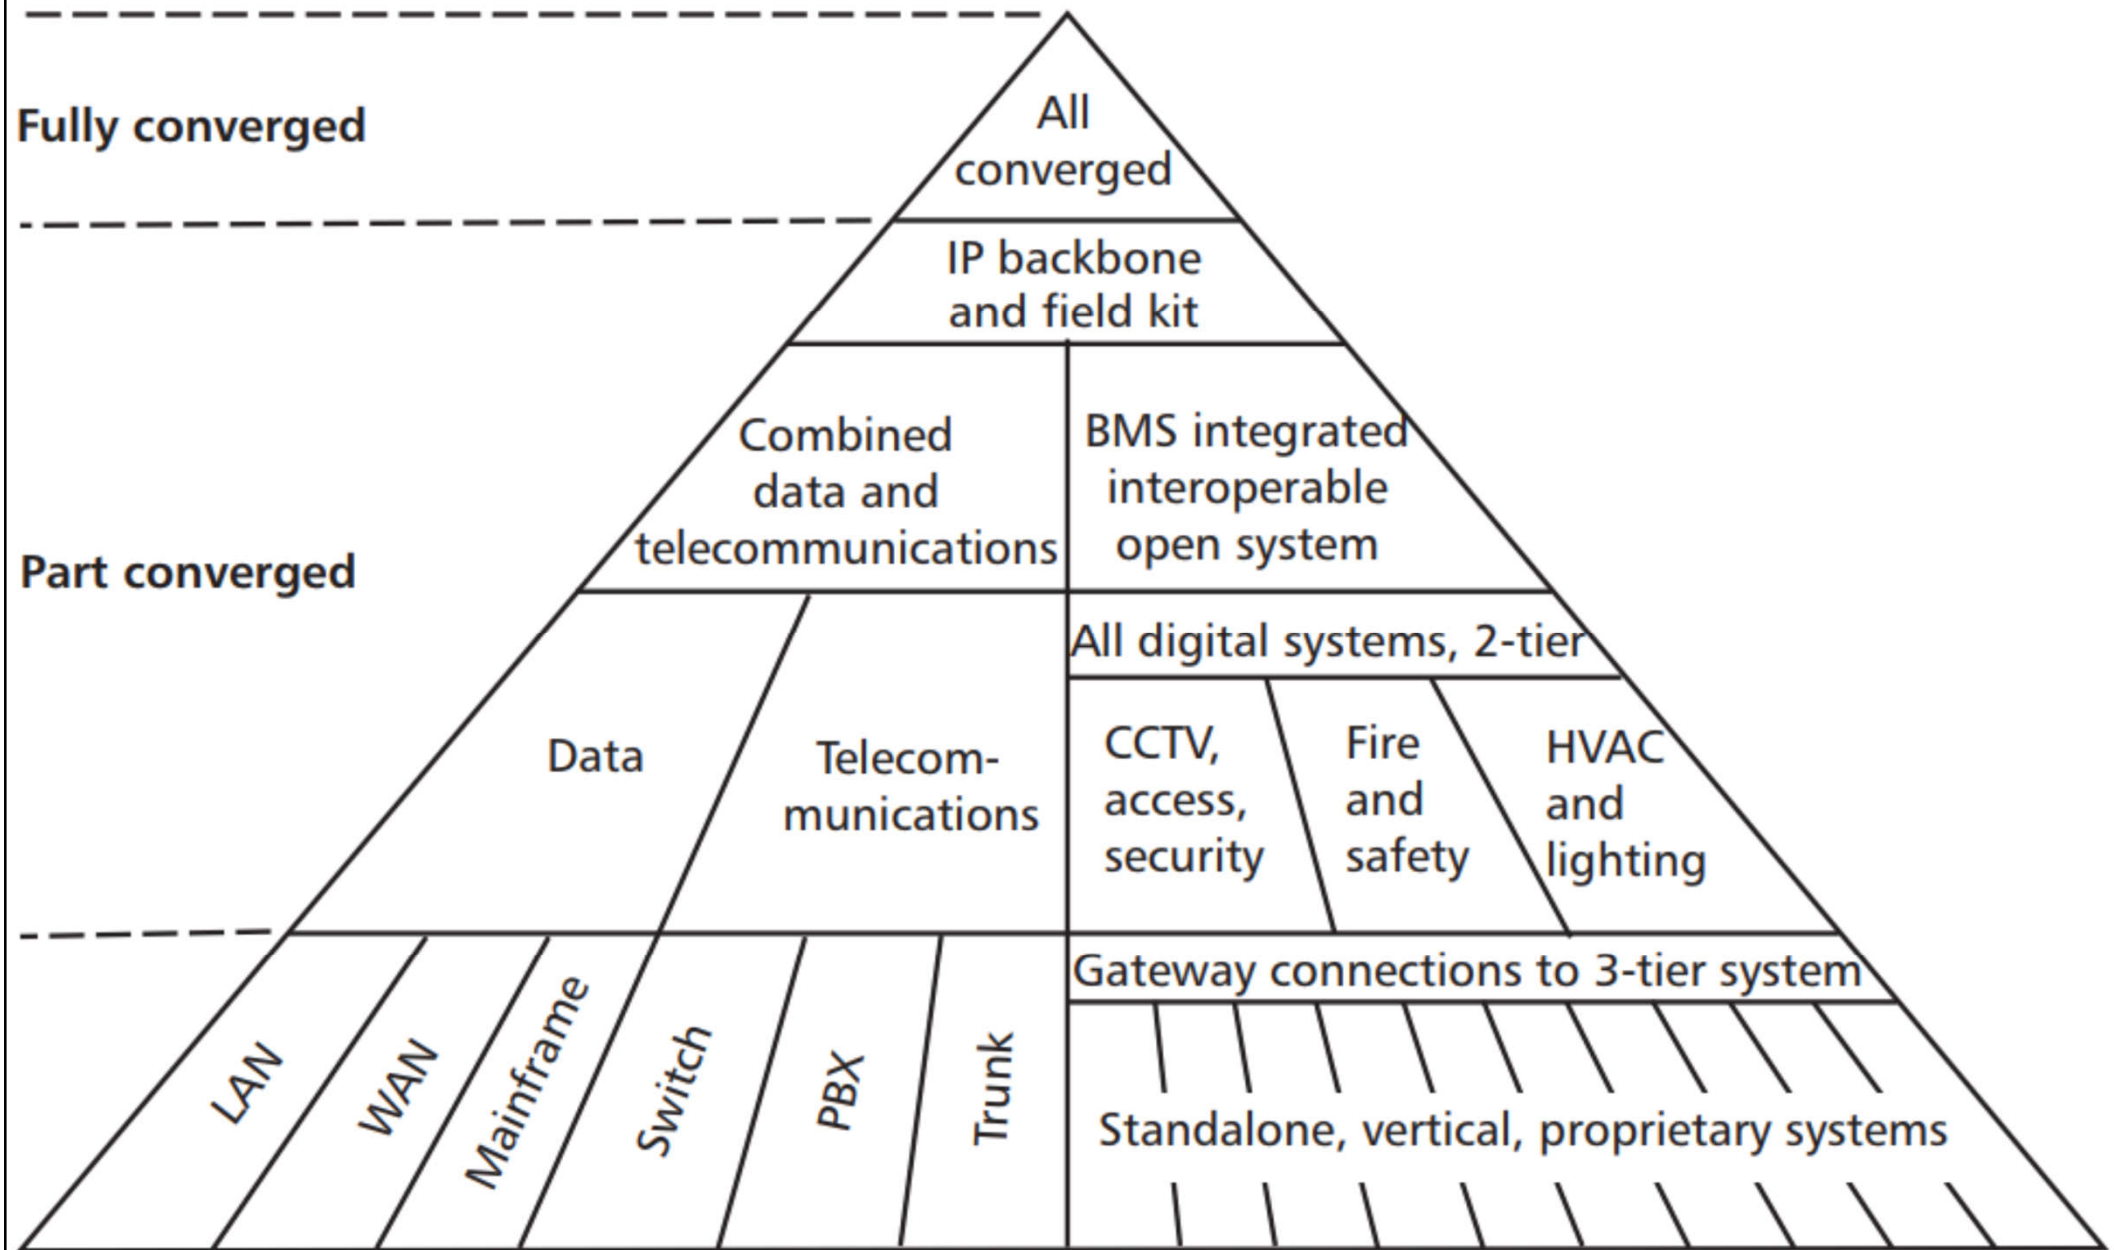

Integration of building automation and enterprise information systems

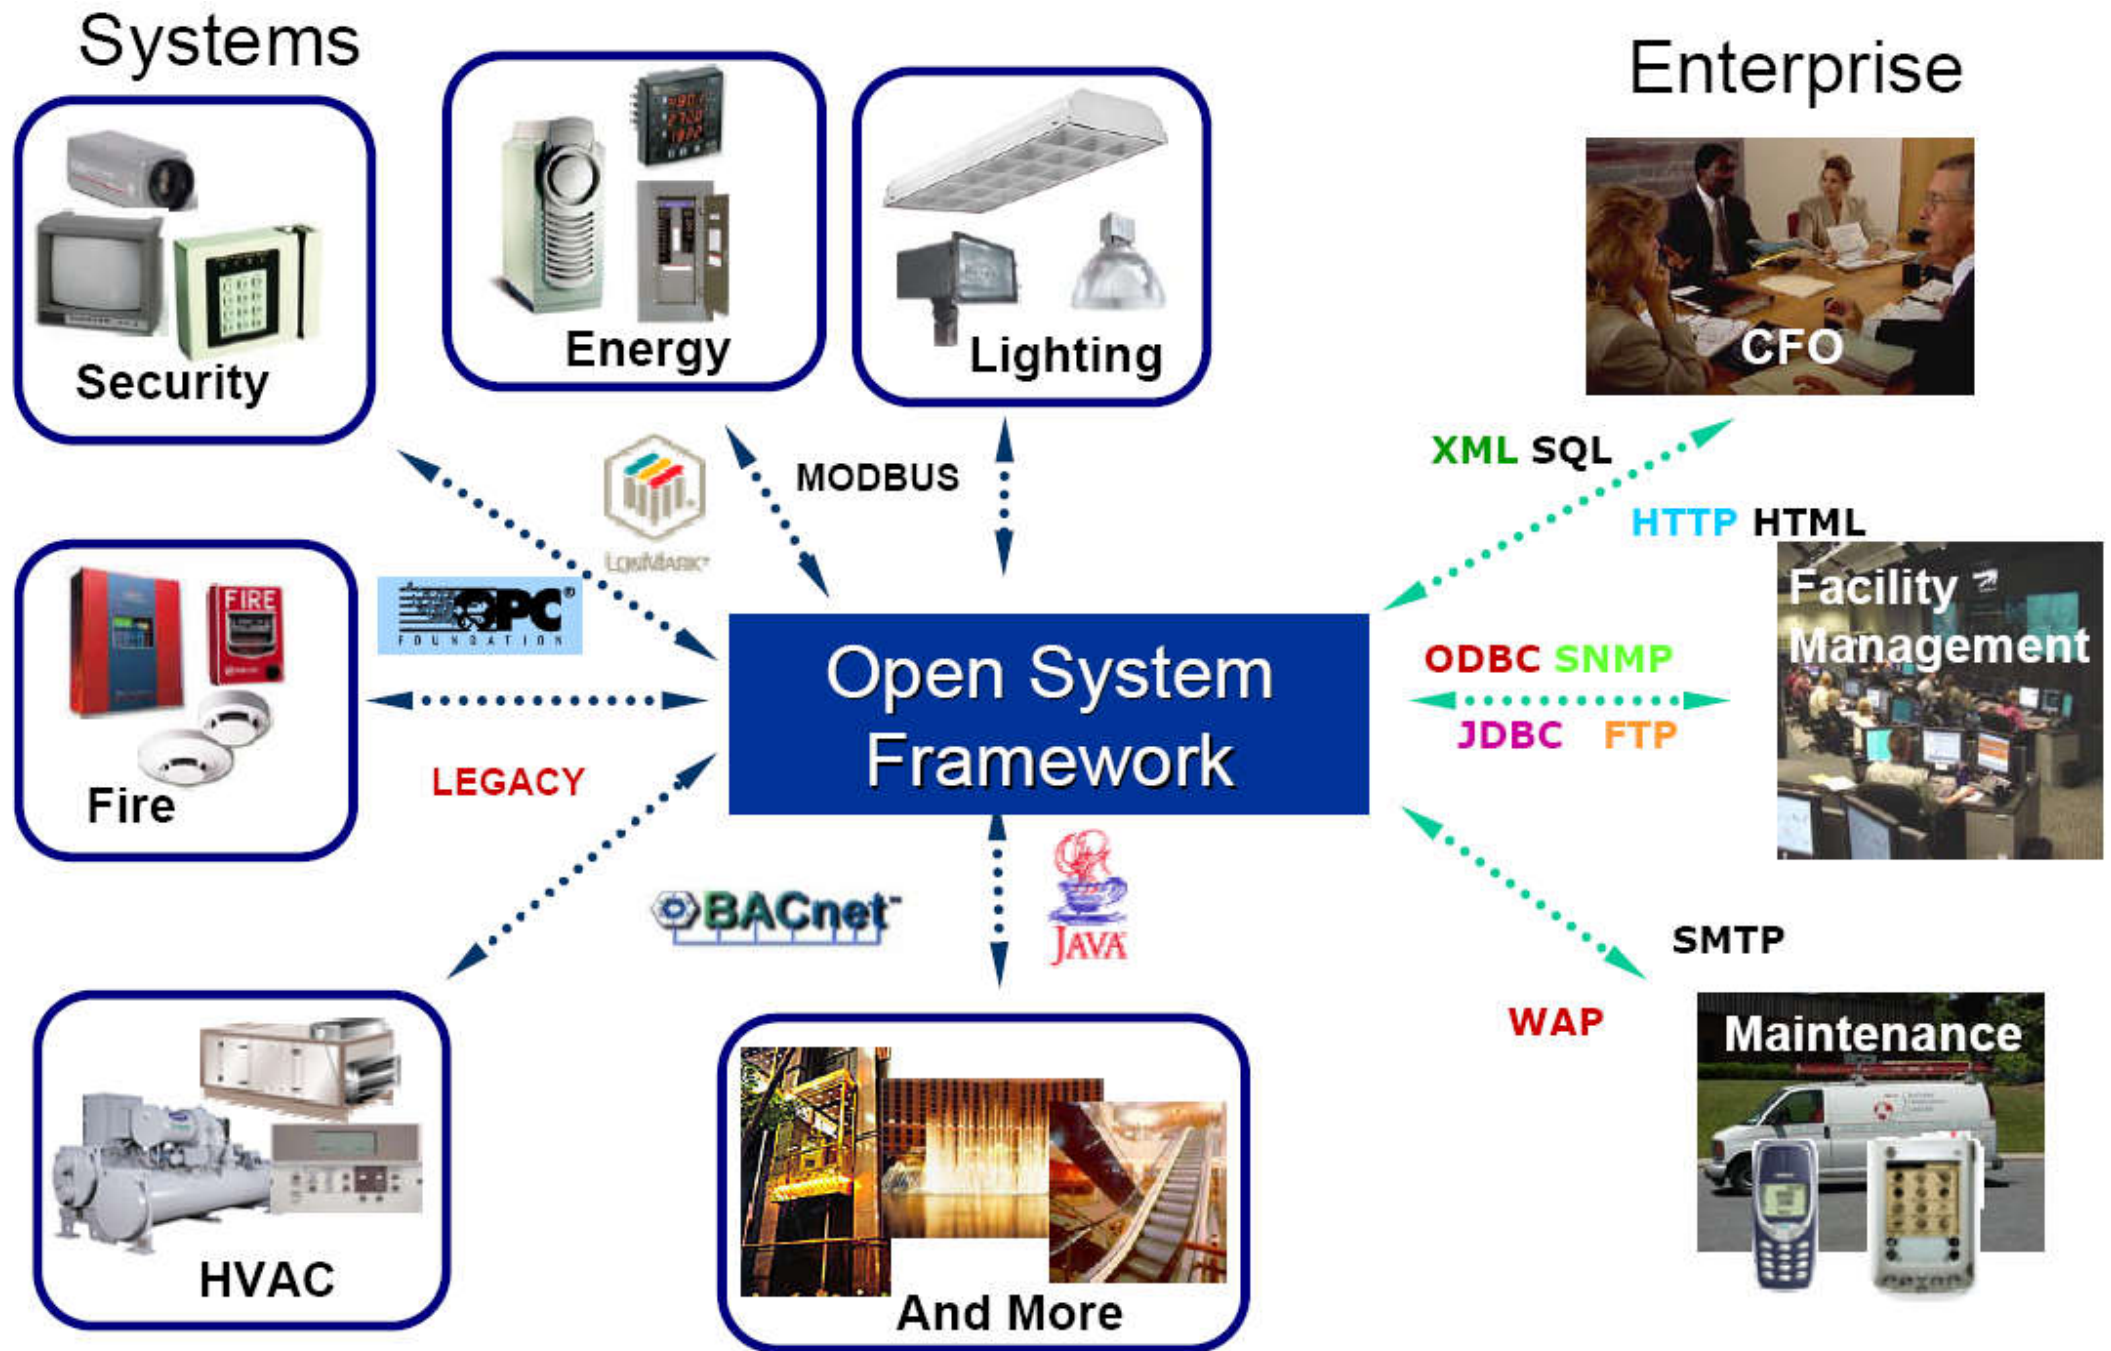


Integration between BASs and enterprise applications based on Web Services

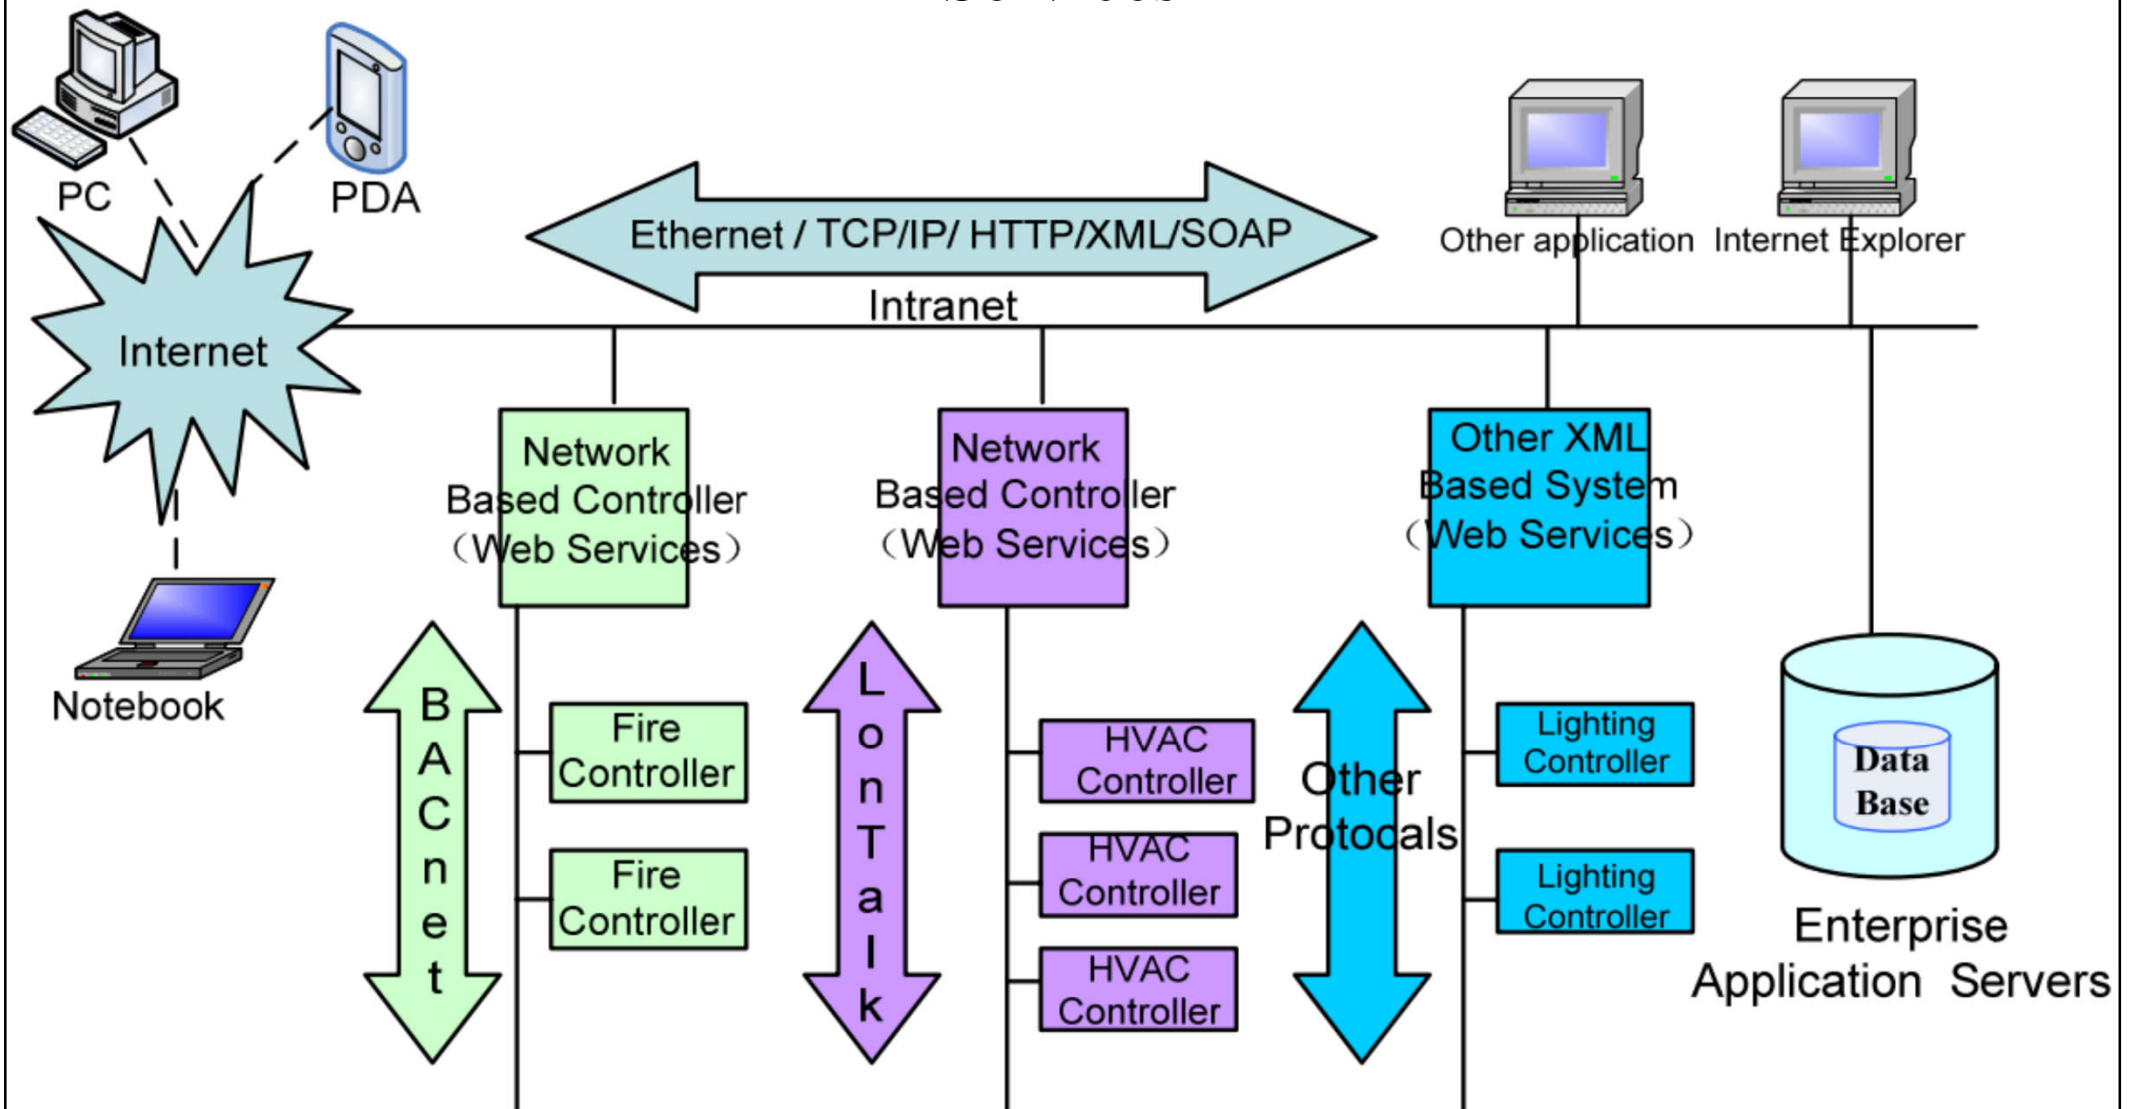

TCP = Transmission Control Protocol
IP = Internet Protocol
HTTP = HyperText Transfer Protocol


XML = Extensible Markup Language
SOAP = Simple Object Access Protocol

Wired and wireless topological hierarchy of BAS

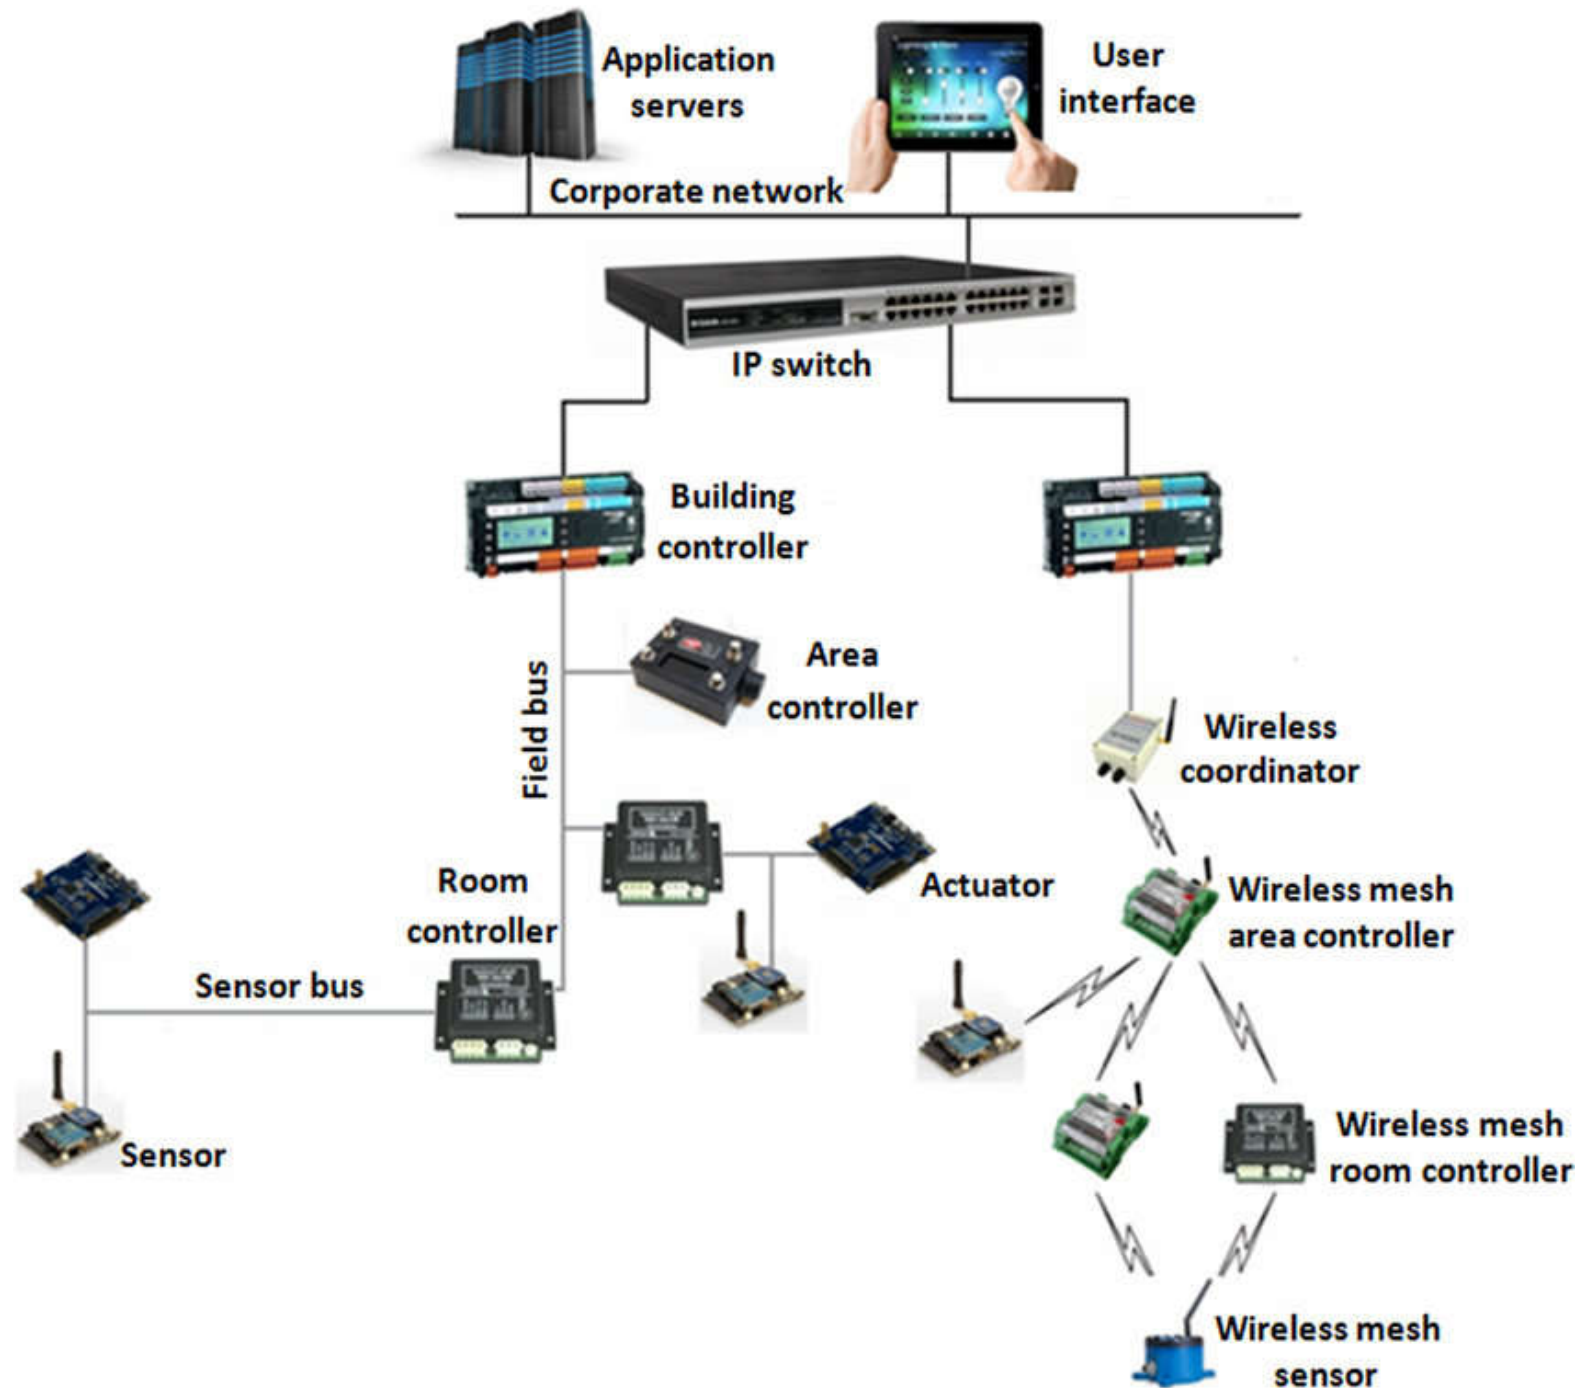


(Source: Maatoug A., Belalem G. & Mahmoudi S., 2019. Fog computing framework for location-based energy management in smart buildings, Multiagent and Grid Systems – An International Journal, 15: 39-56. <https://doi.org/10.3233/MGS-190301>)

An example of wireless network BAS architecture

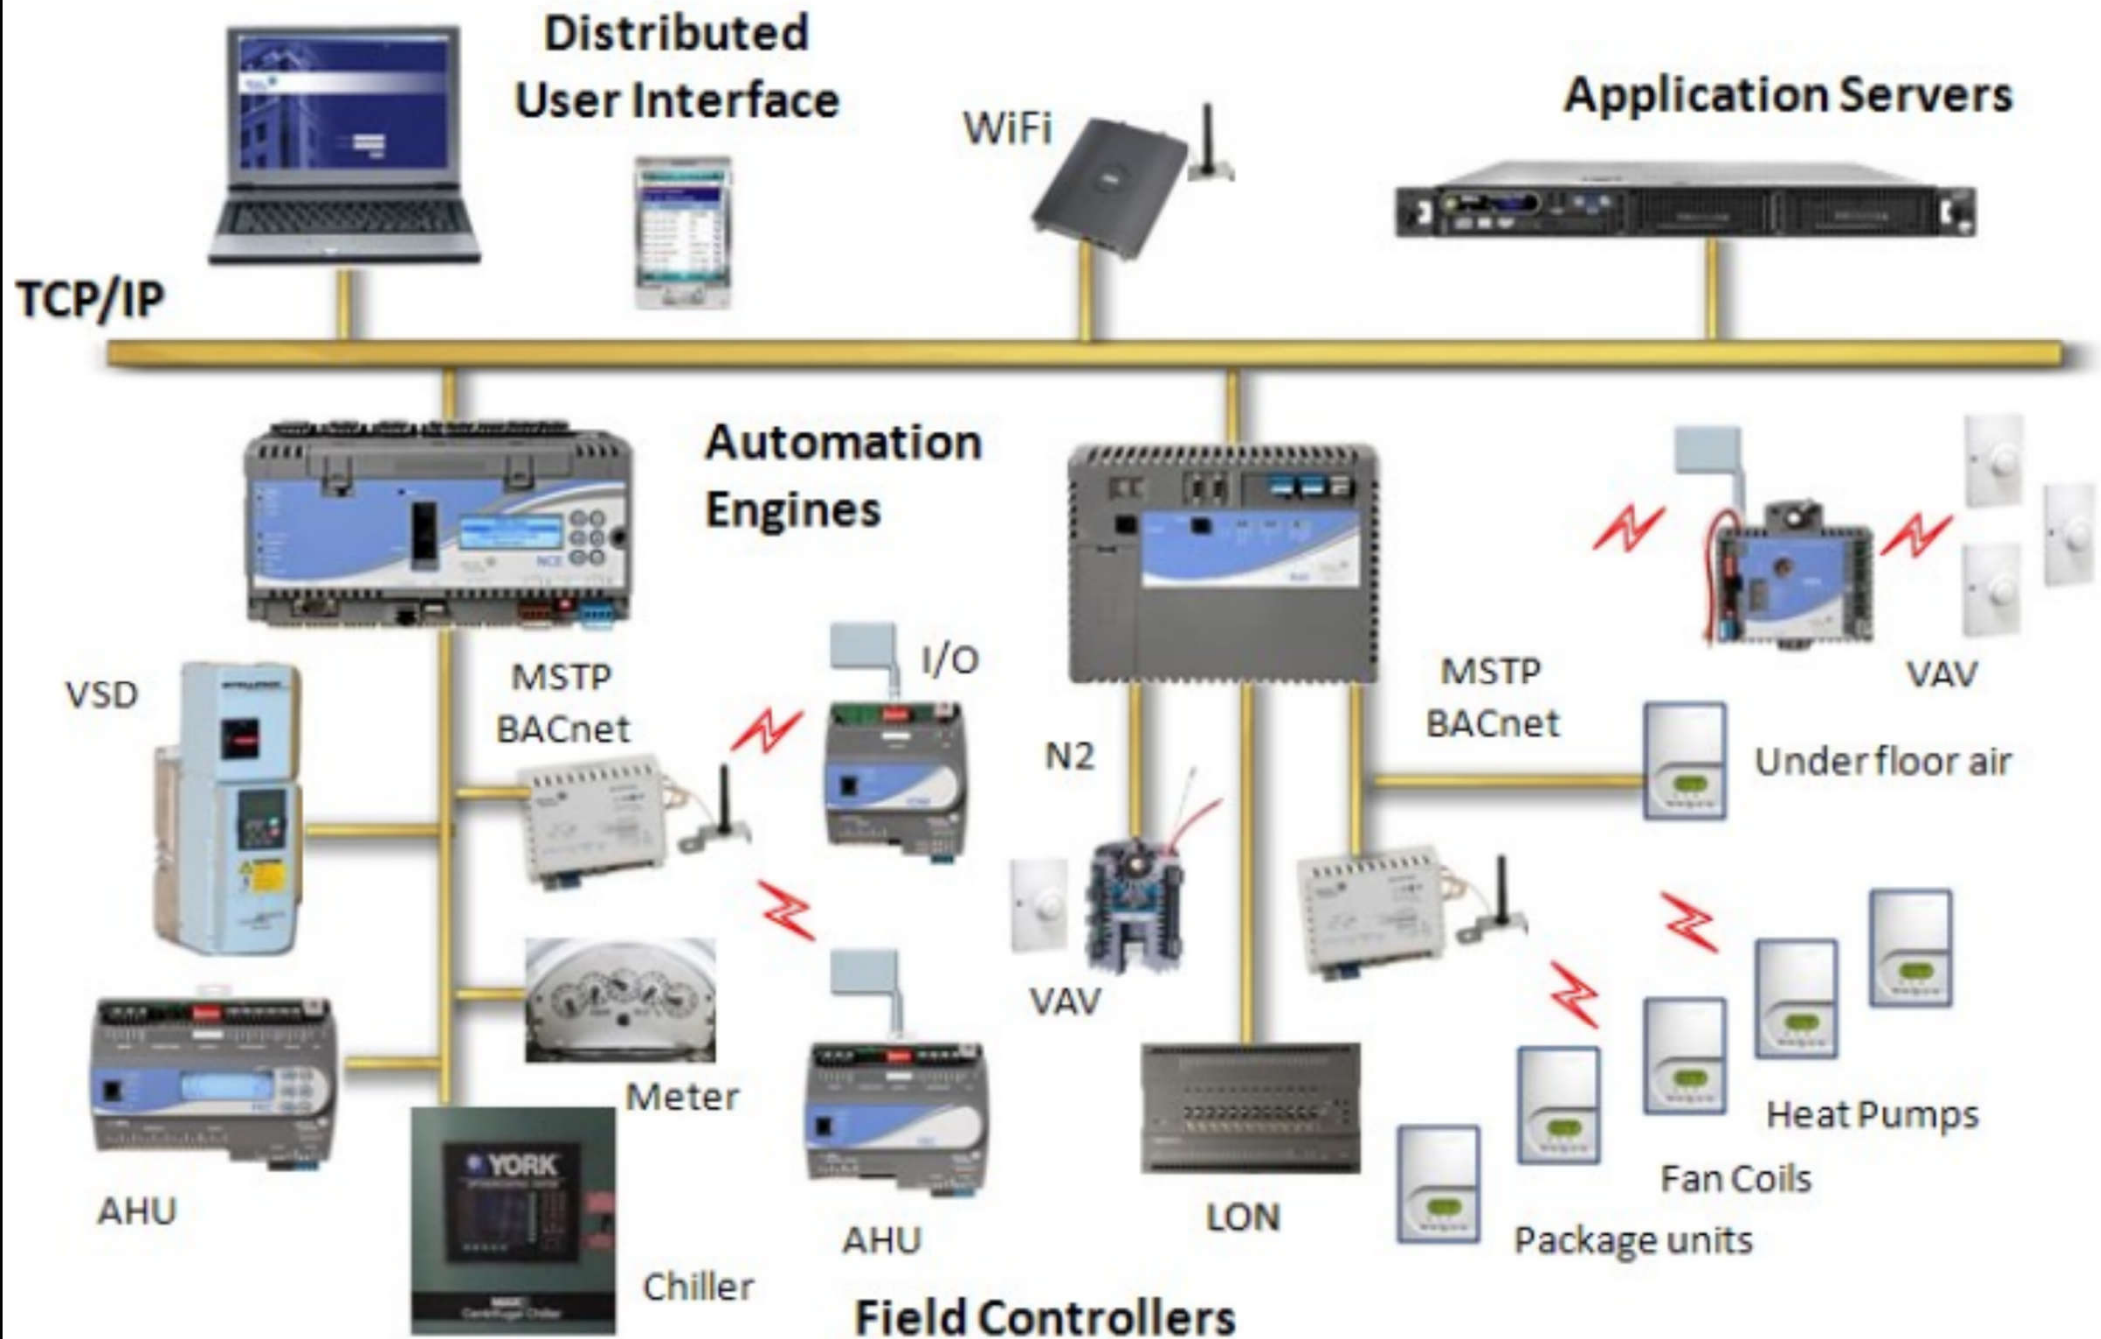

Integration of BAS wireless network and enterprise IT environment

Extended Enterprise IT Environment

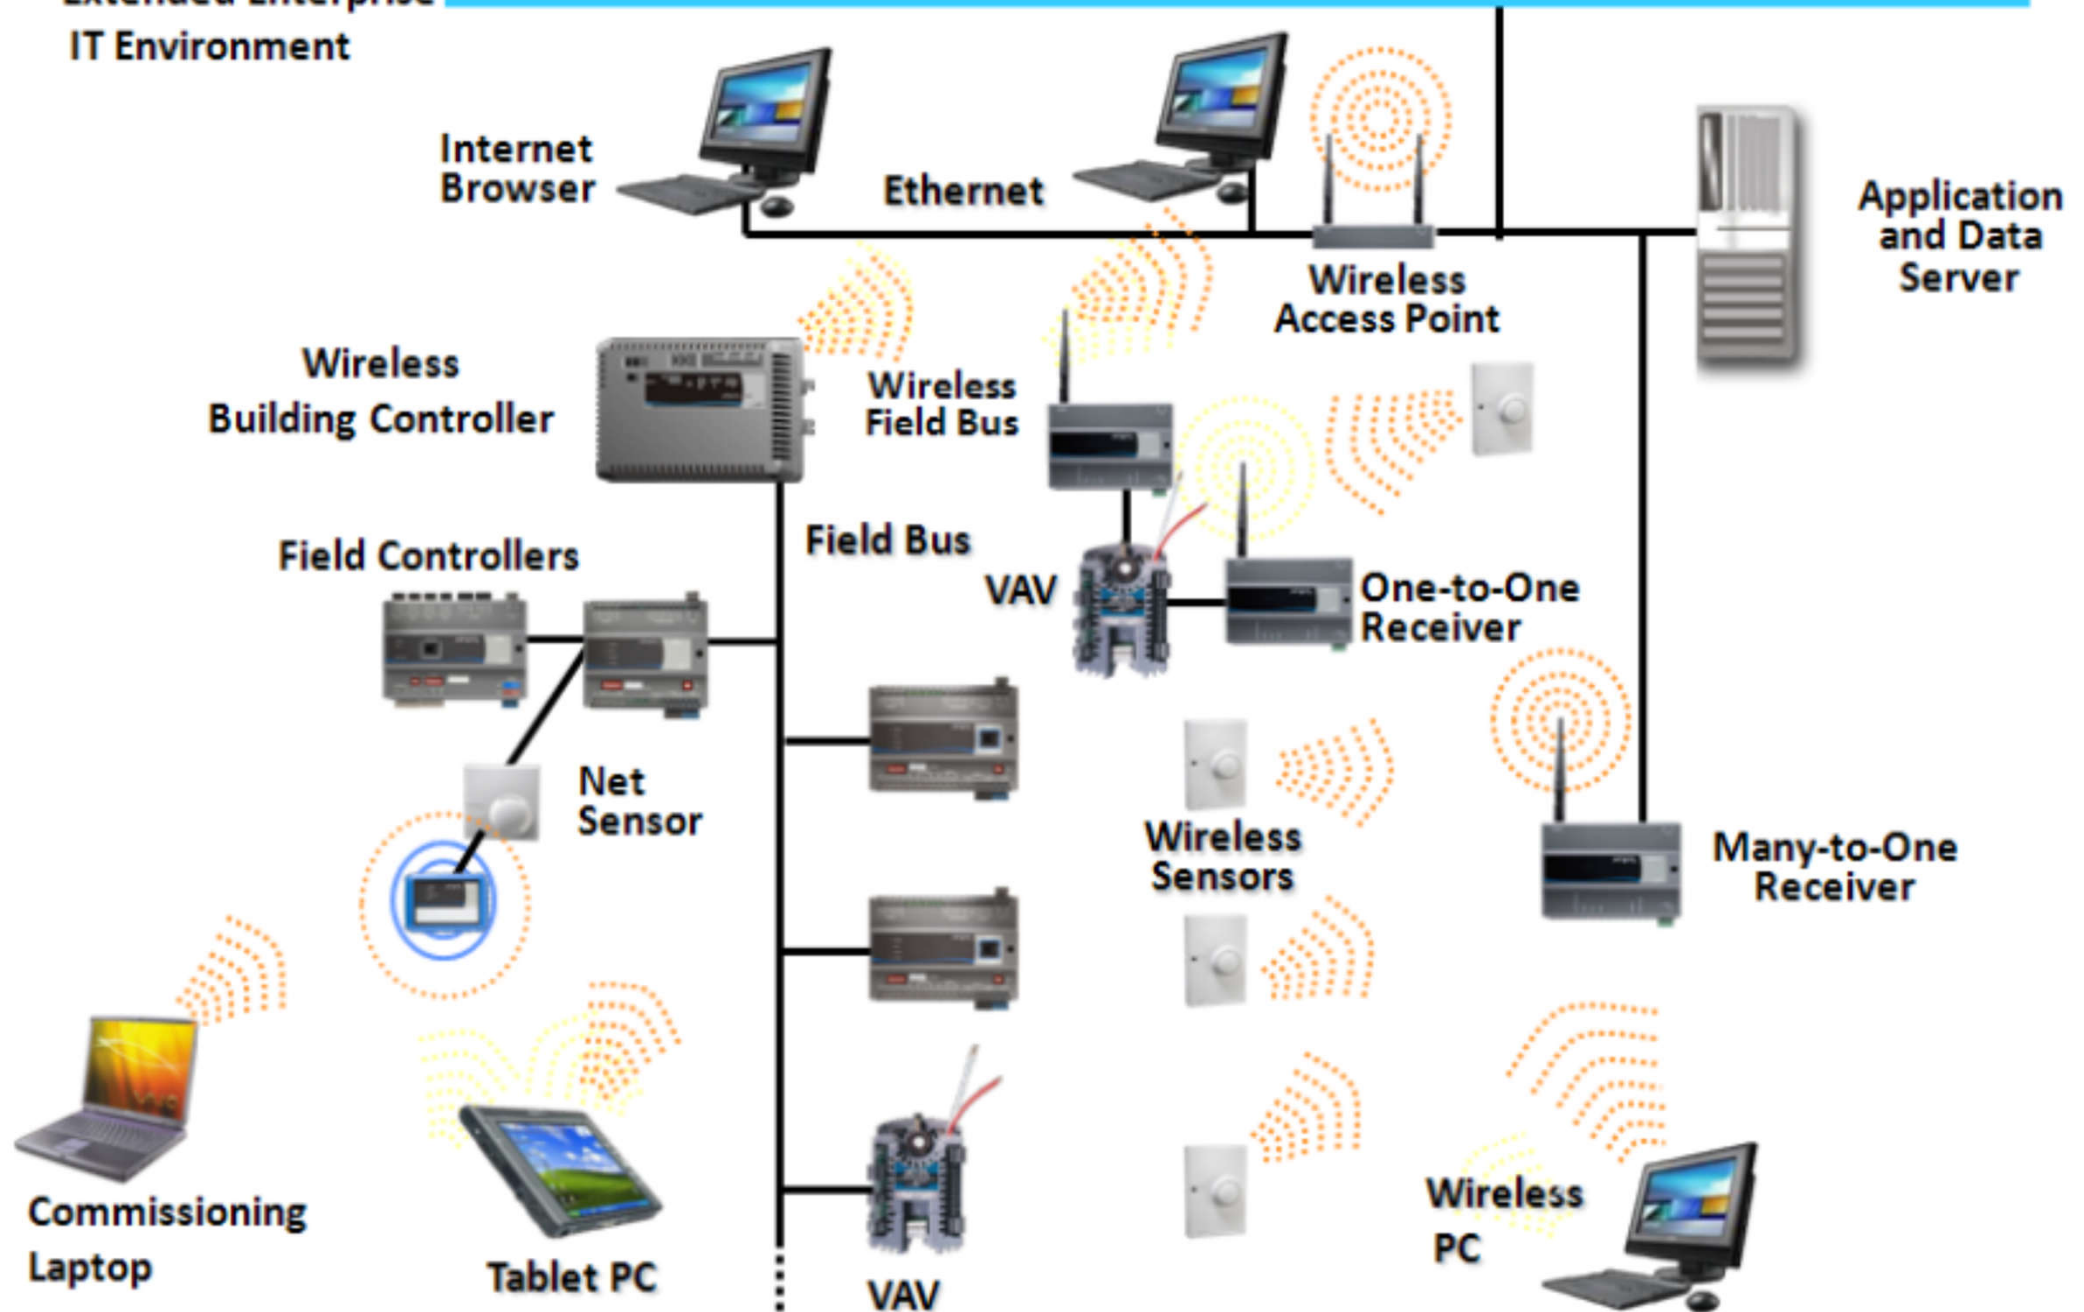


Networking



- BAS with **wireless sensor networks (WSN)**
 - Consist of small sensor nodes that sense the environment, perform computations, and communicate with other nodes using the onboard radio module
 - Sensor nodes transport the measured data to a base station using multi-hop communication
 - The size of sensor nodes is close to a matchbox
 - Wiring is avoided and both installation & operational costs significantly reduced



Basic concept of wireless sensor network (WSN)

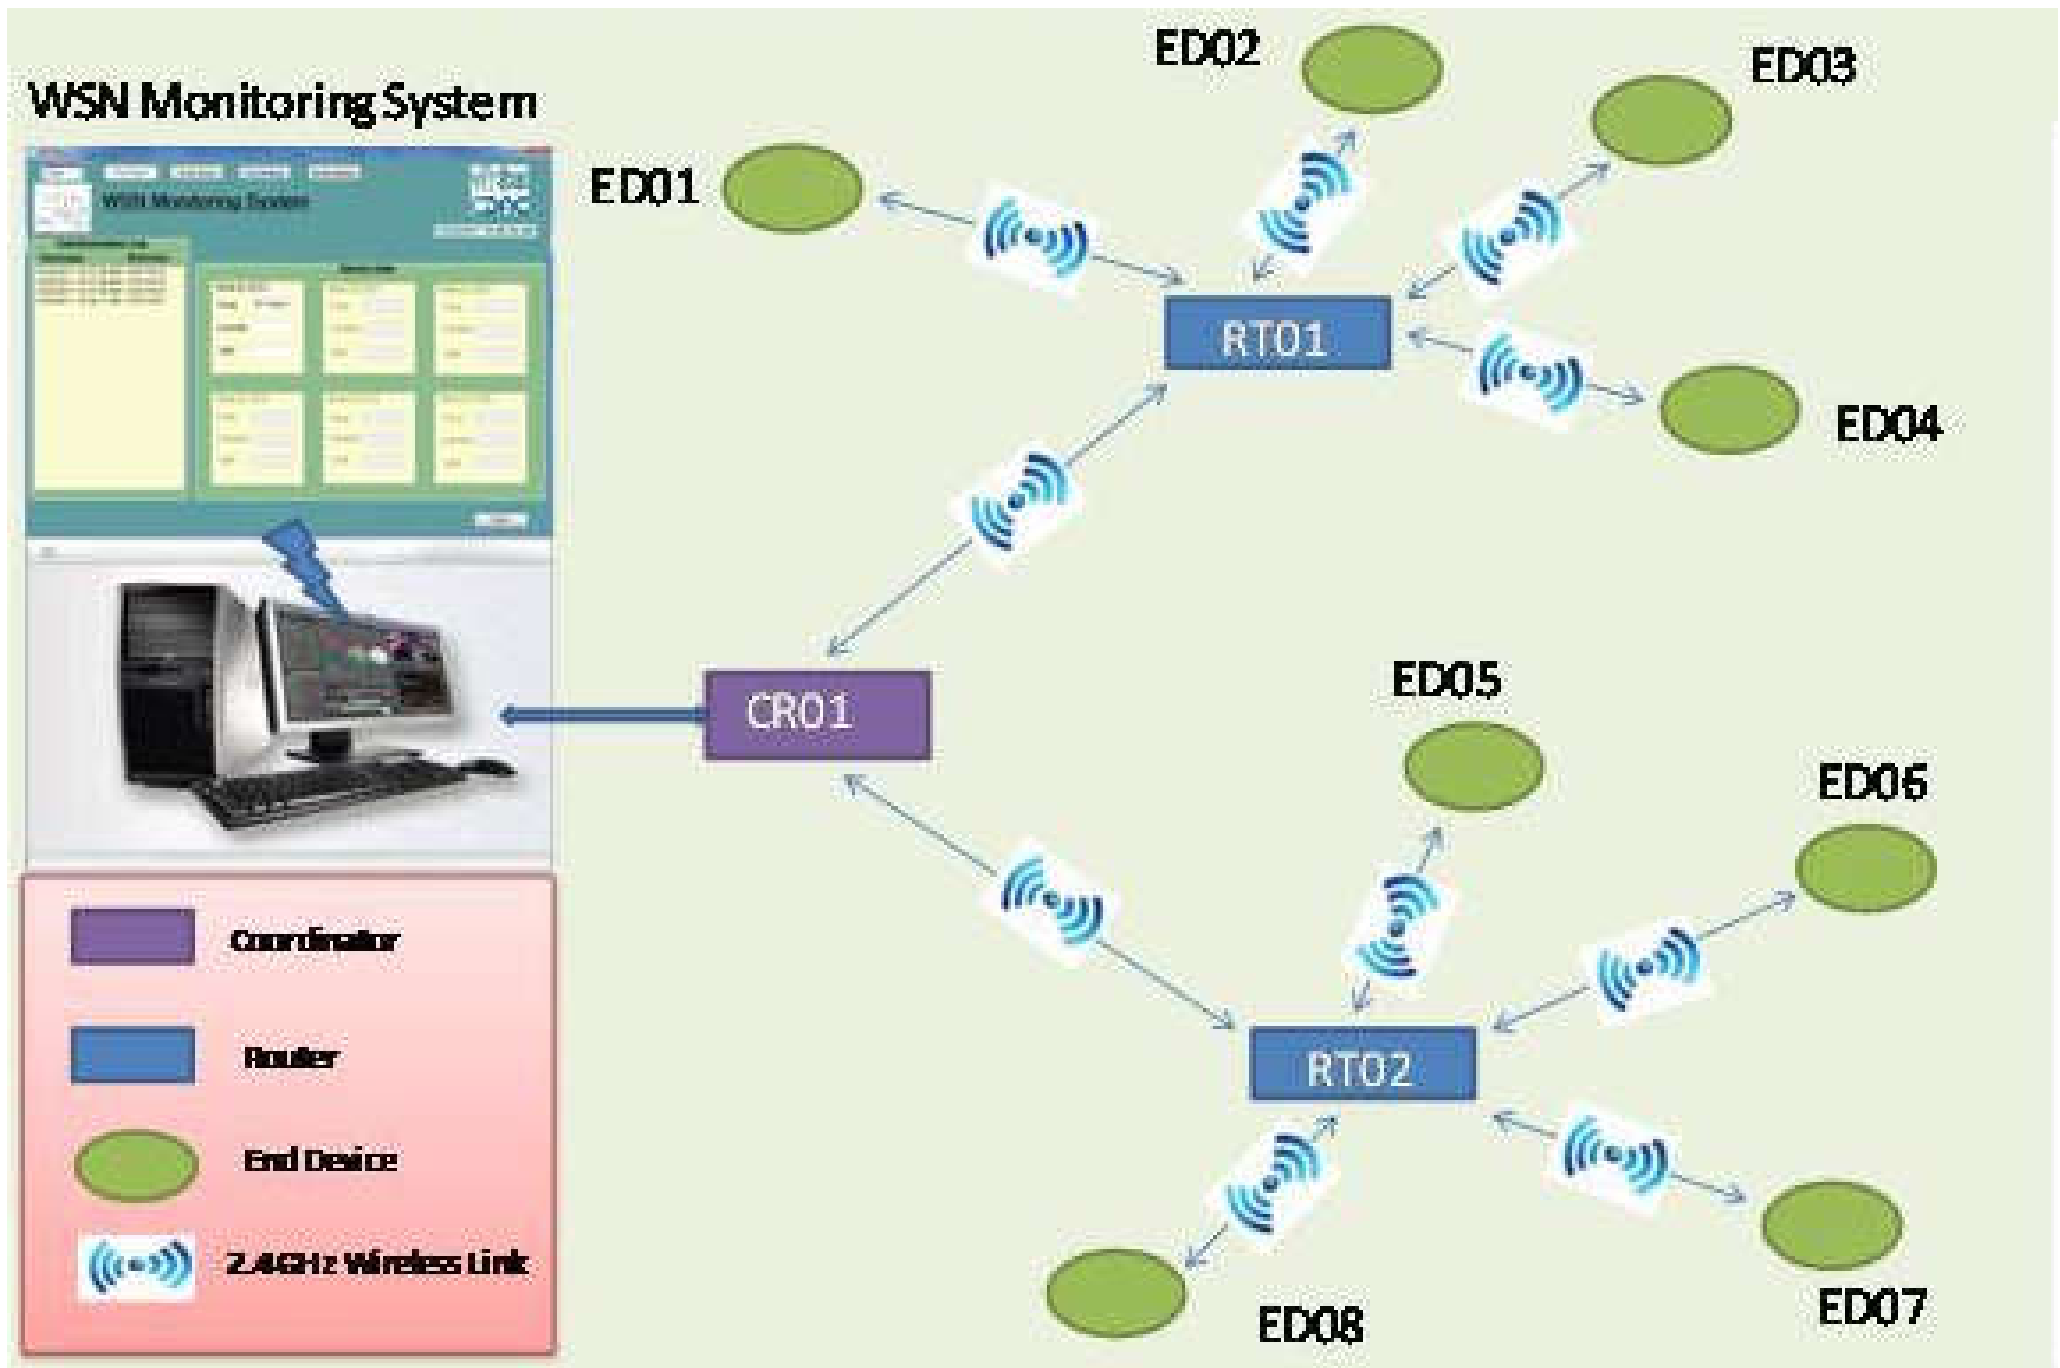

Networking



- Advantages of wireless networks for BAS
 - Lower installation & maintenance costs
 - Greater flexibility & scalability (no wiring is needed)
 - Easier integration with existing infrastructure
 - Support the deployment of more sensors & actuators, which can provide more granular and accurate data for BAS optimization & automation
 - Enable BAS to communicate and collaborate with other wireless devices (e.g. smartphones, tablets, wearables) to provide personalized and interactive services for building occupants



Further reading

- All about Building Automation System (BAS)
<https://www.adftech.com.my/wp-content/uploads/2019/08/E-Book-1.-All-About-Building-Automation-System.pdf>
- Building automation - Wikipedia
https://en.wikipedia.org/wiki/Building_automation
- Domingues P., Carreira P., Vieira R. & Kastner W., 2016. Building automation systems: Concepts and technology review, *Computer Standards and Interfaces*, 45: 1-12.
<http://dx.doi.org/10.1016/j.csi.2015.11.005>
- Ultimate Guide to Smart Building Automation
<https://www.workero.com/smart-building-automation-guide/>