


MEBS6000 Utility Services
<http://me.hku.hk/bse/MEBS6000/>




Steam Systems

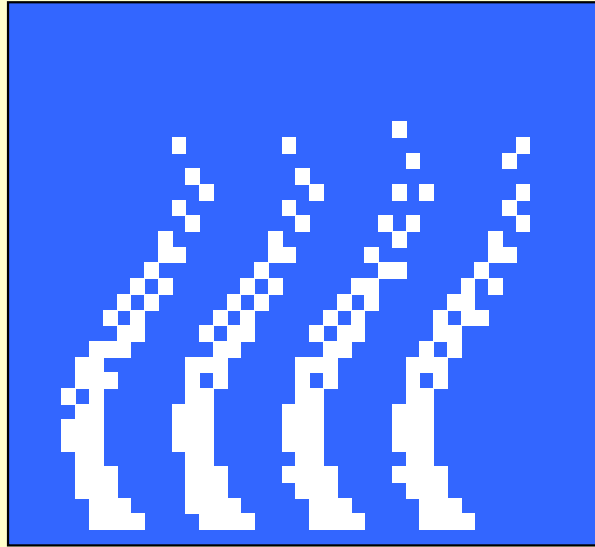

Dr. Sam C. M. Hui
Department of Mechanical Engineering
The University of Hong Kong
E-mail: cmhui@hku.hk

Jan 2016

Contents



- Properties of Steam
- Uses of Steam
- Steam System
- Steam Traps and Components
- Boilers
- Design Considerations
- Condensate Recovery




Properties of Steam



- Basic principles

- Steam: water heated to vaporisation
- At atmospheric pressure, temperature = 100 °C

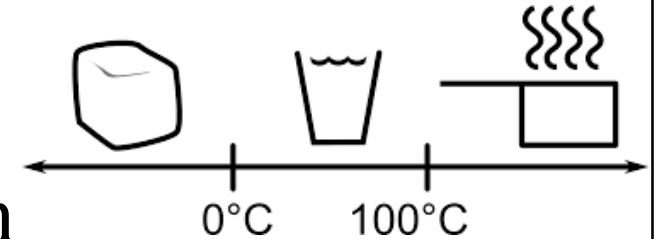


- Three types of heat in **steam** calculation:

- Specific heat (capacity) of water (c_{pw}) = 4.2 kJ/kg.K
- Specific enthalpy of evaporation (h_{fg})
- Specific enthalpy of steam (h_g)

Properties of Steam




- Heat transfer
 - Latent heat of evaporation = 2257 kJ/kg at atm pressure (condensable energy content)
 - Sensible heat of water = 419 kJ/kg (0 to 100 °C)
- Flow at high velocity (24-36 m/s) and high temperature (100-198 °C)

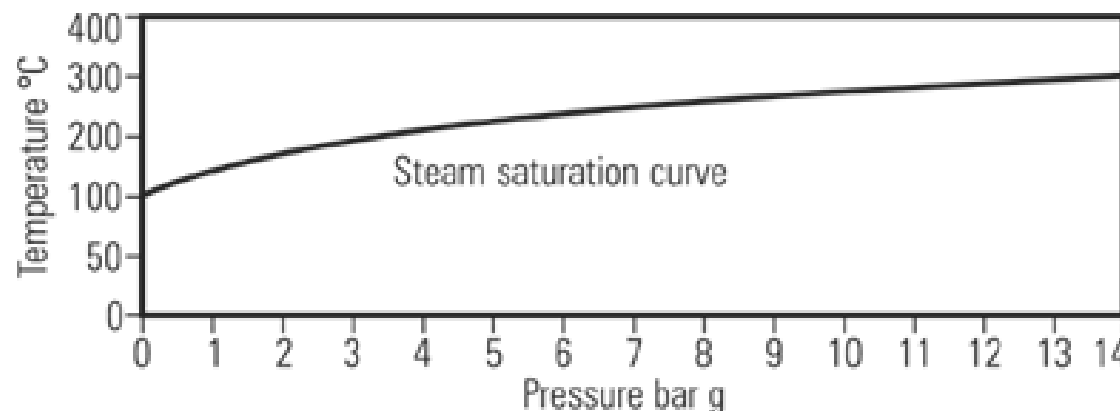

Properties of Steam



- Assume you understand the basics well
 - Such as pressure, specific volume, density, temperature, internal energy, enthalpy, entropy and specific heat
 - Review relevant text books if you have problems!!
- Key fundamental concepts
 - Steam tables
 - Dry steam and wet steam
 - Superheated steam

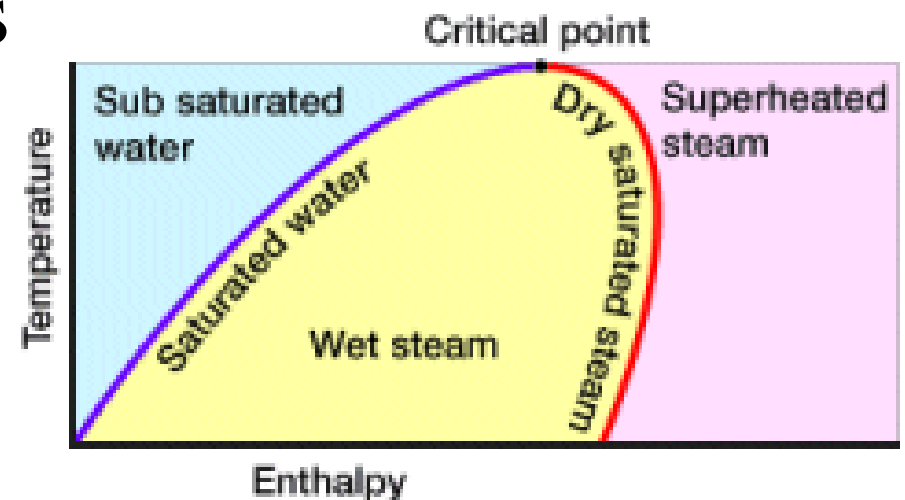

Properties of Steam



- Steam tables

- To determine various steam properties
 - Pressure (absolute or gauge) [1 bar = 100 kPa = 14.5 psi]
 - Temperature [°C or K]
 - Specific enthalpy [kJ/kg]
 - Specific volume (inverse of density) [m³/kg]
 - Specific heat capacity [kJ/kg.K]
- Published tables in databooks, such as CIBSE Guide C, Section 4, or IOP Guide
- Total enthalpy, $h_g = h_f$ (sensible) + h_{fg} (latent)

Do you know how to use these steam tables?


Extract from the saturated steam tables

Pressure bar g	Saturation temperature °C	Enthalpy kJ/kg			Volume of dry saturated steam m ³ /kg
		Water h _f	Evaporation h _{fg}	Steam h _g	
0	100	419	2 257	2 676	1.673
1	120	506	2 201	2 707	0.881
2	134	562	2 163	2 725	0.603
3	144	605	2 133	2 738	0.461
4	152	641	2 108	2 749	0.374
5	159	671	2 086	2 757	0.315
6	165	697	2 066	2 763	0.272
7	170	721	2 048	2 769	0.240

Extract from superheated steam tables

Absolute pressure bar a	Units	Temperature (°C)					
		150	200	250	300	400	500
1.013	v _g (m ³ /kg)	1.912	2.145	2.375	2.604	3.062	3.519
	u _g (kJ/kg)	2 583	2 659	2 734	2 811	2 968	3 131
	h _g (kJ/kg)	2 777	2 876	2 975	3 075	3 278	3 488
	s _g (kJ/kg)	7.608	7.828	8.027	8.209	8.537	8.828


The enthalpy/pressure diagram

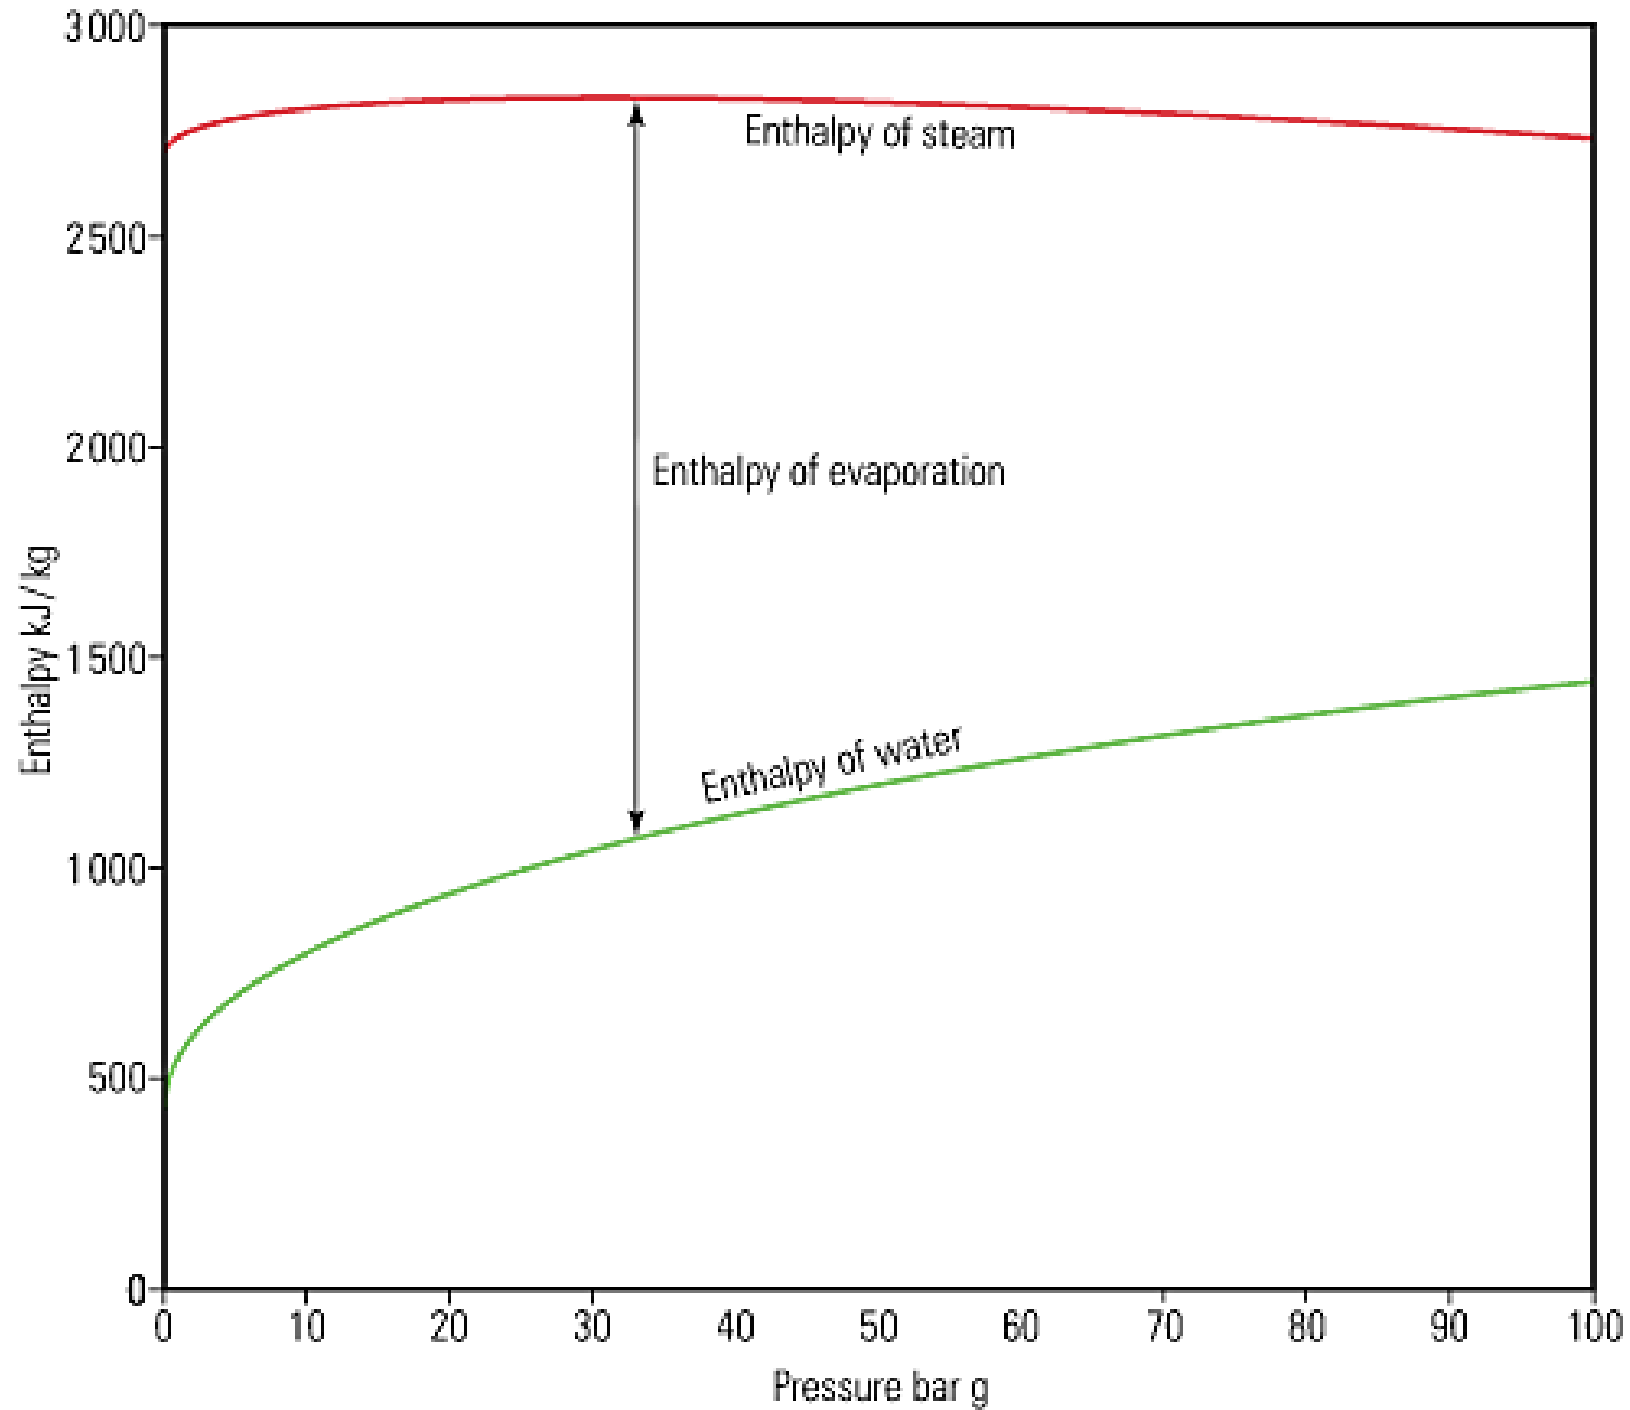

Properties of Steam



- Types of steam:
 - Saturated steam (dry)
 - Unsaturated steam (wet)
 - Superheated steam
 - Supercritical water
- Pressure-temperature relationship of water & steam

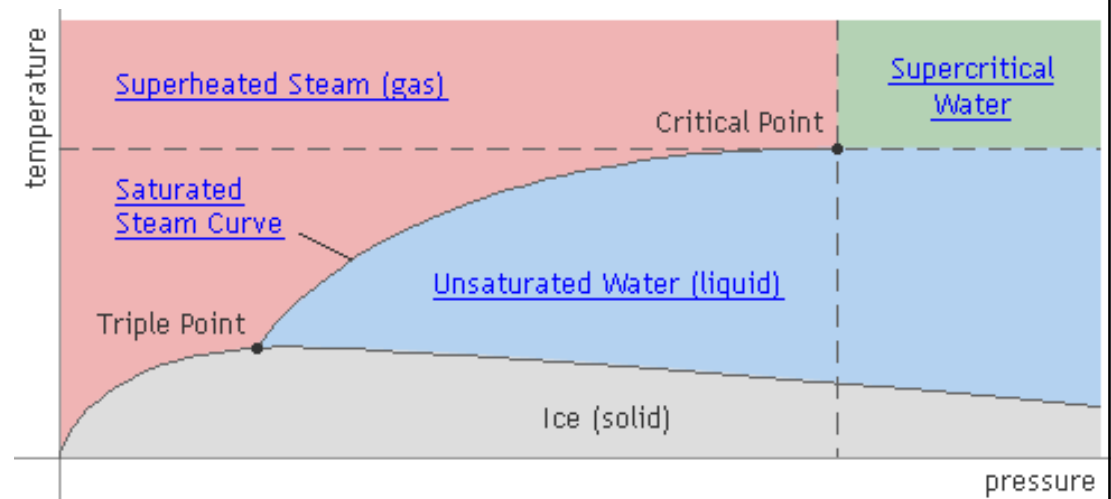


Triple Point : 0°C, 0.61 KPa abs (32°F, 0.09 psia)
Critical Point : 374°C, 22.1 MPa abs (705°F, 3208 psia)

Properties of Steam





- Dryness of steam

- Steam often carries tiny droplets of water
- *Dryness fraction* (χ) = proportion of completely dry steam present in the steam-moisture mixture
- Wet steam has a heat content much lower than that of dry saturated steam at the same pressure
 - Actual enthalpy of evaporation = $h_{fg} \cdot (\chi)$
 - Actual total enthalpy = $h_f + h_{fg} \cdot (\chi)$

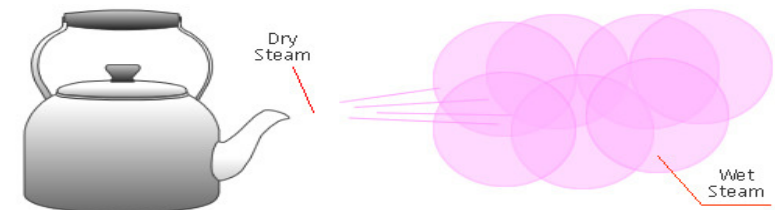


The relationship between steam dryness and enthalpy

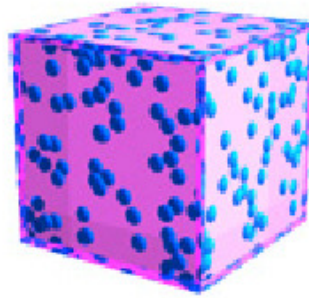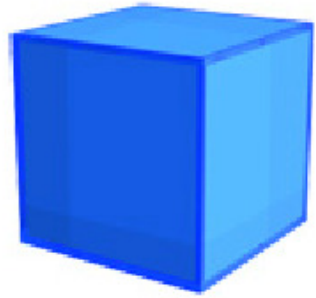

Saturated Water (0% Dryness)
 Temperature: 100 °C [212 °F]
 Total Heat: $h_f + 0\% \cdot h_{fg}$
 = 419 kJ/kg [180 BTU/lb]

Wet Steam (x% Dryness)
 Temperature: 100 °C [212 °F]
 Total Heat: $h_f + x\% \cdot h_{fg}$
 < 2676 kJ/kg [1150 BTU/lb]

Saturated Steam (100% Dryness)
 Temperature: 100 °C [212 °F]
 Total Heat: $h_f + 100\% \cdot h_{fg}$
 = 2676 kJ/kg [1150 BTU/lb]

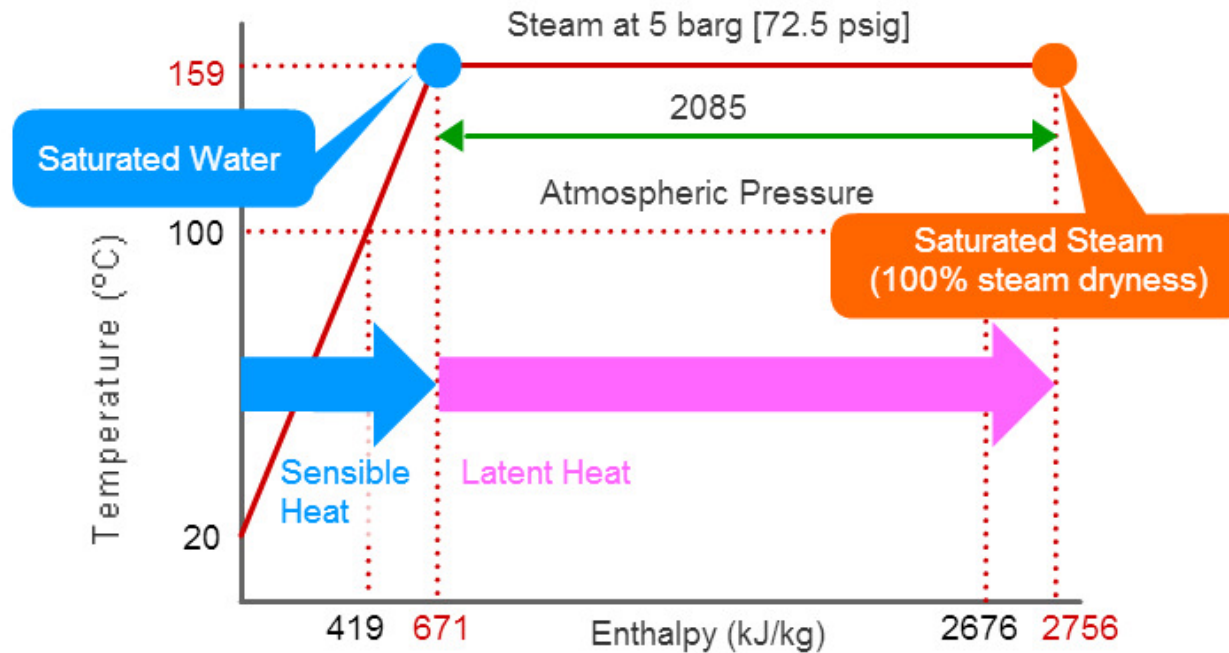

Steam Table (abs)

		(m ³ /kg)		(kJ/kg)		
P (bar)	T (°C)	v _f	v _g	h _f	h _{fg}	h _g
1	100	0.00104	1.673	419	2257	2676
6	159	0.00110	0.3213	671	2085	2756


Properties of Steam




- Superheated steam

- If the saturated steam produced in a boiler is exposed to a surface with a higher temperature, its temperature will increase above the evaporating temperature → Superheated
- When superheated steam gives up some of its enthalpy, a fall in temperature without condensation until the saturation temperature has been reached (condensation occurs in saturated steam)

The temperature/enthalpy diagram

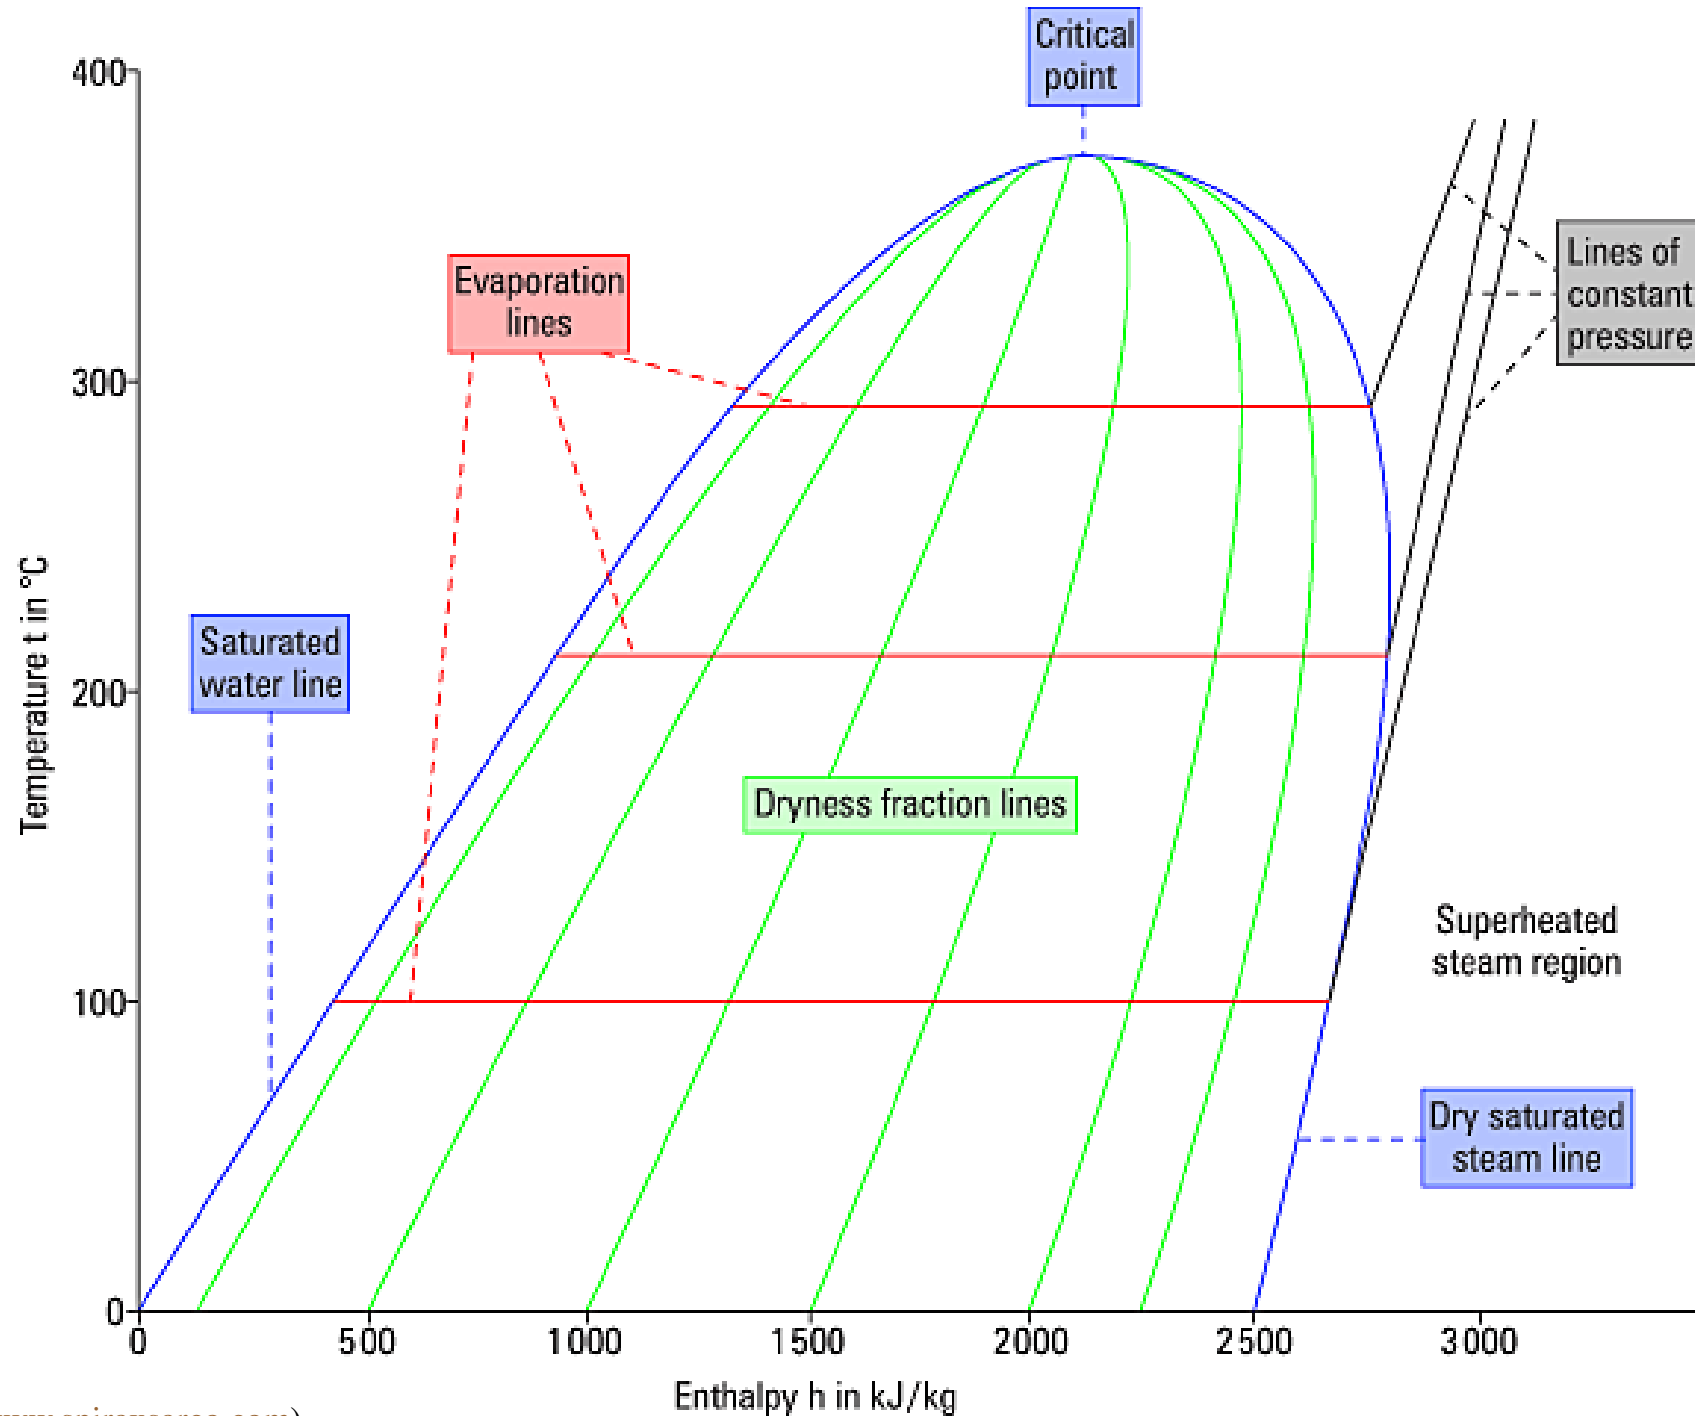

Uses of Steam



- **Steam** is used:

- To produce electrical power in power plants
- As a heating medium for industrial process, heating & hot water in buildings, cooking
- To provide chilled water using waste heat



- Common applications in buildings:


- As a primary medium for distributing heat in factories, hospitals and hotels
- Means of sterilizing, cooking (Chinese restaurants)
- Space heating, humidifying air, hot water supply



Industries and processes which use steam

Heavy users	Medium users	Light users
Food and drinks Pharmaceuticals Oil refining Chemicals Plastics Pulp and paper Sugar refining Textiles Metal processing Rubber and tyres Shipbuilding Power generation	Heating and ventilating Cooking Curing Chilling Fermenting Treating Cleaning Melting Baking Drying	Electronics Horticulture Air conditioning Humidifying

Uses of Steam



- **Steam** as a source of **heat**:

- Direct steam heating



- Processes where steam is in direct contact with the product being heated, e.g. steam Chinese dumplings


- Indirect steam heating



Jacketed kettle


- Processes where steam is not in direct contact with the product being heated; widely used in industry (with a heat exchanger) because it provides rapid, even heating
- The water droplets formed during heating will not affect the product

Heat transfer equations for steam heating

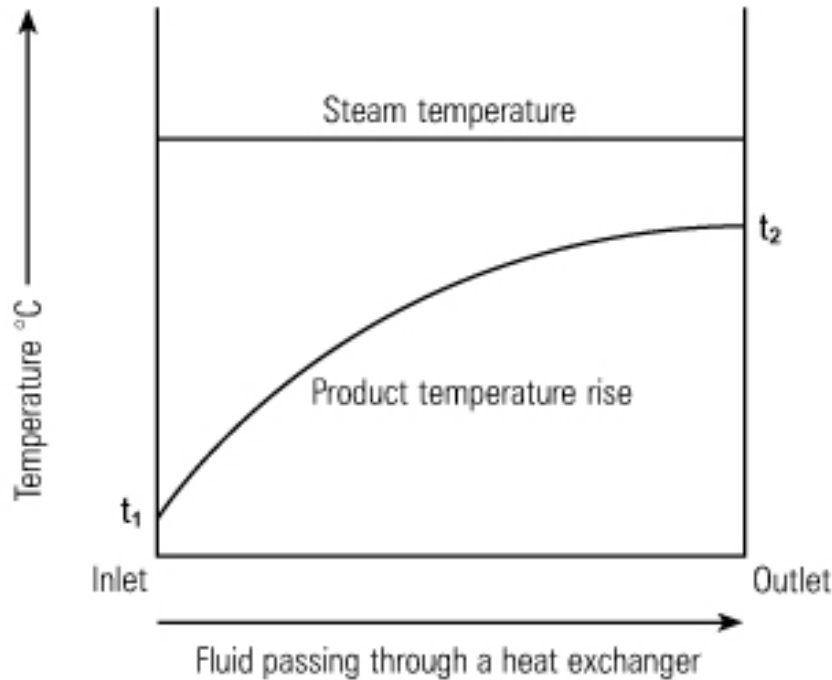

Log mean temperature difference (LMTD)


$$\Delta T_{LMTD} = \frac{T_2 - T_1}{\ln \left(\frac{T_s - T_1}{T_s - T_2} \right)}$$

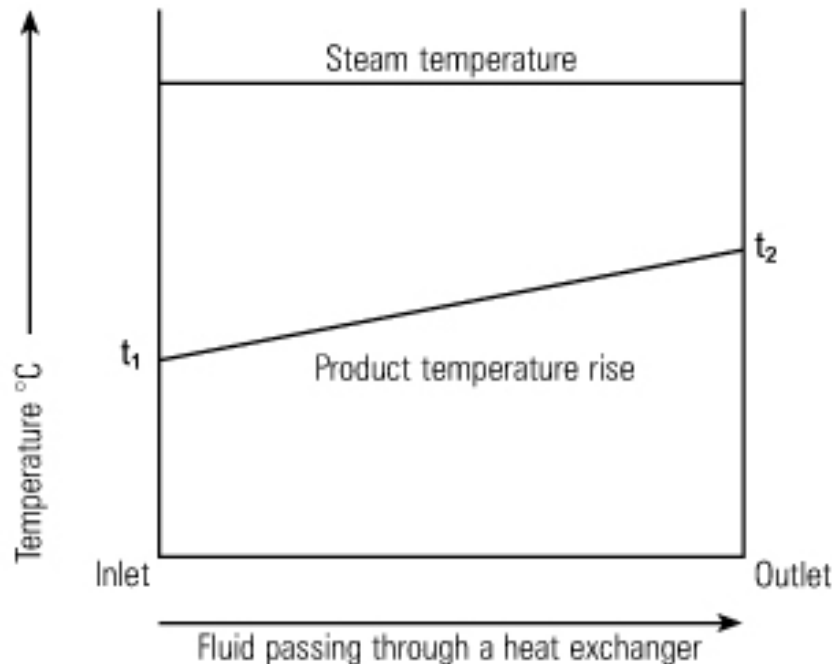


Arithmetic mean temperature difference (AMTD)

$$\Delta T_{AMTD} = T_s - \left(\frac{T_1 + T_2}{2} \right)$$

Uses of Steam




- Typical applications for steam in industry: *
 - Heating/Sterilization
 - Propulsion/Drive
 - Motive
 - Atomization
 - Cleaning
 - Moisturization
 - Humidification

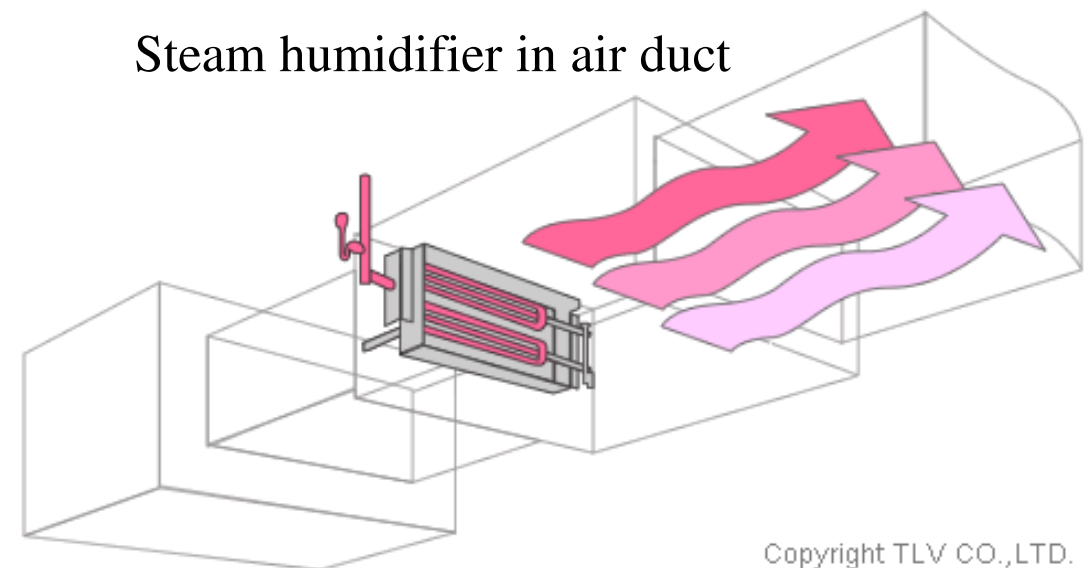

Copyright TLV CO.,LTD.

Uses of Steam




- Unique properties of steam for applications:
 - Sterility – sterilizing in hospitals & food industry
 - High heat content – means smaller pipes than a water-based system
 - High heat transfer value (w/ change of state) – means smaller heat exchangers
 - Ease of distribution – no pumps are required
 - Flexibility – can provide the means to heat, cool (absorption chillers) and humidify

Comparison between steam and water for humidification


Factor	Steam	Water
Cleanliness	Clean and sterile. Can be used in clean areas	Disinfection needed. Care must be taken to avoid formation of stagnant pools. Not suitable for clean areas
Efficiency	Easily absorbed	Carryover normal. Eliminator plates necessary
Heating	No change in air temperature	Reheat battery needed
Cooling	No cooling effect	Can provide evaporative cooling
Controllability	Easily controlled	Difficult to control

Uses of Steam



- Advantages of steam over hot water systems:
 - No pumps needed: steam flows through system unaided
 - Smaller heat emitters
 - Low density: steam can be used in tall buildings where water systems create excessive pressure
 - Terminal units can be added/removed easily
 - Steam components can be repaired or replaced just by closing the steam supply (no associated draining and refilling a water system)
 - Steam system temperature can be controlled by varying either steam pressure or temperature
- Disadvantages:
 - More complicated, more maintenance & supervision


Uses of Steam



- Utilizing latent heat (steam heating) for heat transfer is more effective than utilizing sensible heat (hot water or oil heating), as a much higher amount of energy is released in a shorter period of time

Property	Advantage
Rapid even heating through latent heat transfer	Improved product quality and productivity
Pressure can control temperature	Temperature can be quickly and precisely established
High heat transfer coefficient	Smaller required heat transfer surface area, enabling reduced initial equipment outlay


Uses of Steam



- Use steam directly for heating
 - Low pressure (LP): up to 35 kPa
 - Medium pressure (MP): 140 to 550 kPa
 - High pressure (HP): 550 to 1400 kPa
- Low pressure steam
 - It has a higher heat content
 - Causes less risk of noise and wear
- Medium or high pressure steam
 - For large installations with long steam mains
 - Requires pressure-reducing set for appliances

Operating principle of steam heating

Why air valve? Where to put it?

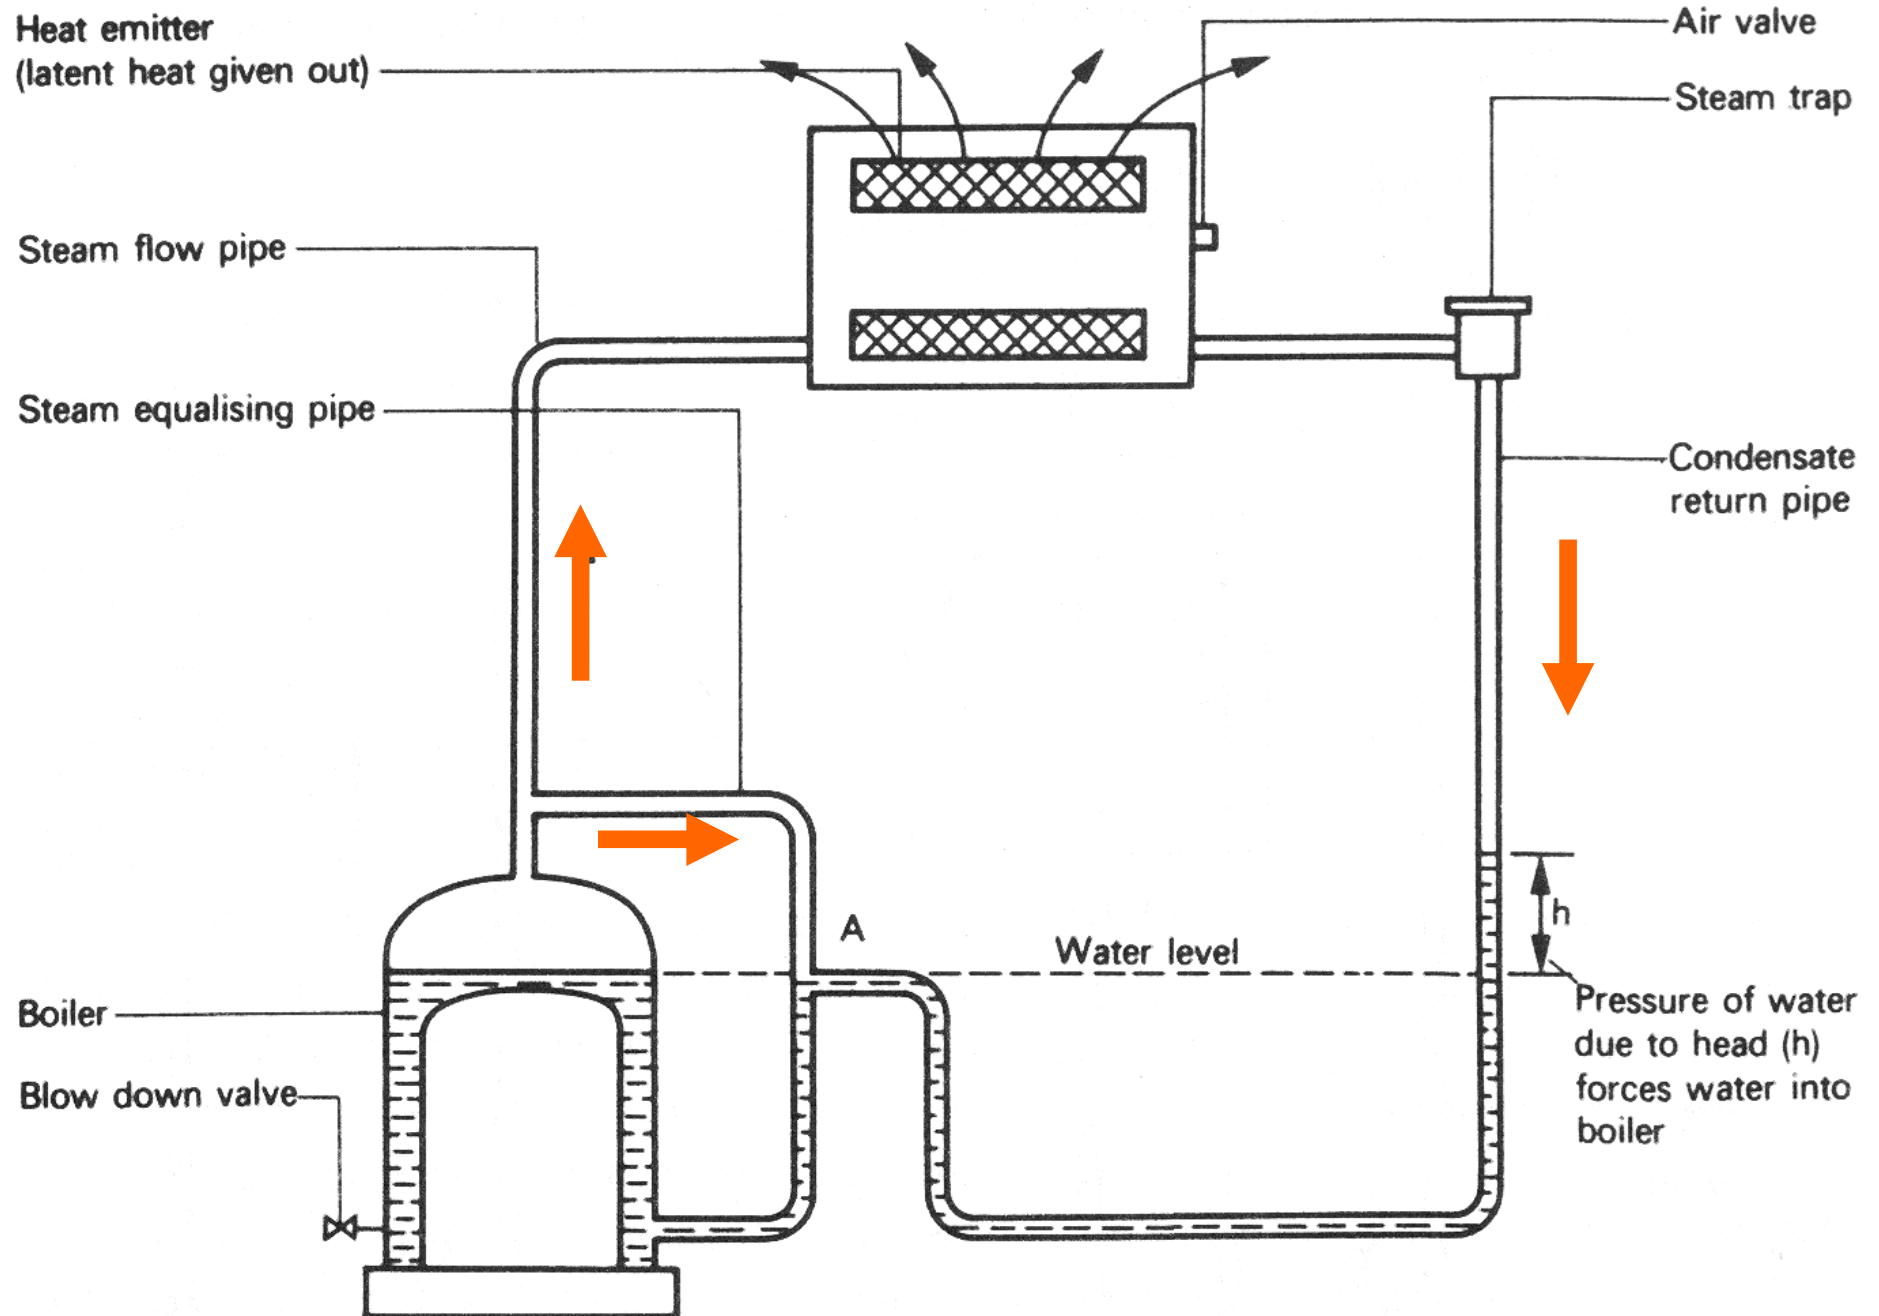


Steam System



- Basic arrangements
 - Boiler plant using steam pressurisation
 - Hot water boiler (w/ steam maintained inside)
 - Boiler feed pump & cistern
 - Circulating pump & pipework
 - Cooling water bypass (mixing to control the pressure)
 - Steam & the water are at saturation temperature

Boiler plant using steam pressurisation

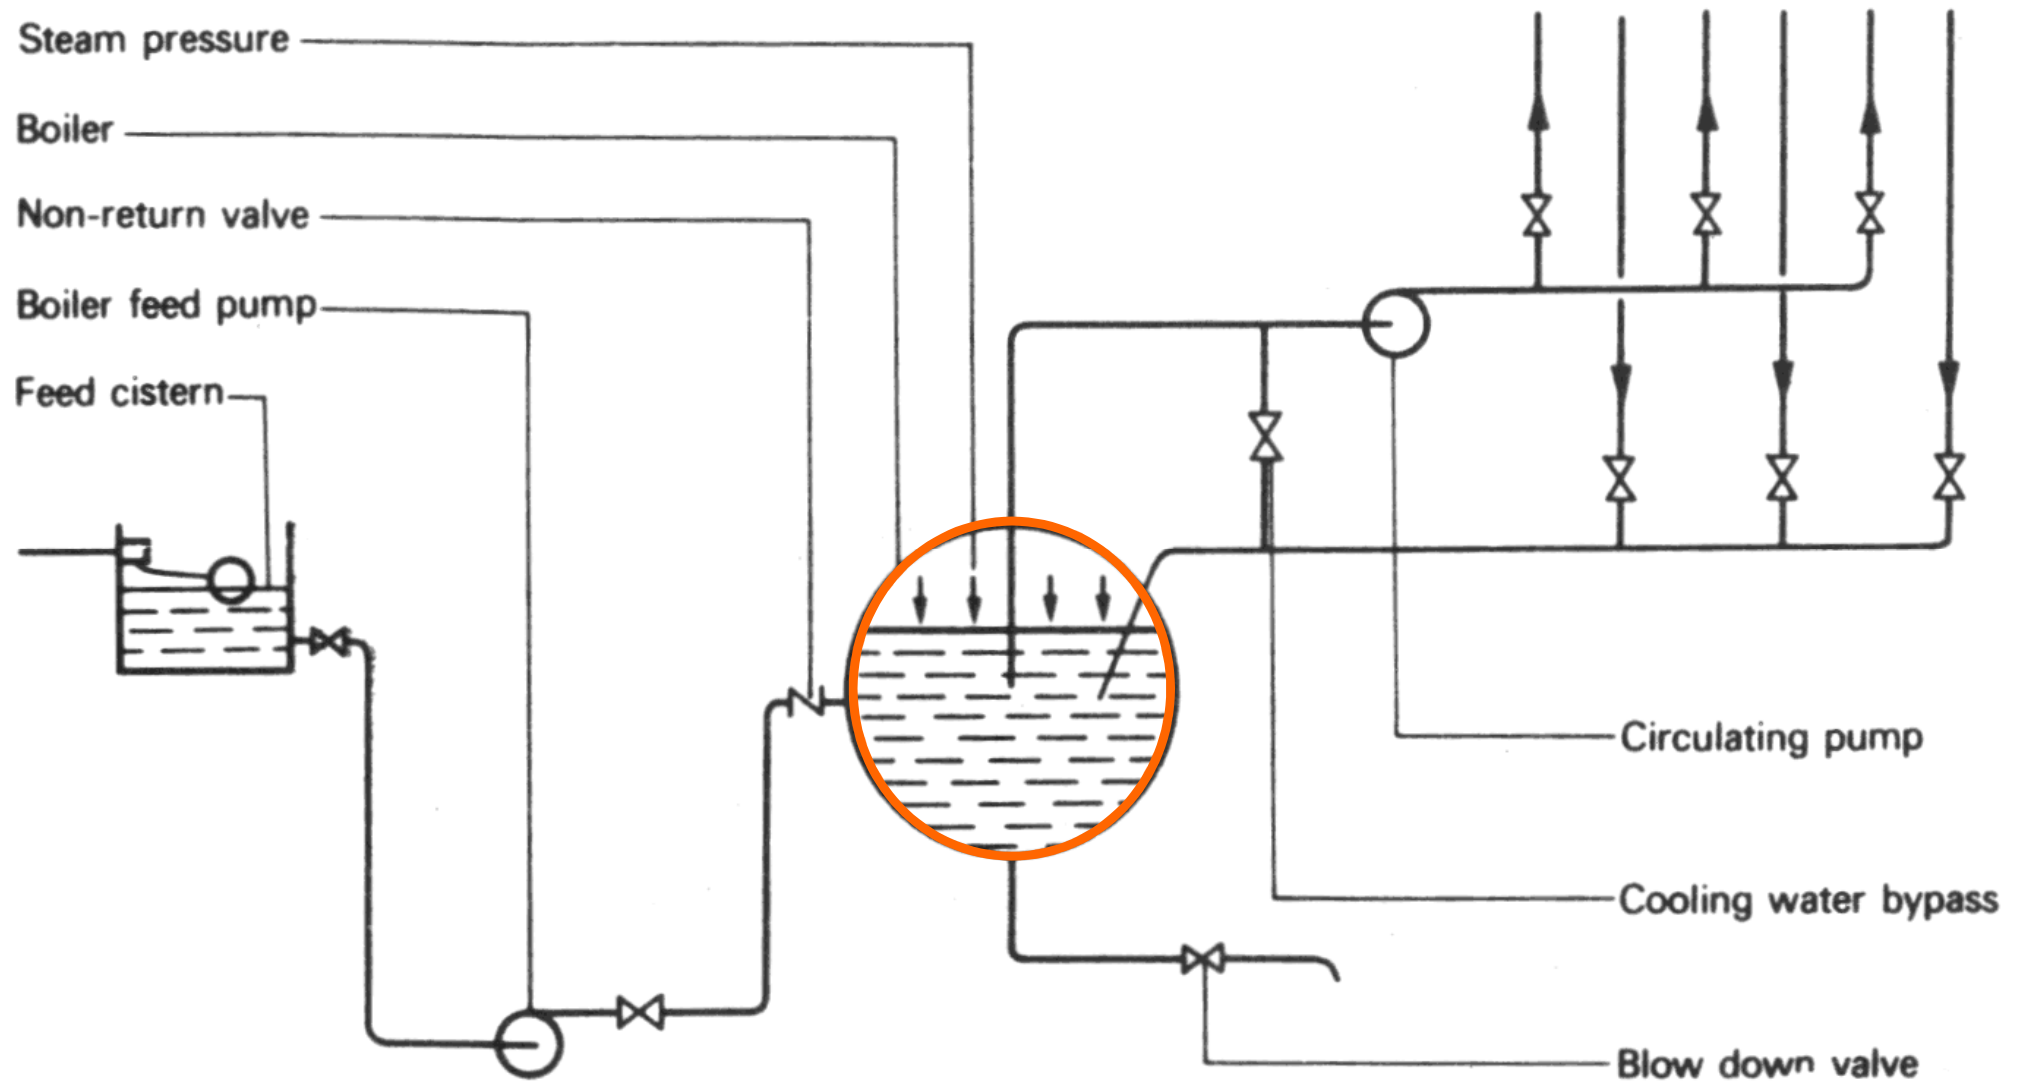


Why blow down?

Steam System




- Classification of steam systems:
 - By method of condensate return
 - 1) By gravity (runs back to boiler)
 - 2) By automatic pump (pumped back to boiler)
 - 3) By condensate lifting trap
 - By pipe layout
 - One pipe or two pipe
 - Up-feed or down-feed

One-pipe gravity steam heating system

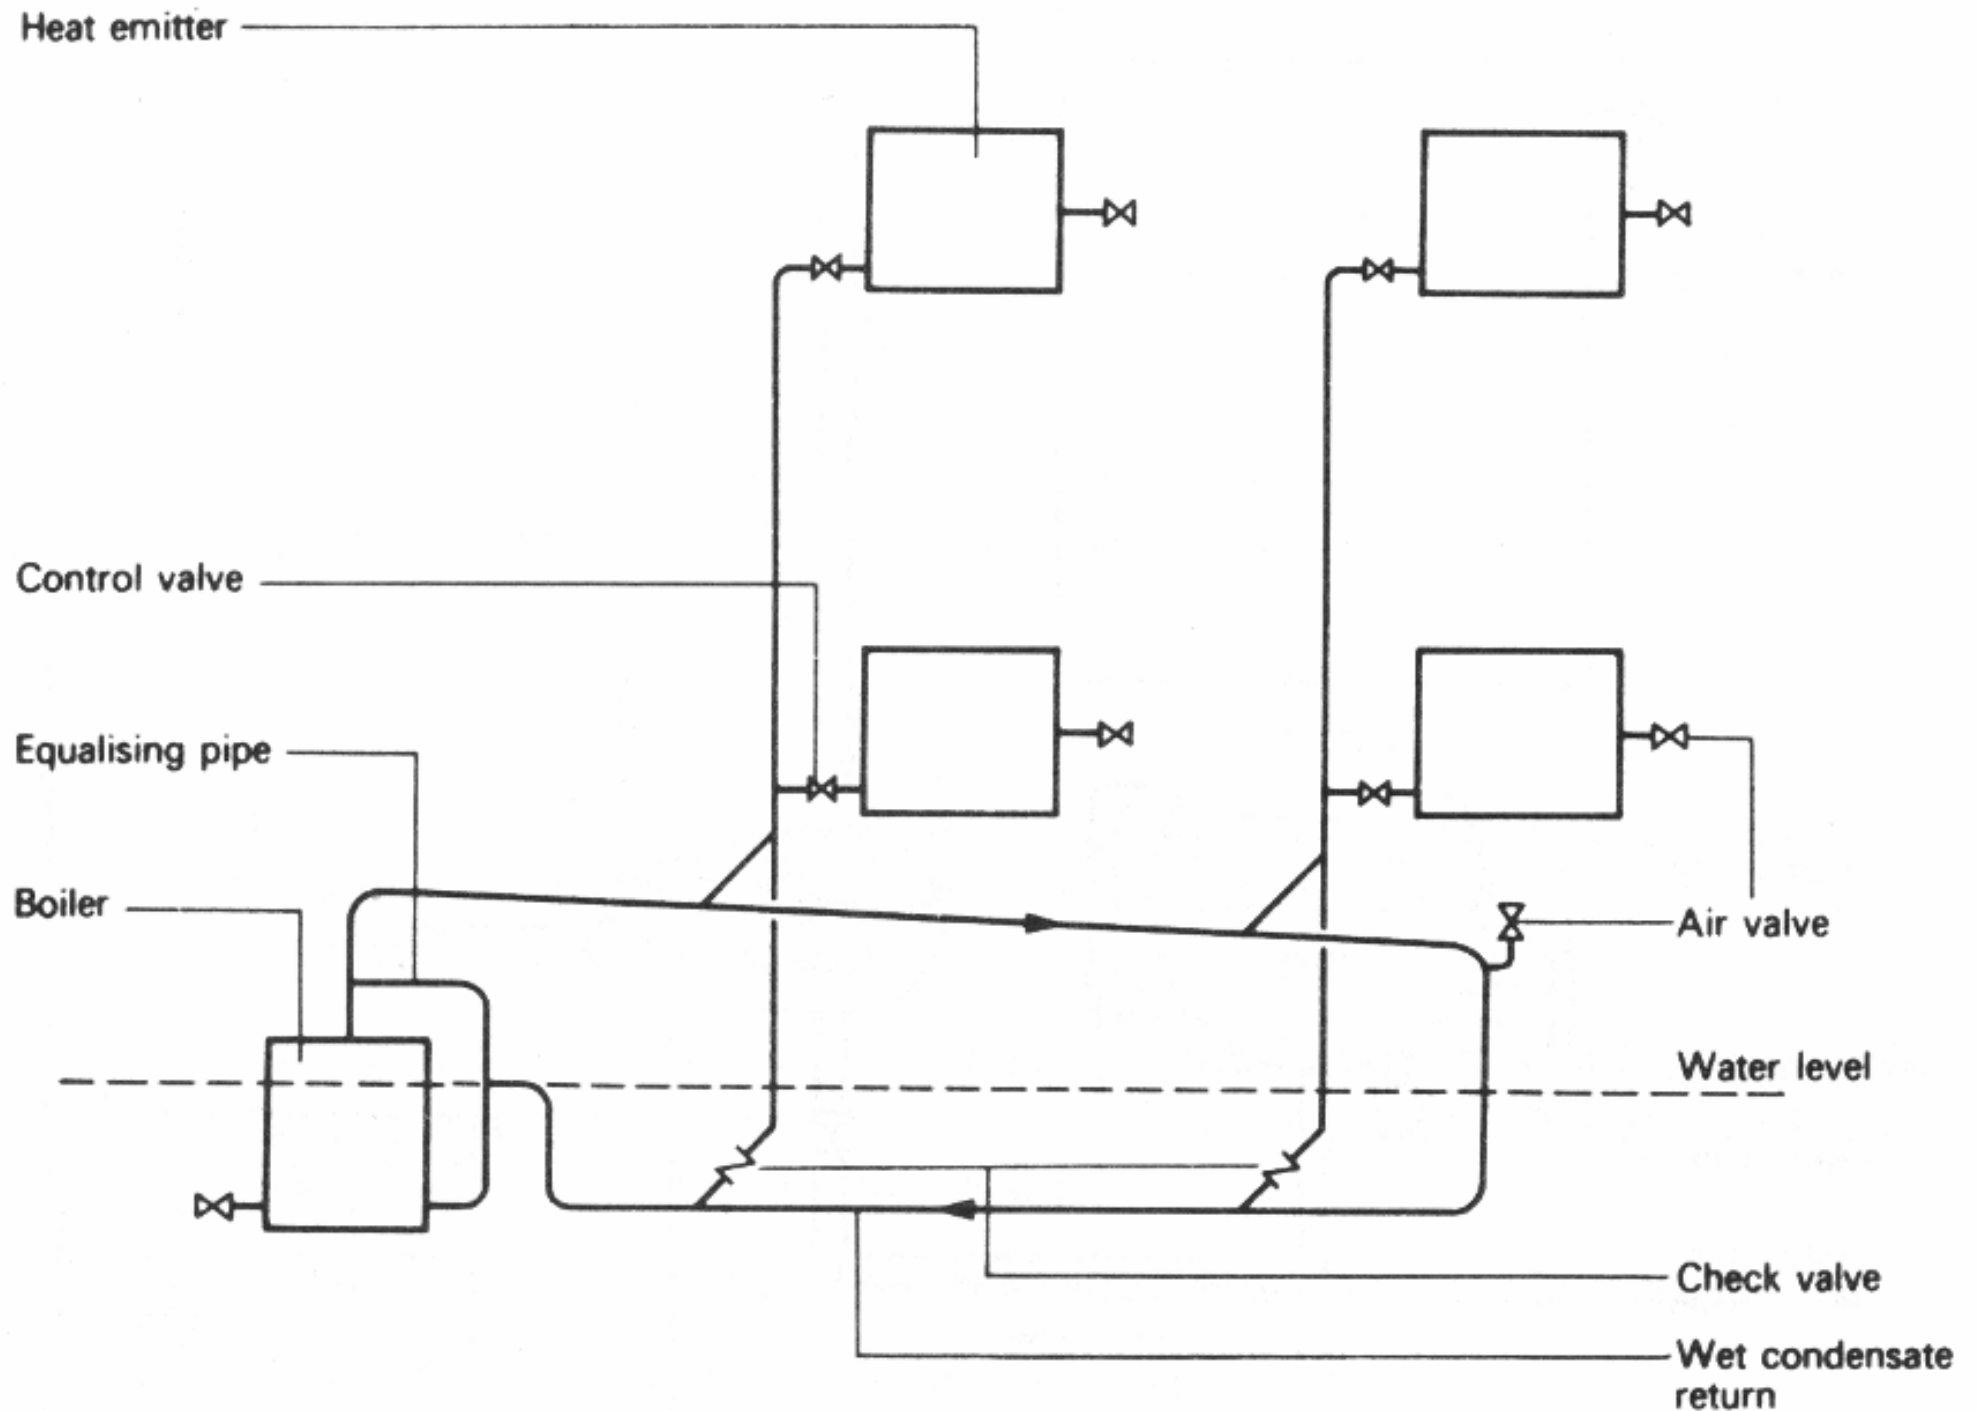

Two-pipe mechanical steam heating system

What are the functions of strainer, trap & sight glass?

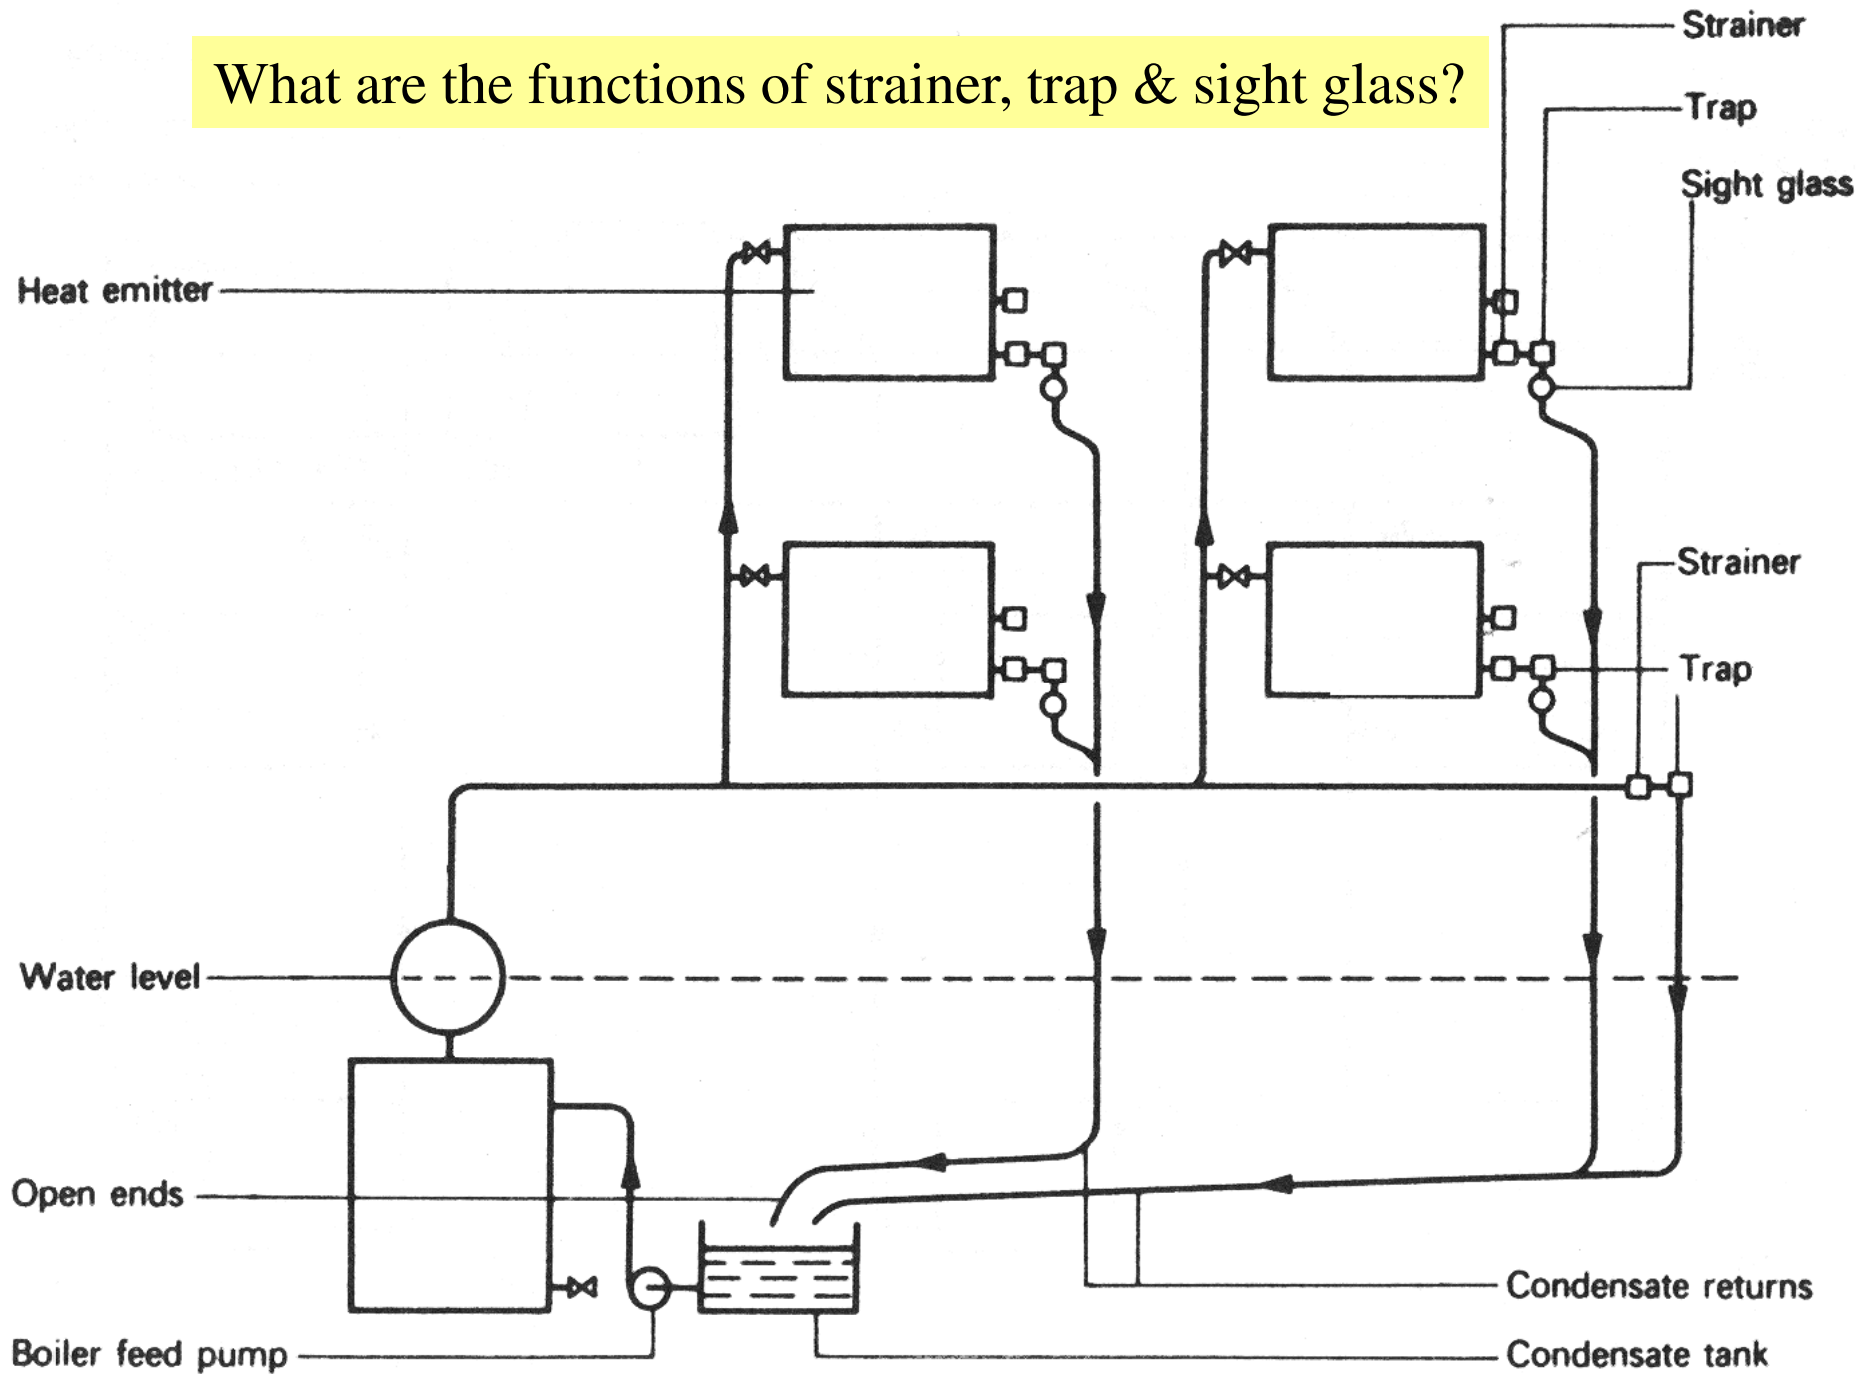


Steam System




- A steam system consists of:
 - Steam-supply/generating facility
 - Boilers, feedwater systems, heat exchangers (e.g. economizers), boiler and system controls, fuel and gas handling equipment (e.g., fuel trains, stacks), and steam/water treatment equipment and piping
 - Steam and condensate return/water piping system
 - The steam and condensate loop
 - Steam-use facility
 - For industrial and commercial needs, such as comfort heating, food processing, paper corrugation

Typical steam system

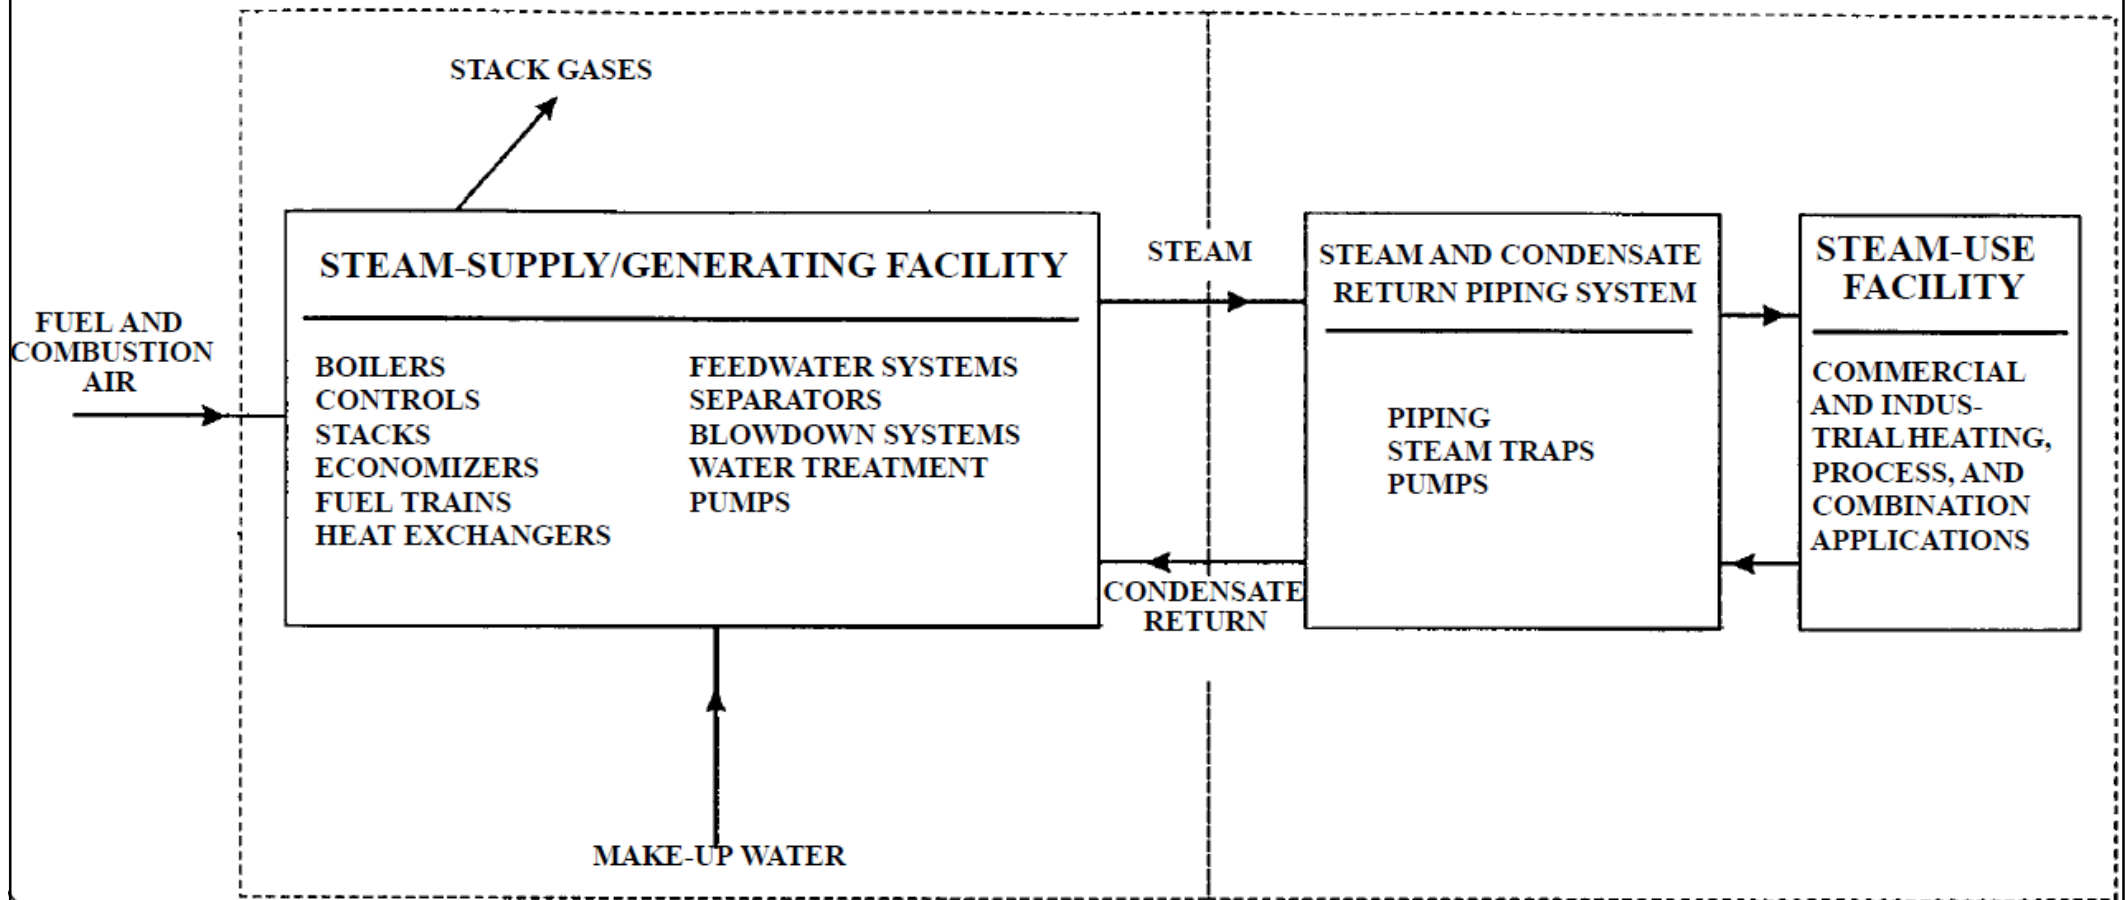


Four steps of the steam and condensate loop:
generation, distribution, usage and condensate return.

Schematic diagram of a generic steam-generating facility

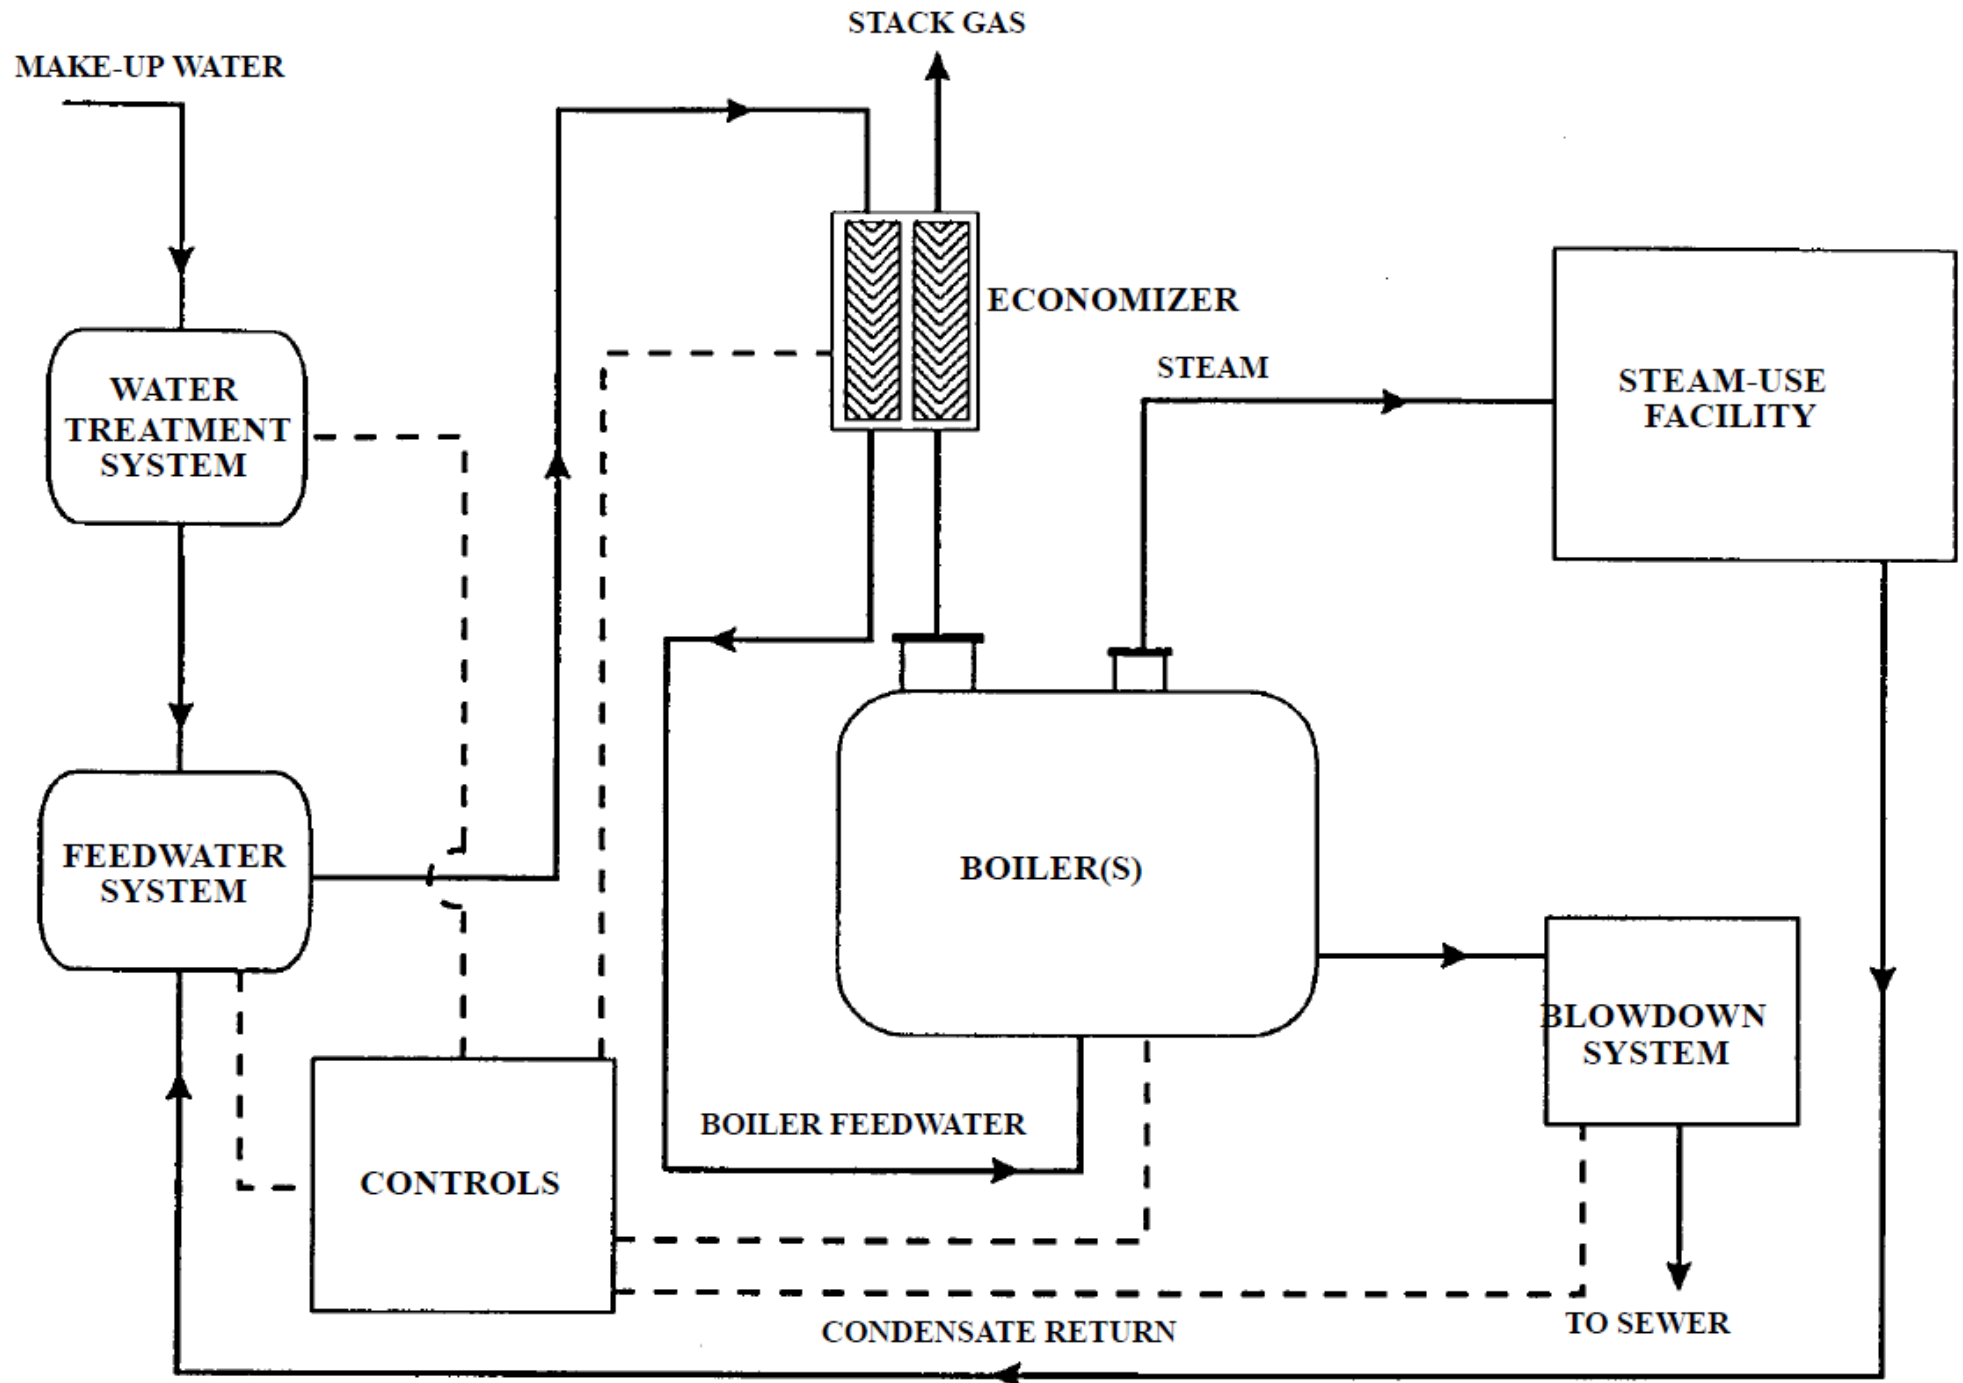


Four principal areas of a steam system

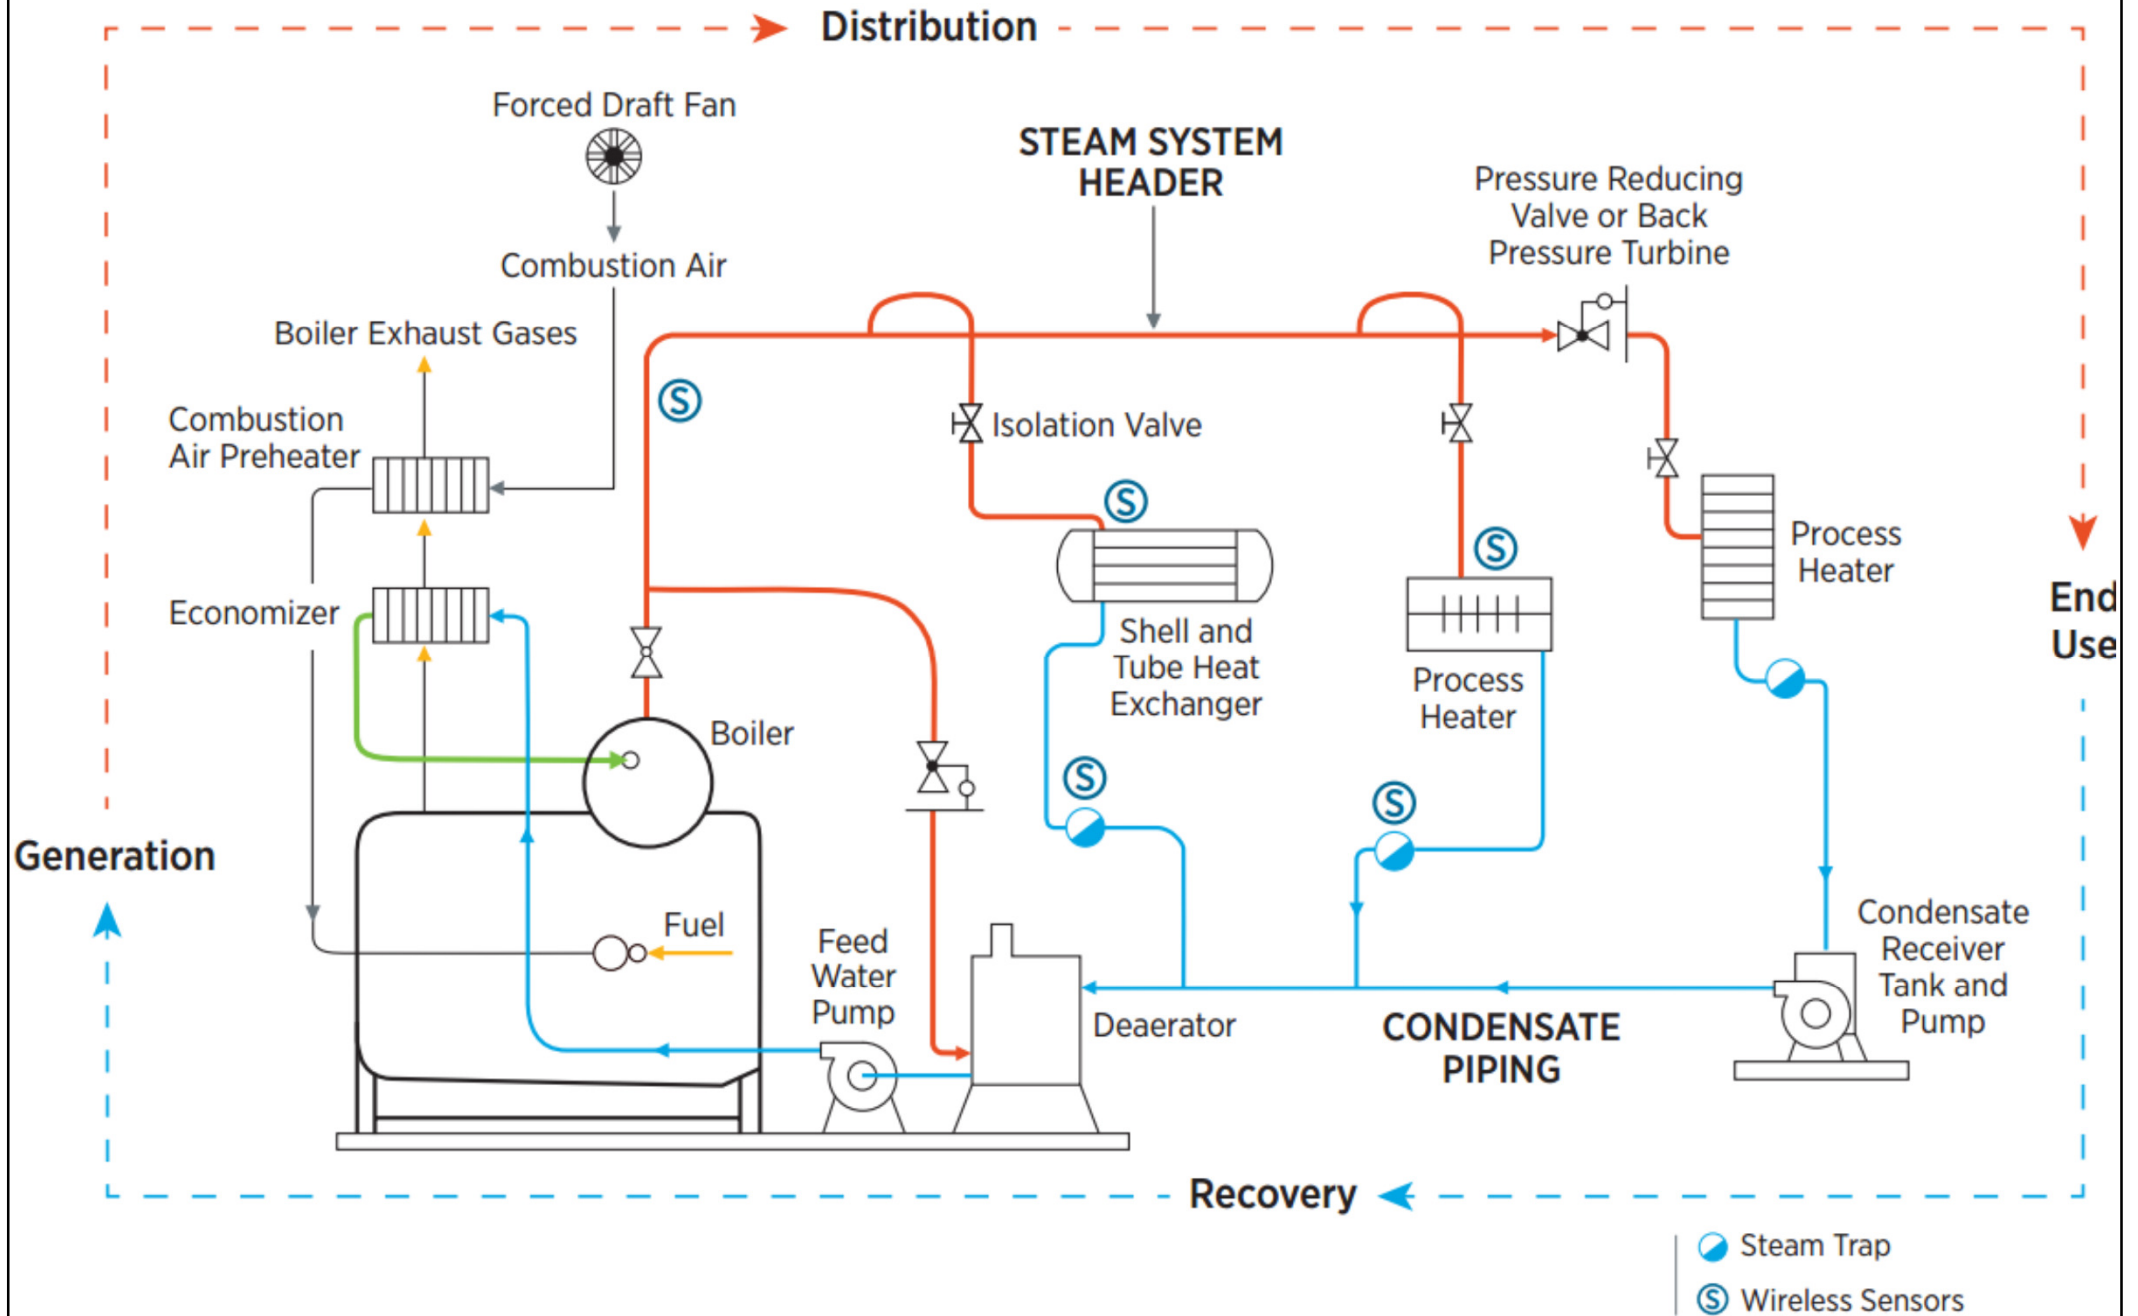


Steam System



- Steam quality: steam should be available at the point of use:
 - In the correct quantity
 - At the correct temperature and pressure
 - Free from air and incondensable gases
 - Clean
 - Dry

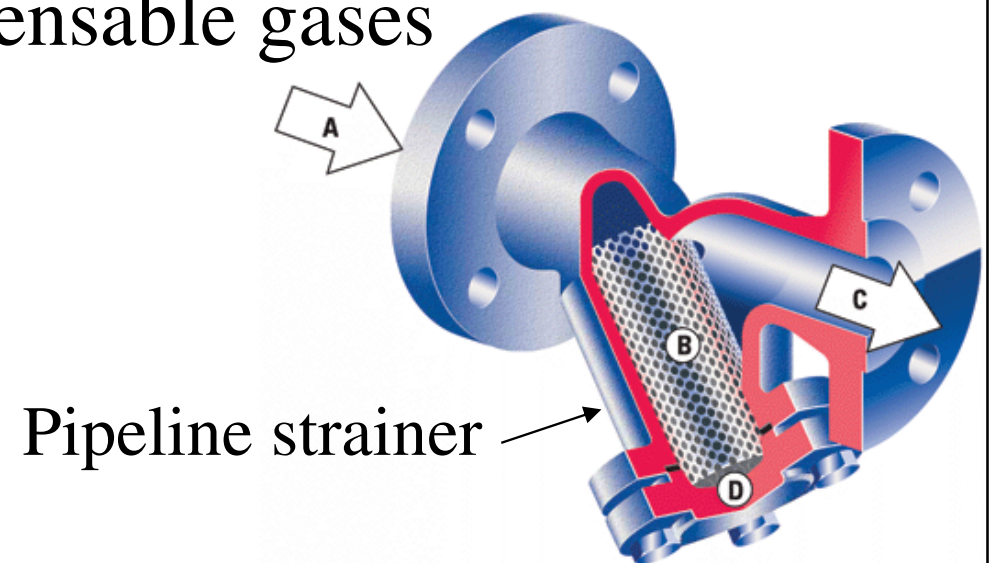

A typical basic steam circuit (the steam and condensate loop)

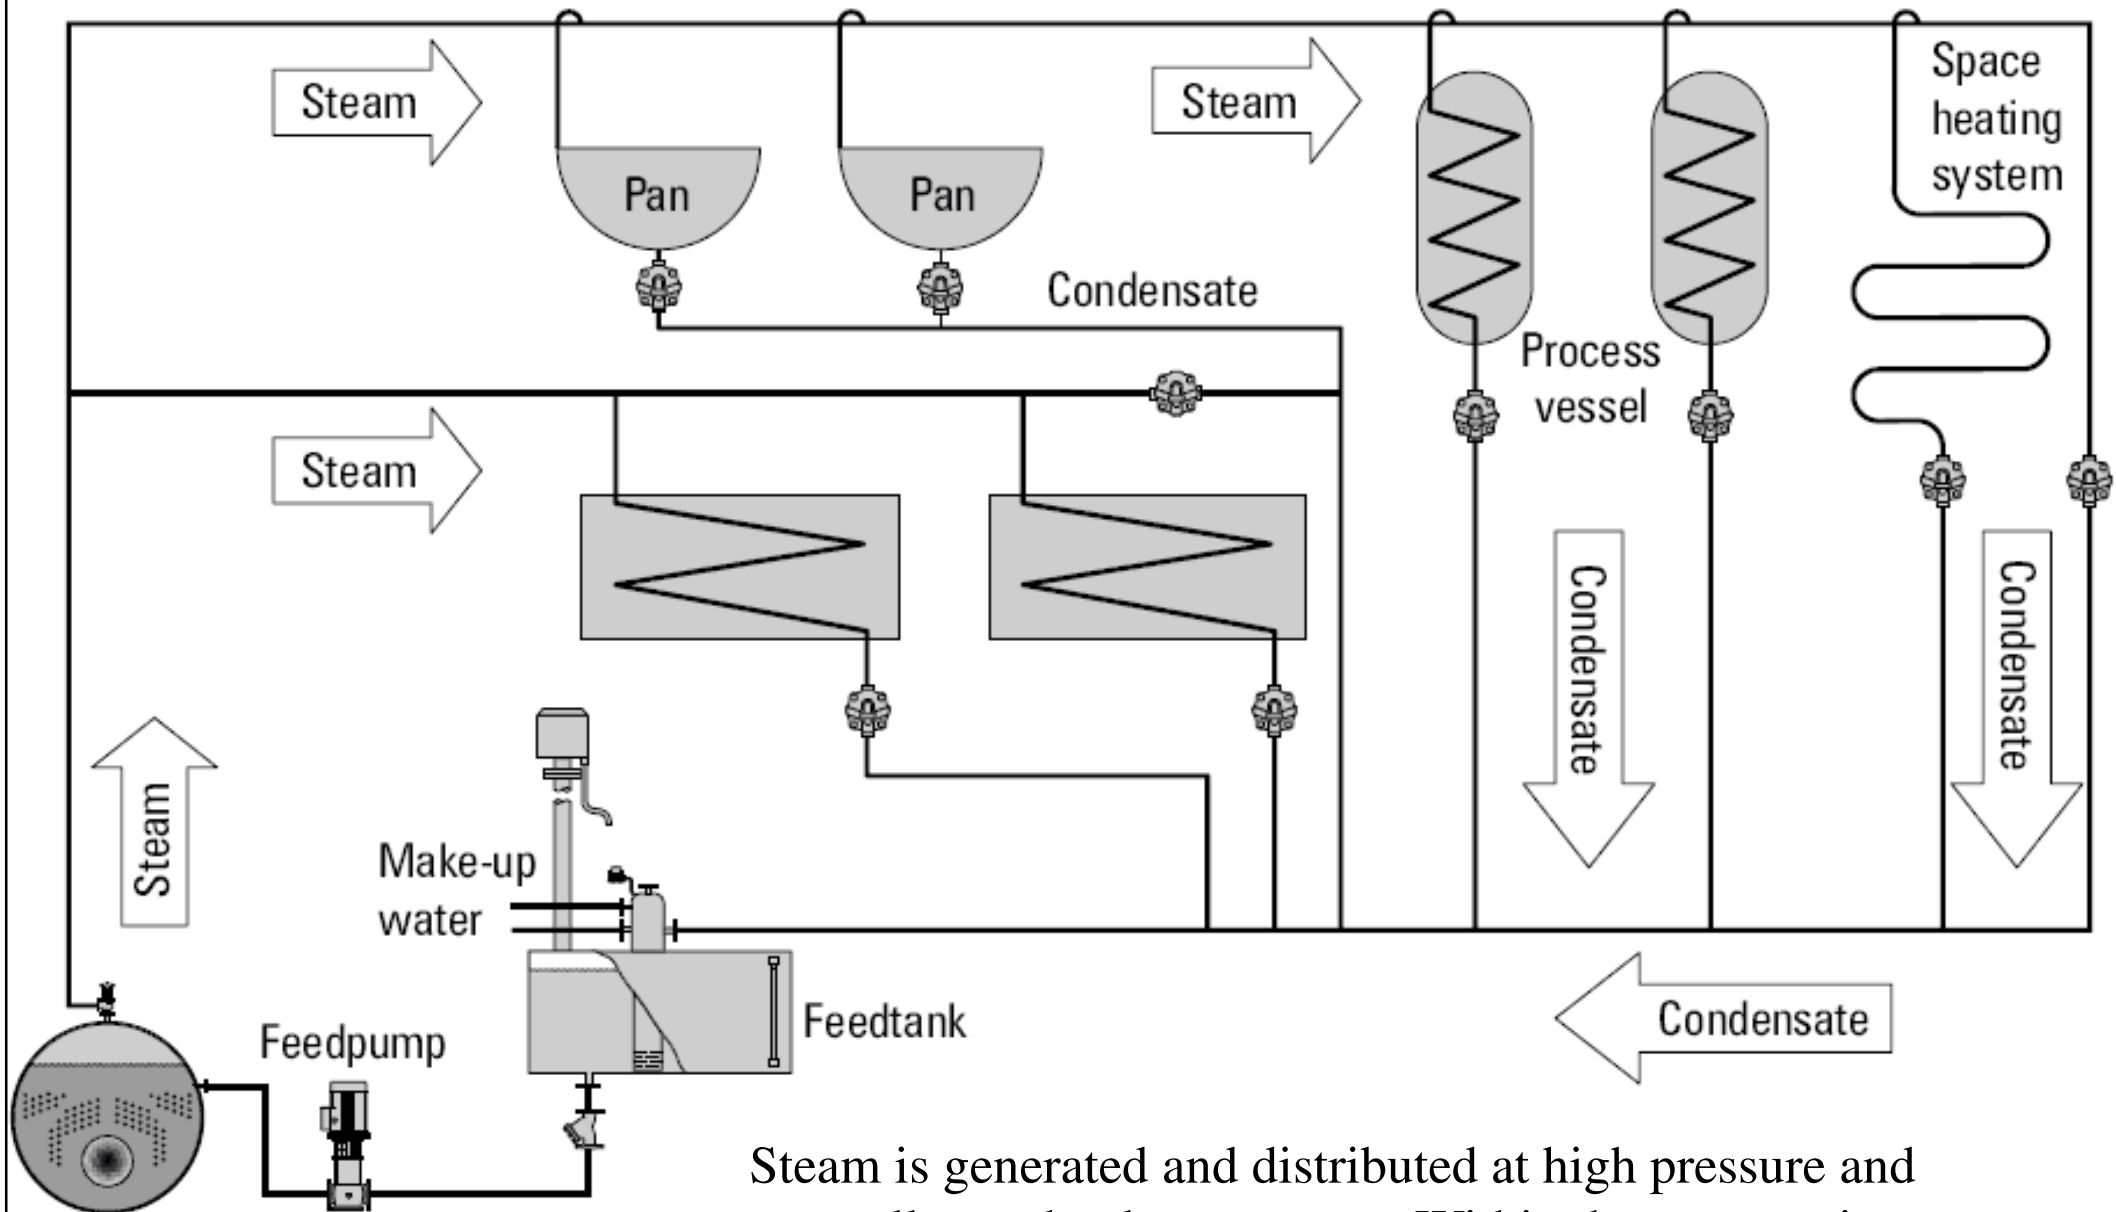

Steam is generated and distributed at high pressure and generally used at low pressure. Within the steam-using equipment, when the steam condenses it gives up its enthalpy of evaporation, transferring heat to the secondary medium.

Steam Traps and Components



- Steam traps

- Purpose: automatic valve to “trap” the steam and filter out condensate (i.e. condensed steam) and non-condensable gases (e.g. air)
- Definition by ANSI (American National Standard Institute):
 - *“Self contained valve which automatically drains the condensate from a steam containing enclosure while remaining tight to live steam, or if necessary, allowing steam to flow at a controlled or adjusted rate. Most steam traps will also pass non-condensable gases while remaining tight to live steam.”*

Steam Traps and Components



- Why are steam traps installed?
 - When steam has given up its latent heat, steam condenses and becomes condensate
 - Heating efficiency will suffer if condensate is not removed as rapidly as possible
- Three main groups of steam traps:
 - (a) Thermostatic
 - (b) Mechanical
 - (c) Thermodynamic

Typical types of steam traps



Ball float type



Thermodynamic type



Thermostatic type



Inverted bucket type

“The duty of a steam trap is to discharge condensate while not permitting the escape of live steam”


New functions in modern steam traps:
e.g. automatic air venting and scale removal

(See also: The History of Steam Traps

<http://www.tlv.com/global/AU/steam-theory/history-of-steam-traps-pt1.html>

<http://www.tlv.com/global/AU/steam-theory/history-of-steam-traps-pt2.html>)

Thermostatic

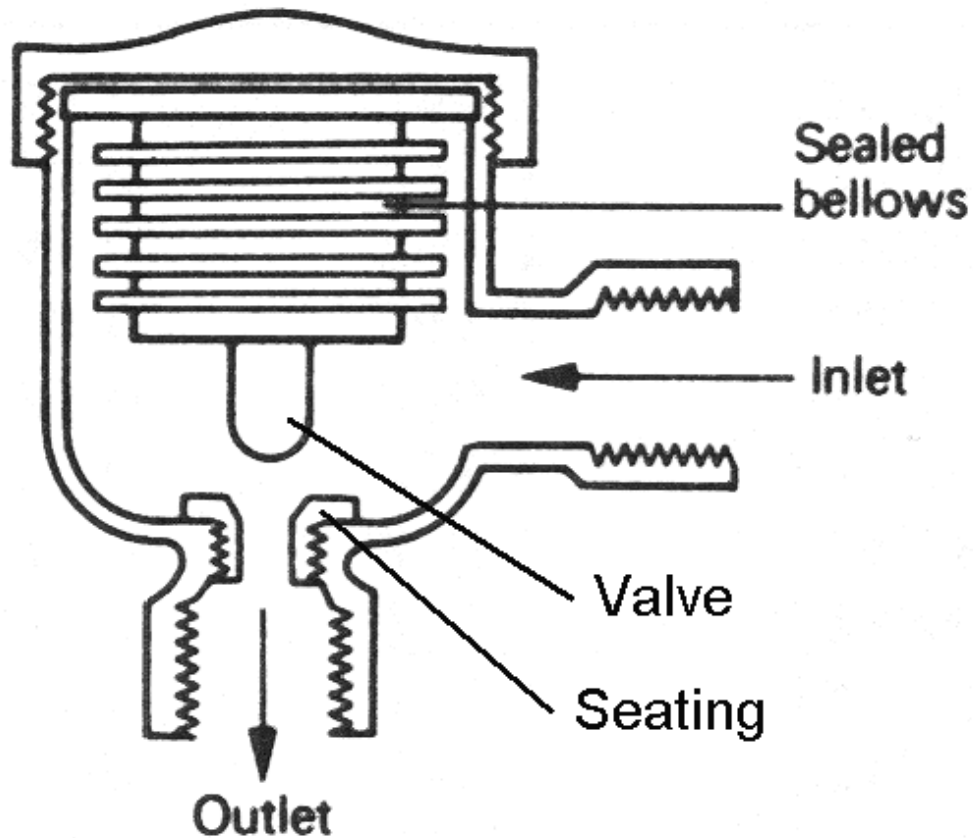

Thermostatic steam trap


Operating principle:

- The closed bellows contains a volatile spirit which has a boiling point suiting the temperature
- When steam enters the traps, the volatile spirit expands → open the bellows, close the valve
- Water (condensate) enters the traps at a temperature lower than steam, the spirit contracts and closes the bellows → open the valve + allow water to flow back to boiler

(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/thermostatic-steam-traps.aspx>)

(Source: Hall, F. and Greeno, R., 2008. *Building Services Handbook*)

Mechanical

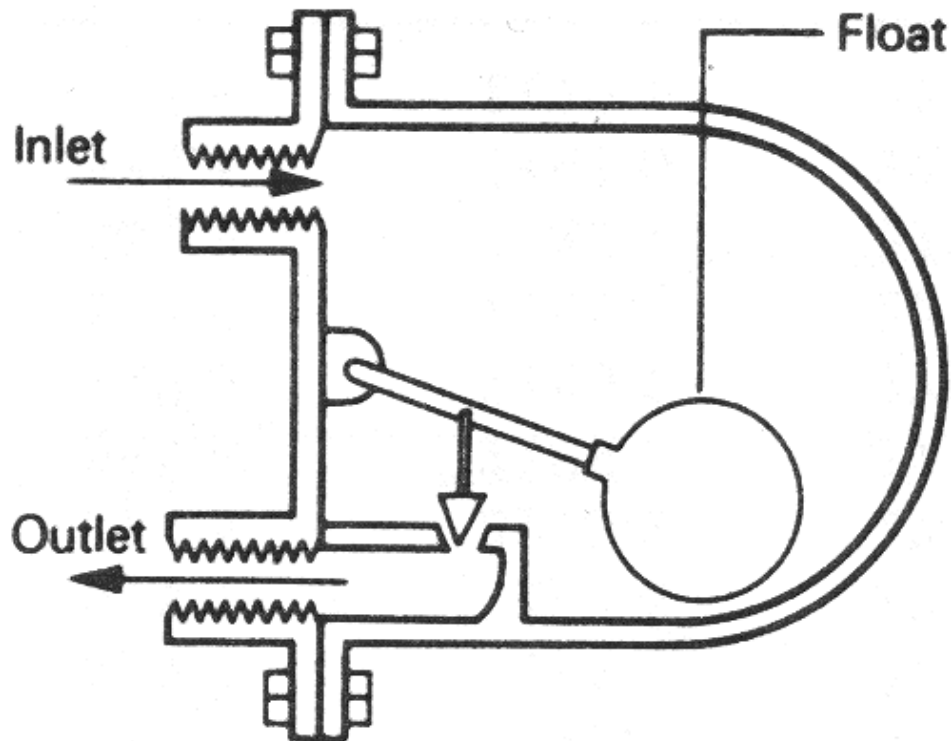

Ball float steam trap

Operating principle:


- Steam enters the trap → ball float valve suspended → weight of float keeps outlet valve close
- Water (condensate) enters trap → float buoyant → opens valve → allow water flowing back to boiler

(See also: <http://www.tlv.com/global/AU/steam-theory/mechanical-steam-traps.html>)

(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/mechanical-steam-traps.aspx>)

(Source: Hall, F. and Greeno, R., 2008. *Building Services Handbook*)

Mechanical

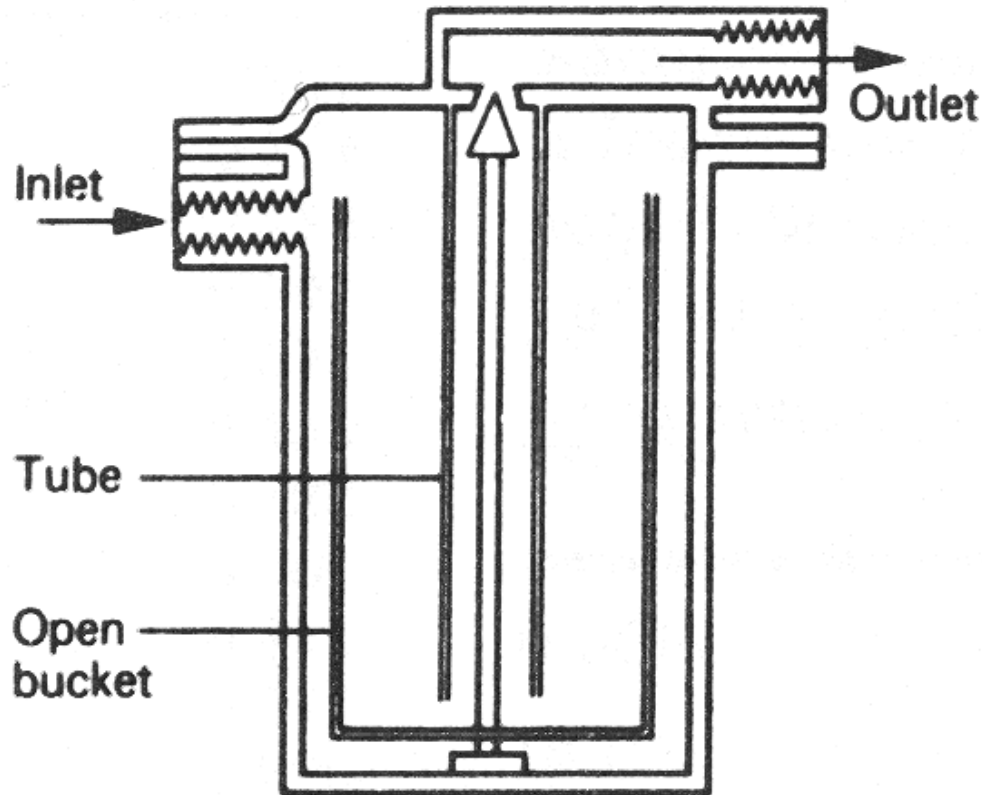

Open bucket steam trap

Operating principle:


- Bucket floats → outlet valve close
- Water (condensate) enters trap → overflows into bucket → bucket to sink → open the valve
- Steam forces water out of bucket through the tube → bucket is buoyant → closing the valve

(See also: <http://www.tlv.com/global/AU/steam-theory/mechanical-steam-traps.html>)

(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/mechanical-steam-traps.aspx>)

(Source: Hall, F. and Greeno, R., 2008. *Building Services Handbook*)

Mechanical

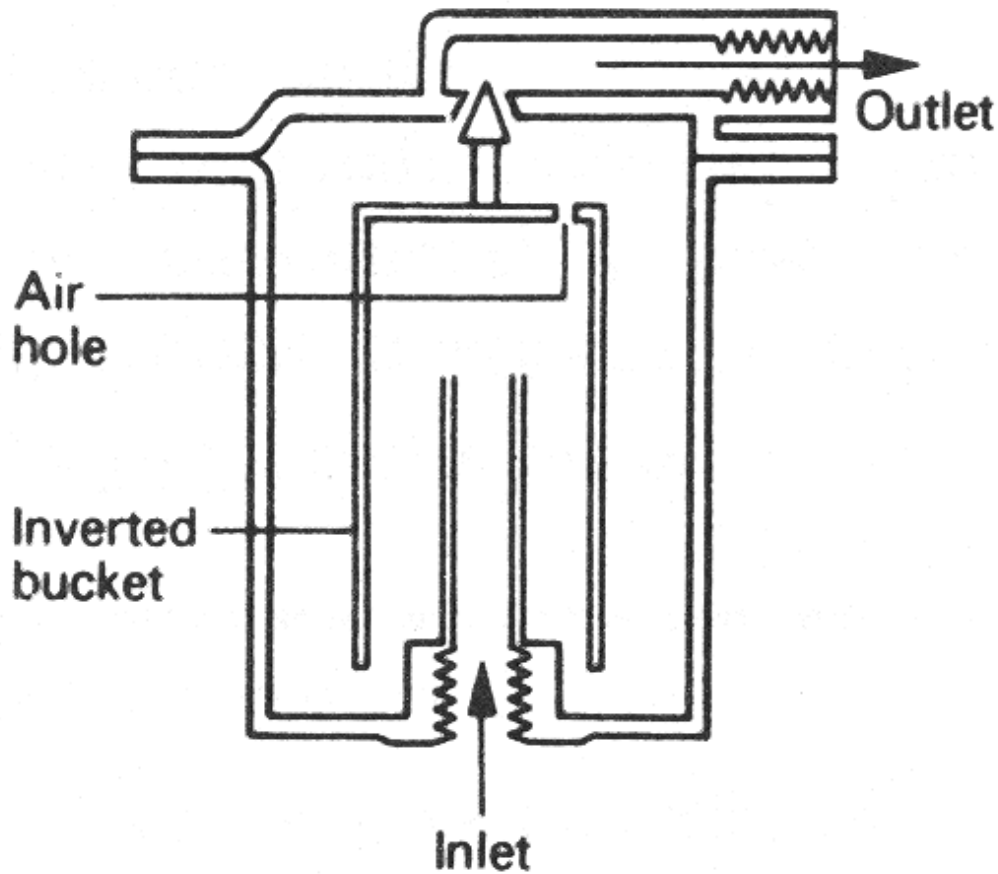

Inverted bucket steam trap


Operating principle:

- Steam enters the trap → bucket is lifted → valve is closed
- Water (condensate) enters trap → bucket fails under its own weight → valve opens → steam pressure forced water out

(See also: <http://www.tlv.com/global/AU/steam-theory/mechanical-steam-traps.html>)

(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/mechanical-steam-traps.aspx>)

Thermodynamic

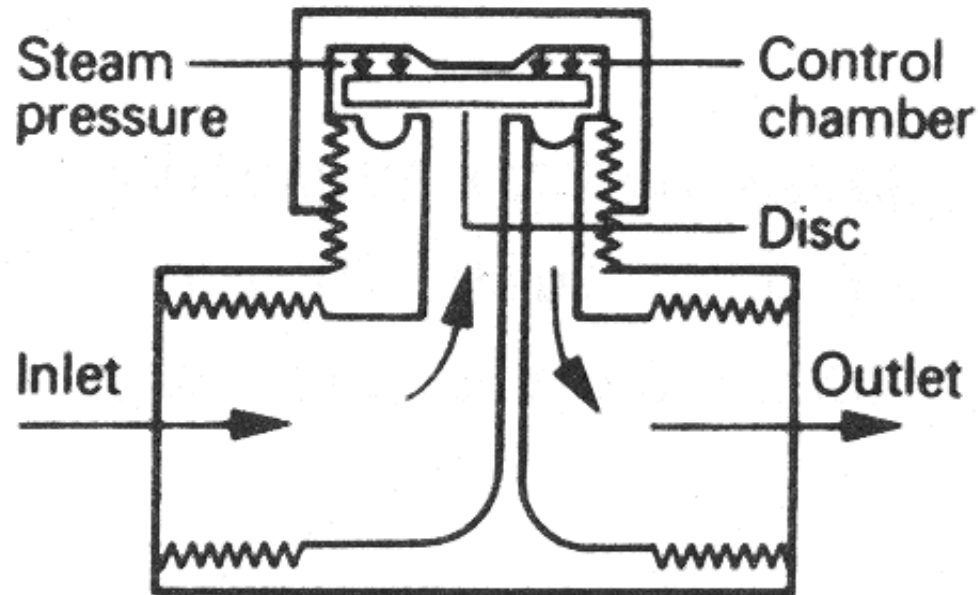

Thermodynamic steam trap

Bernoulli principle:

kinetic pressure + potential energy
= constant


Operating principle:

- Steam flows through trap → increase kinetic energy between disc & seating → reduce pressure energy at this point → disc moves nearer the seating until kinetic energy decreases
- Reduction in kinetic energy → increase pressure energy → lift the disc from seating (prevented from doing so by the steam pressure acting upon the top of the disc in the control chamber)
- Area at the top of the disc > area at inlet underneath → the upper pressure forces the disc firmly on to its seat

(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/thermodynamic-steam-traps.aspx>)

(Source: Hall, F. and Greeno, R., 2008. *Building Services Handbook*)

Thermodynamic

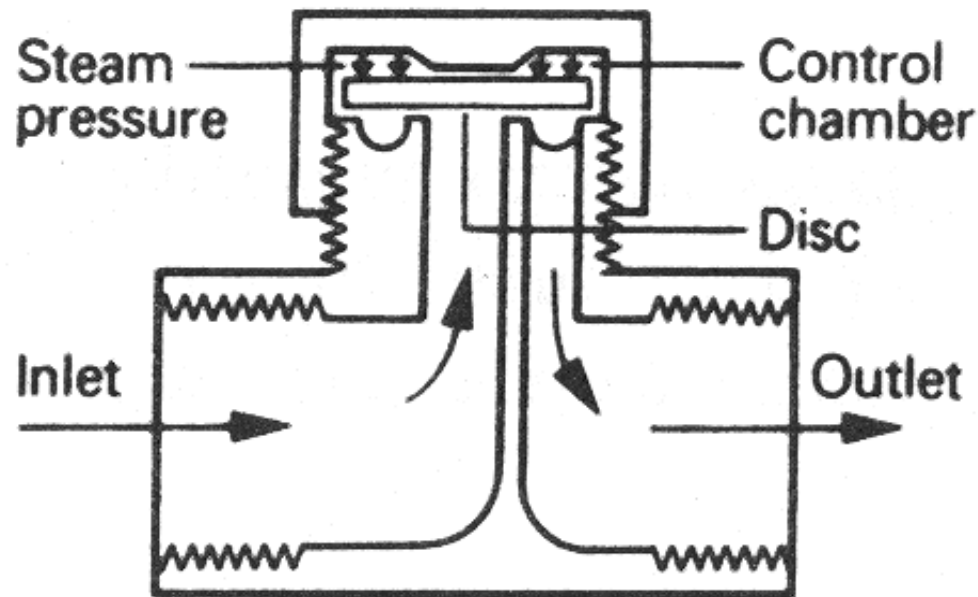

Thermodynamic steam trap

Bernoulli principle:

kinetic pressure + potential energy
= constant

Operating principle (cont'd):

- Water (condensate) enters trap → steam above disc condenses → reduce pressure → disc forced up → water flow through trap
- Water (condensate) flows through trap at a lower velocity than steam → insufficient reduction in pressure below the disc → traps remains open until steam enters


(See also: <http://www.tlv.com/global/AU/steam-theory/how-disc-traps-work.html>)

Steam Traps and Components



- Steam trap selection -- key considerations:
 - Pressure and temperature ratings, discharge capacity, trap type, body material, etc.
 - Selection process:
 - 1. Determine discharge requirements of the steam trap application (e.g. hot or subcooled discharge), and select the matching trap type
 - 2. Select trap model according to operating pressure, temperature, orientation, and any other relevant conditions
 - 3. Calculate application load requirements and apply the trap manufacturer's recommended safety factor
 - 4. Base the final trap selection on lowest Life Cycle Cost (LCC)

Steam trap selection: Understanding specifications

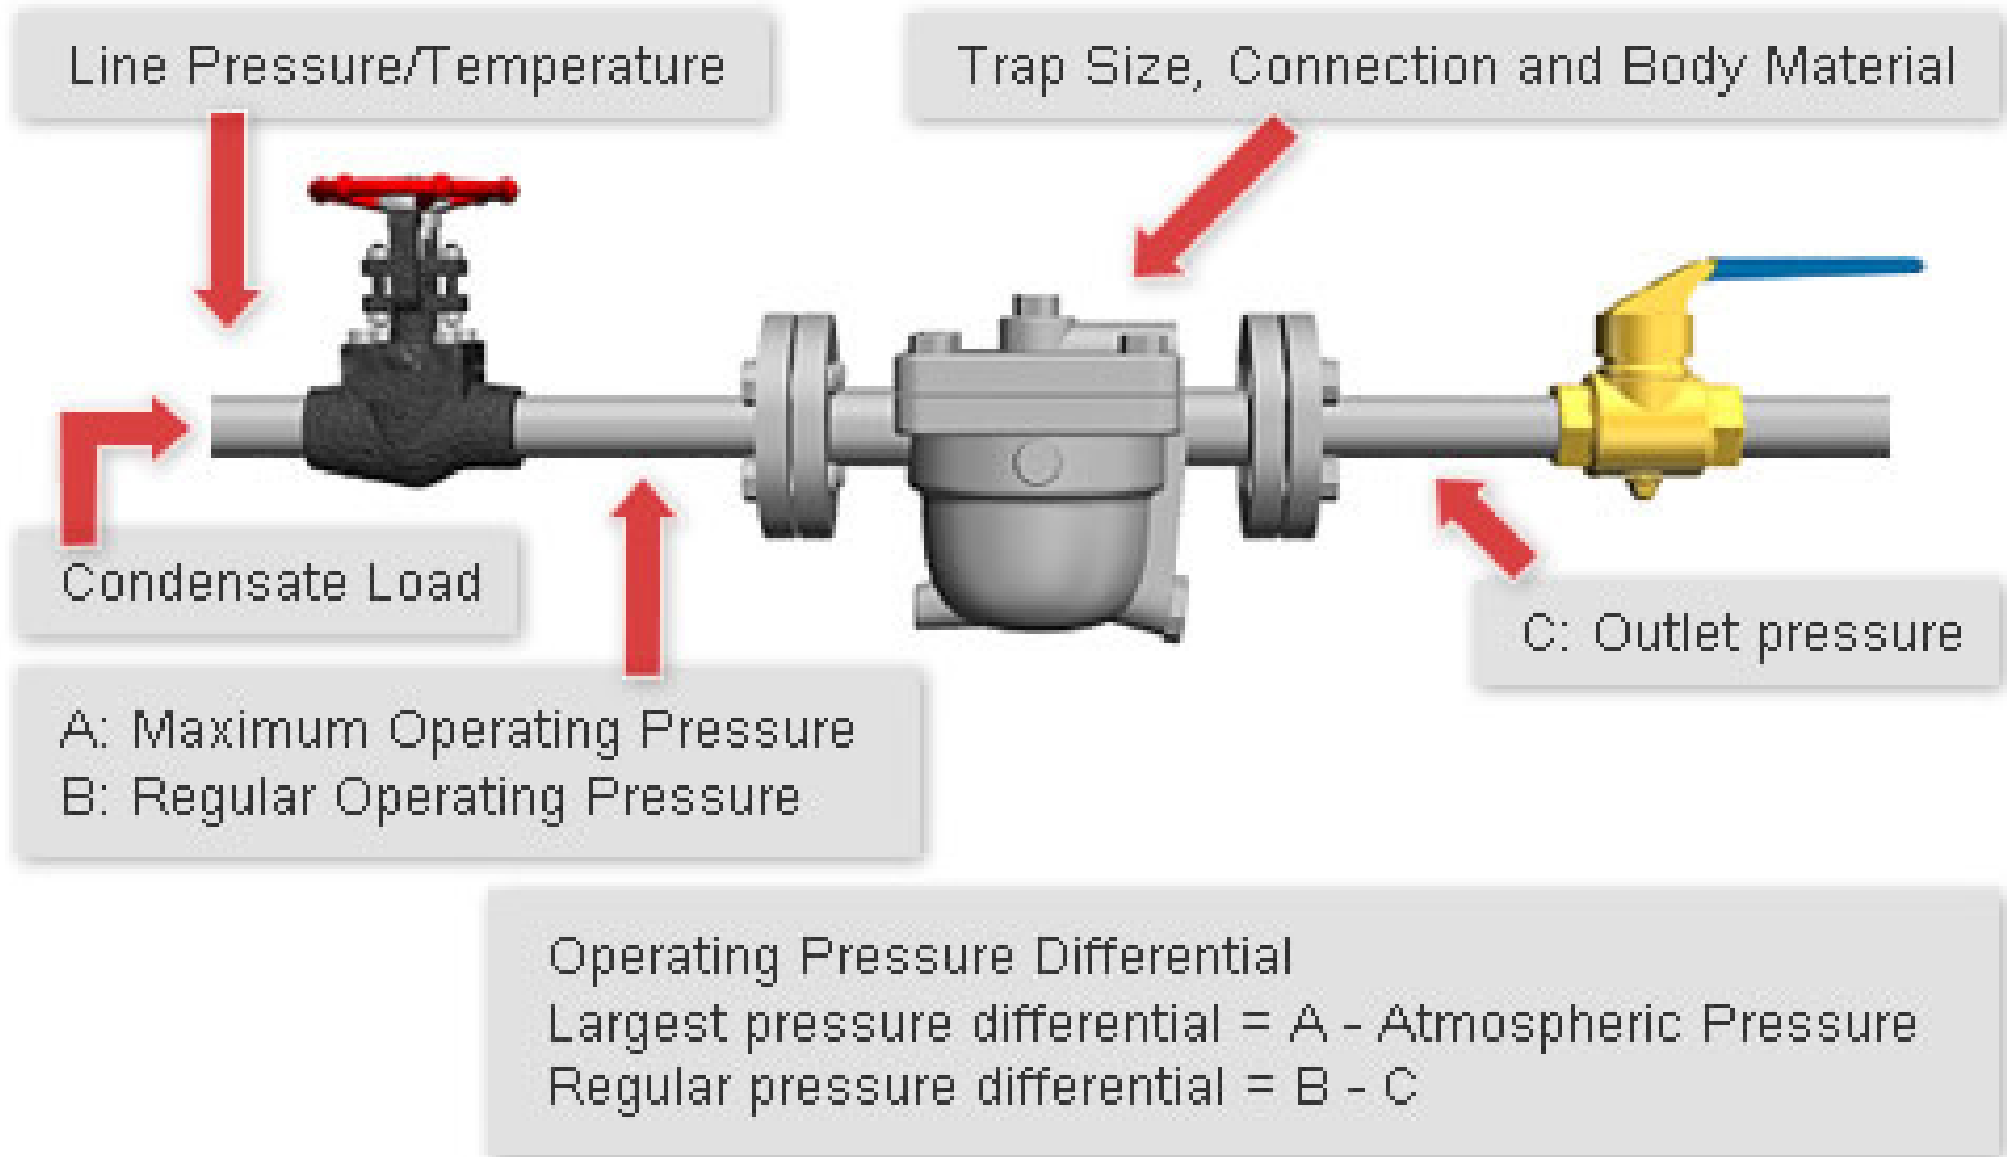

Steam Traps and Components



- Selecting Steam Traps:- (examples & applications)
 - <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping.aspx>
 - 6. Canteen Equipment; Oil Transfer/Storage; Hospital Equipment
 - 7. Industrial Dryers
 - 8. Laundries, Presses
 - 9. Process Equipment
 - 10. Space Heating Equipment
 - 11. Steam Mains; Tanks and Vats; Pressure Reducing Valves

Steam Traps and Components




- Steam trap and piping problems (typical):
 - Trap leaking live steam
 - Temperature control trap (to avoid overheating)
 - Trap installation orientation
 - Trap back pressure
 - Double trapping, group trapping
 - Steam locking, air binding
 - Water/Steam hammer (pressure shock/impact)


(See also: <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-traps-and-steam-trapping/considerations-for-selecting-steam-traps.aspx>)

(Further info: <http://www.tlv.com/global/AU/steam-theory/trap-leaking-live-steam.html>)

Water hammer -- Formation of a solid slug of water

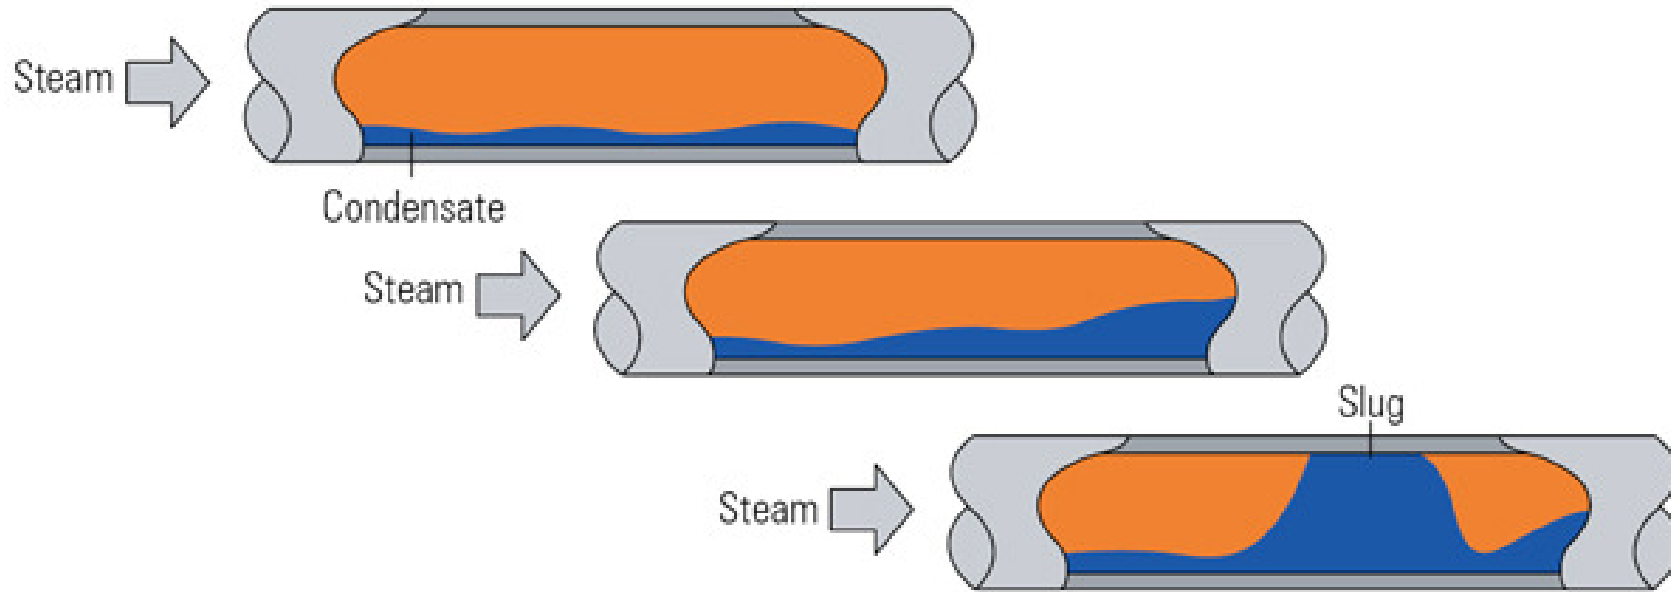


Potential sources of water hammer

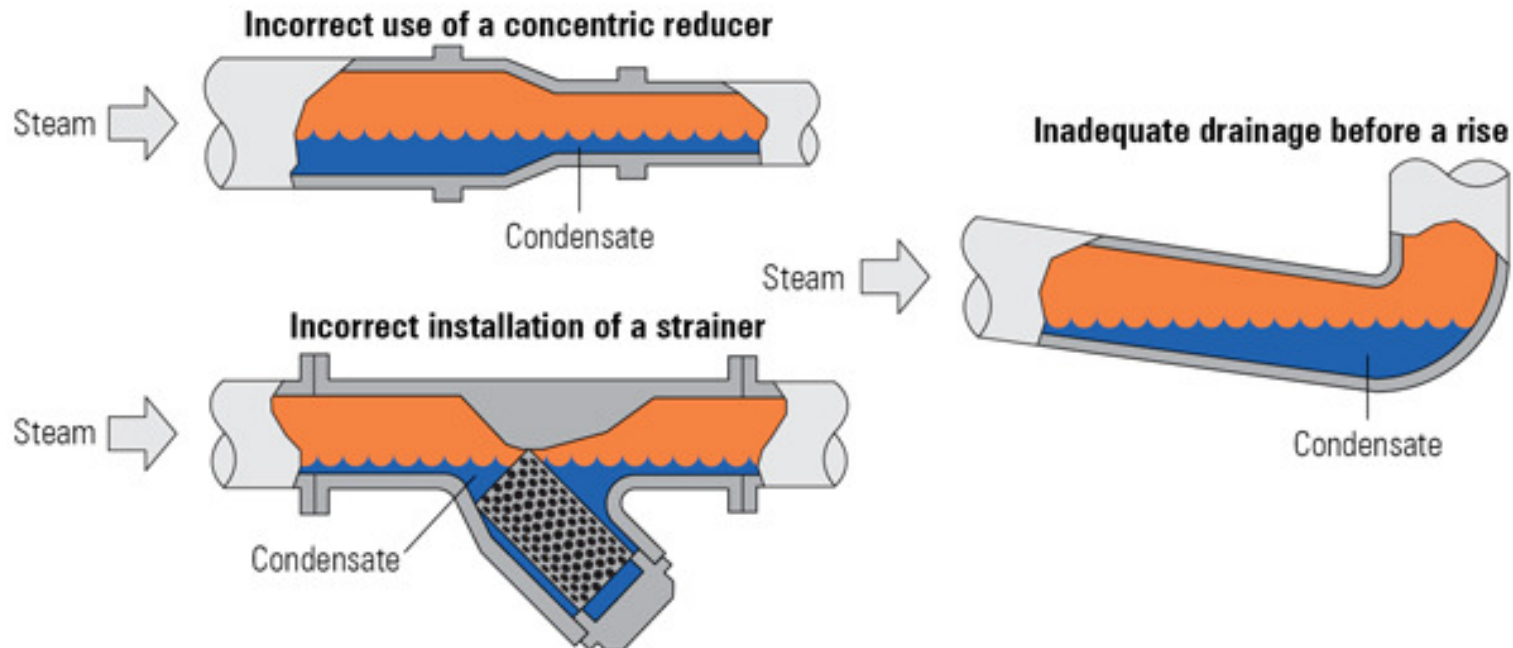

Steam Traps and Components



- Steam trap management
 - Steam trap losses - what it costs you
 - e.g. calculate the cost of losses from one trap, calculate steam leakage amounts from holes in piping
<http://www.tlv.com/global/AU/steam-theory/cost-of-steam-trap-losses.html>
 - Steam trap testing
 - Through visual observation
 - Using temperature
 - Using sound

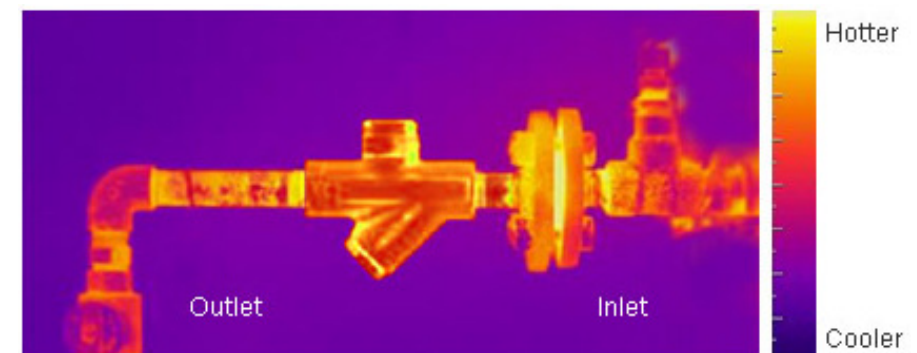

Steam Traps and Components



- Steam separator
 - Radiant heat loss from piping causes part of the steam to lose some of its latent heat and revert back to water, thereby decreasing steam dryness
 - Steam traps cannot remove moisture entrained in the steam flow
 - Wet steam not only affects heat transfer efficiency, but also causes erosion of piping and critical equipment e.g. turbine blades
 - Should take preventative measures e.g. using a steam separator to remove the entrained condensate

Steam Traps and Components



- Steam separator (cont'd)
 - Four basic separating principles/mechanisms:
 - 1. Mechanical impediment
 - 2. Flow velocity achieved
 - 3. Directional changes
 - 4. Impingement
 - Higher separation efficiency can be achieved by utilizing several of these techniques as opposed to just one
 - Separators can come in models either with or without a built-in trap

Steam Traps and Components




- Other components

- Strainers
- Automatic air vent
- Check valves
- Isolation valves
- Pressure reducing valves
- Gauges, sight glasses

- Typical steam equipment:

- Steam heated cooking vessel (jacketed)

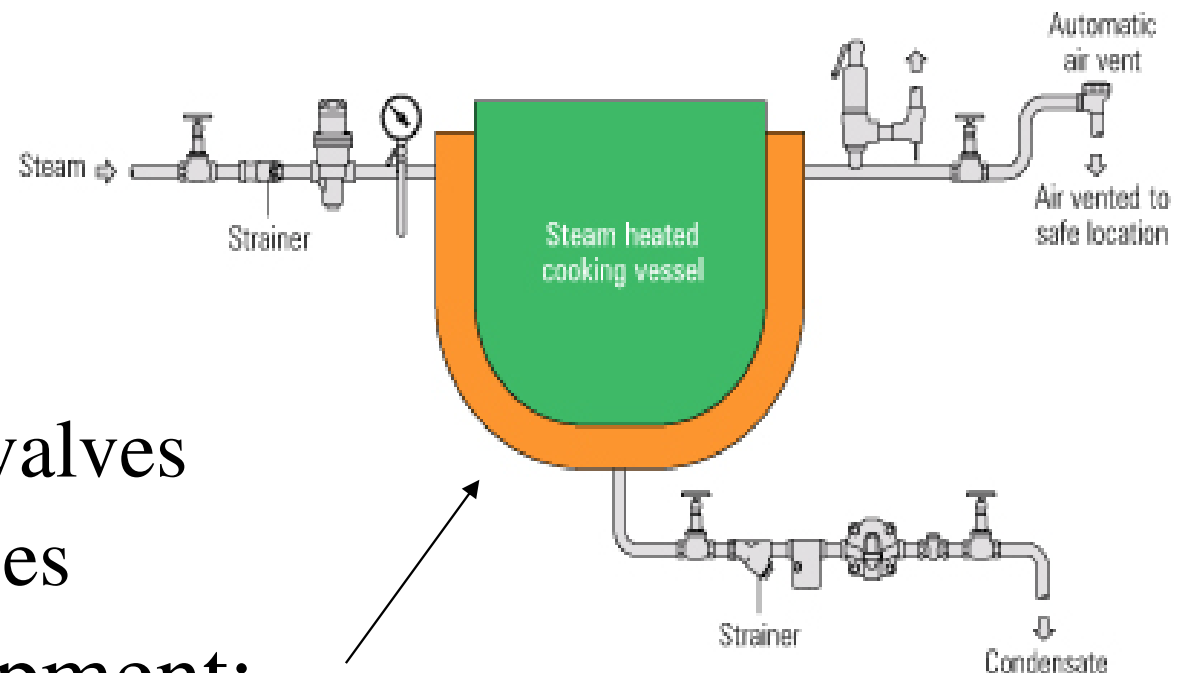


Boilers



- **Boilers** – classified according to:
 - Type of working fluid or heat carrier used
 - Such as steam and hot water
 - Physical arrangement of the working fluid
 - Fire tube: flue gas products flow through boiler tubes
 - Water tube: water circulates within boiler tubes
 - Combustion gases/fuels
 - Natural gas, town gas, diesel, etc.
 - Gas & oil replace coal for fuel of boiler/furnace
 - Easier to handle & less pollution product

Basic diagram of a boiler

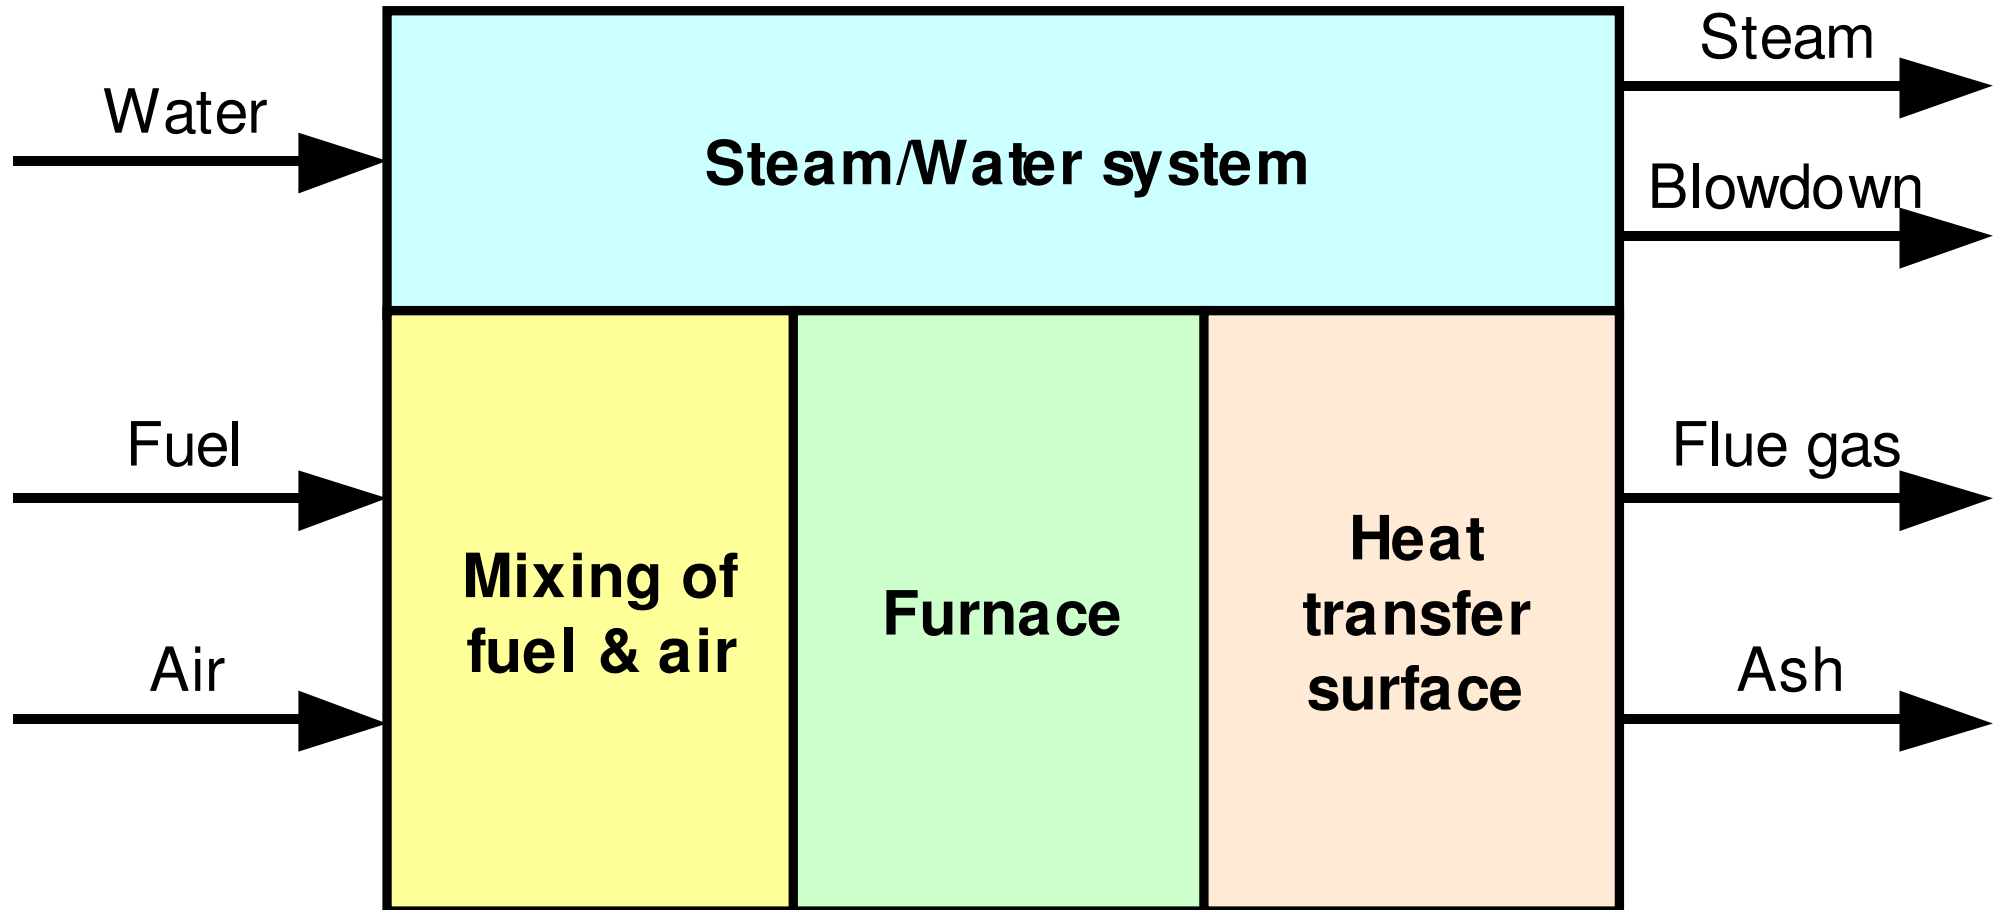

Boilers




- **Steam boilers** (high and low pressure)
 - High-pressure >100 kPa
 - Reduce size of boiler & steam piping (due to density)
 - But decrease boiler efficiency
 - Good for heat load at long distance
 - Low-pressure ≤ 100 kPa
 - Simpler in both design & operation
 - No pressure-reducing valves are required
 - Water chemical treatment less costly & complex

Boilers



- **Hot water boilers** (high and low temperature)
 - High-temperature hot water (HTHW) boiler
 - Water at temp. > 121 °C or pressure $> 1,100$ kPa
 - Carry greater heat; reduce pumping & piping costs
 - Low-temperature hot water (LTHW) boiler
 - Water at temp. < 96 °C or pressure $\leq 1,100$ kPa
- **Calorifiers**
 - Provide storage & allow heat exchange
 - Non-storage calorifiers can also be used for providing hot water for space heating

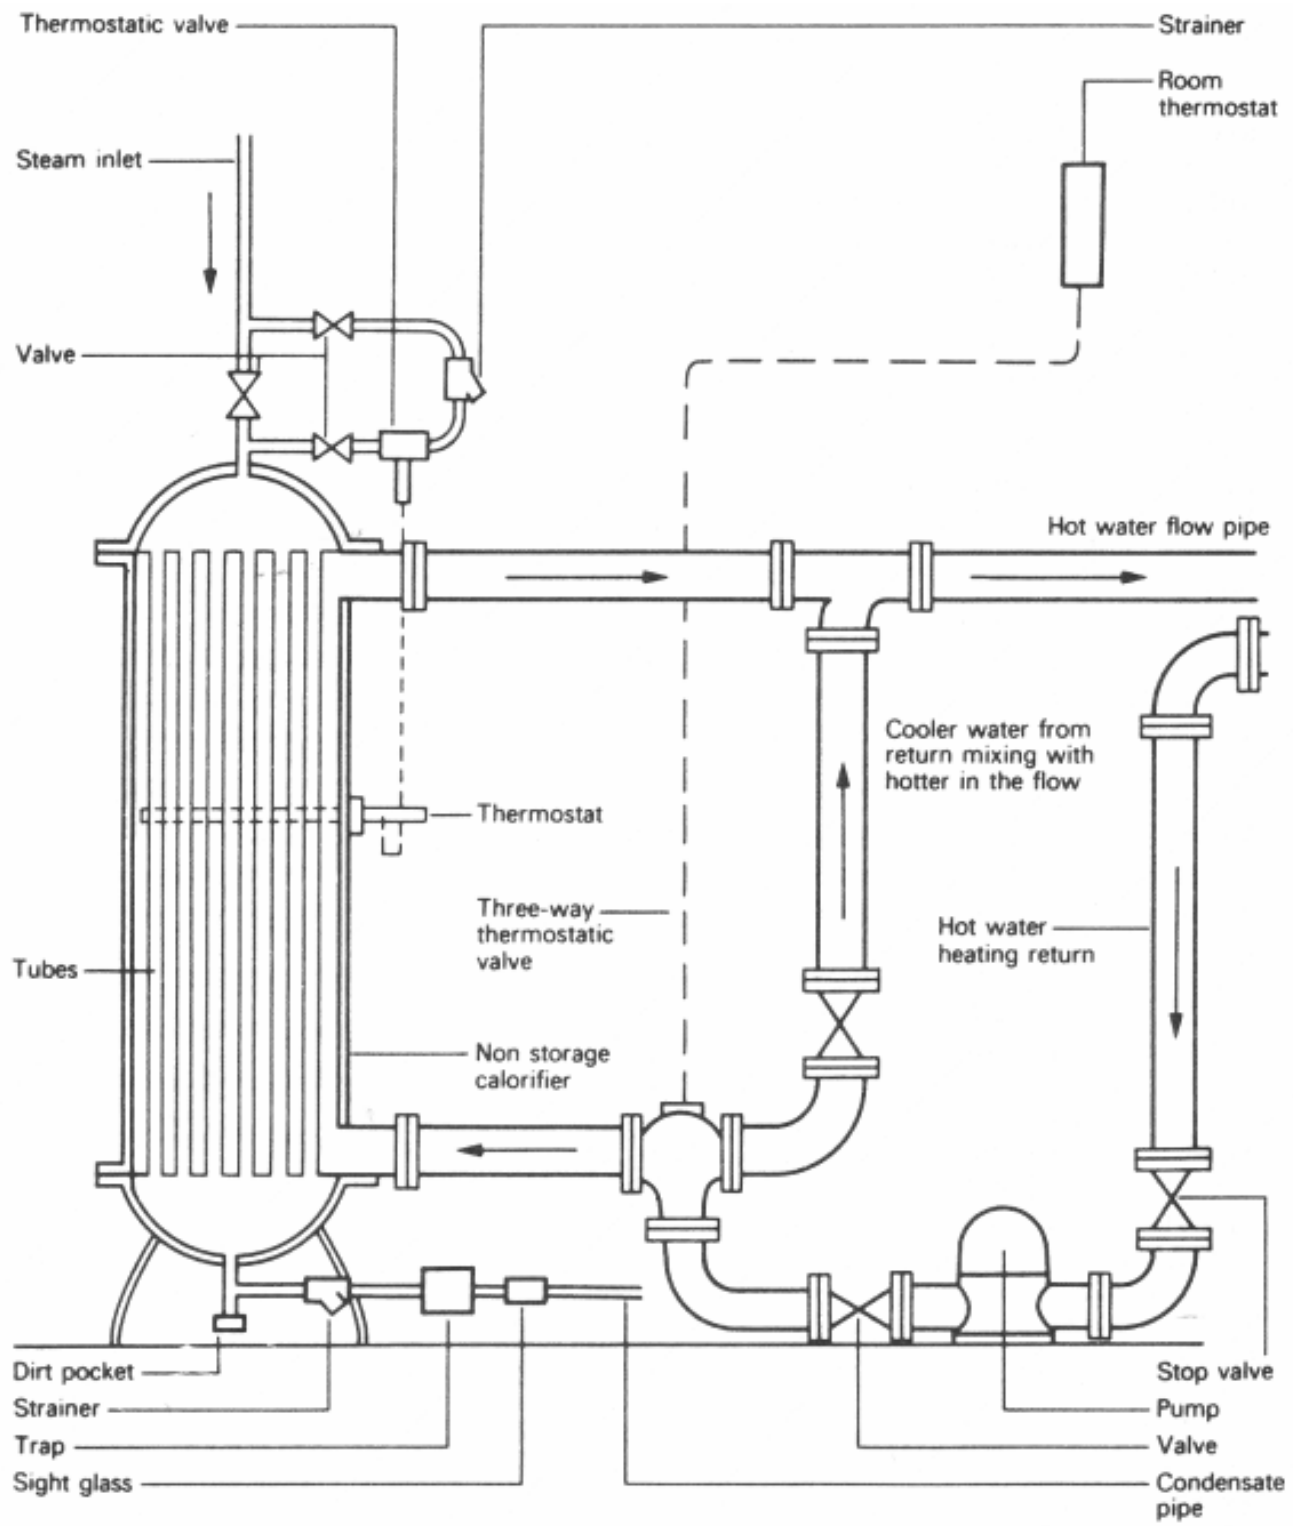

Non-storage
type calorifier

(Source: Hall, F. and Greeno, R., 2008. *Building Services Handbook*)


Boilers



- **Shell boilers**


- The heat transfer surfaces are all contained within a steel shell
- Also known as ‘fire tube’ or ‘smoke tube’ boilers
 - Products of combustion pass through the boiler tubes, which in turn transfer heat to the boiler water
- Typical types of shell boilers:
 - Lancashire boiler
 - Economic boiler (two-pass or three-pass)
 - Packaged boiler

Lancashire boiler (first developed in 1844)

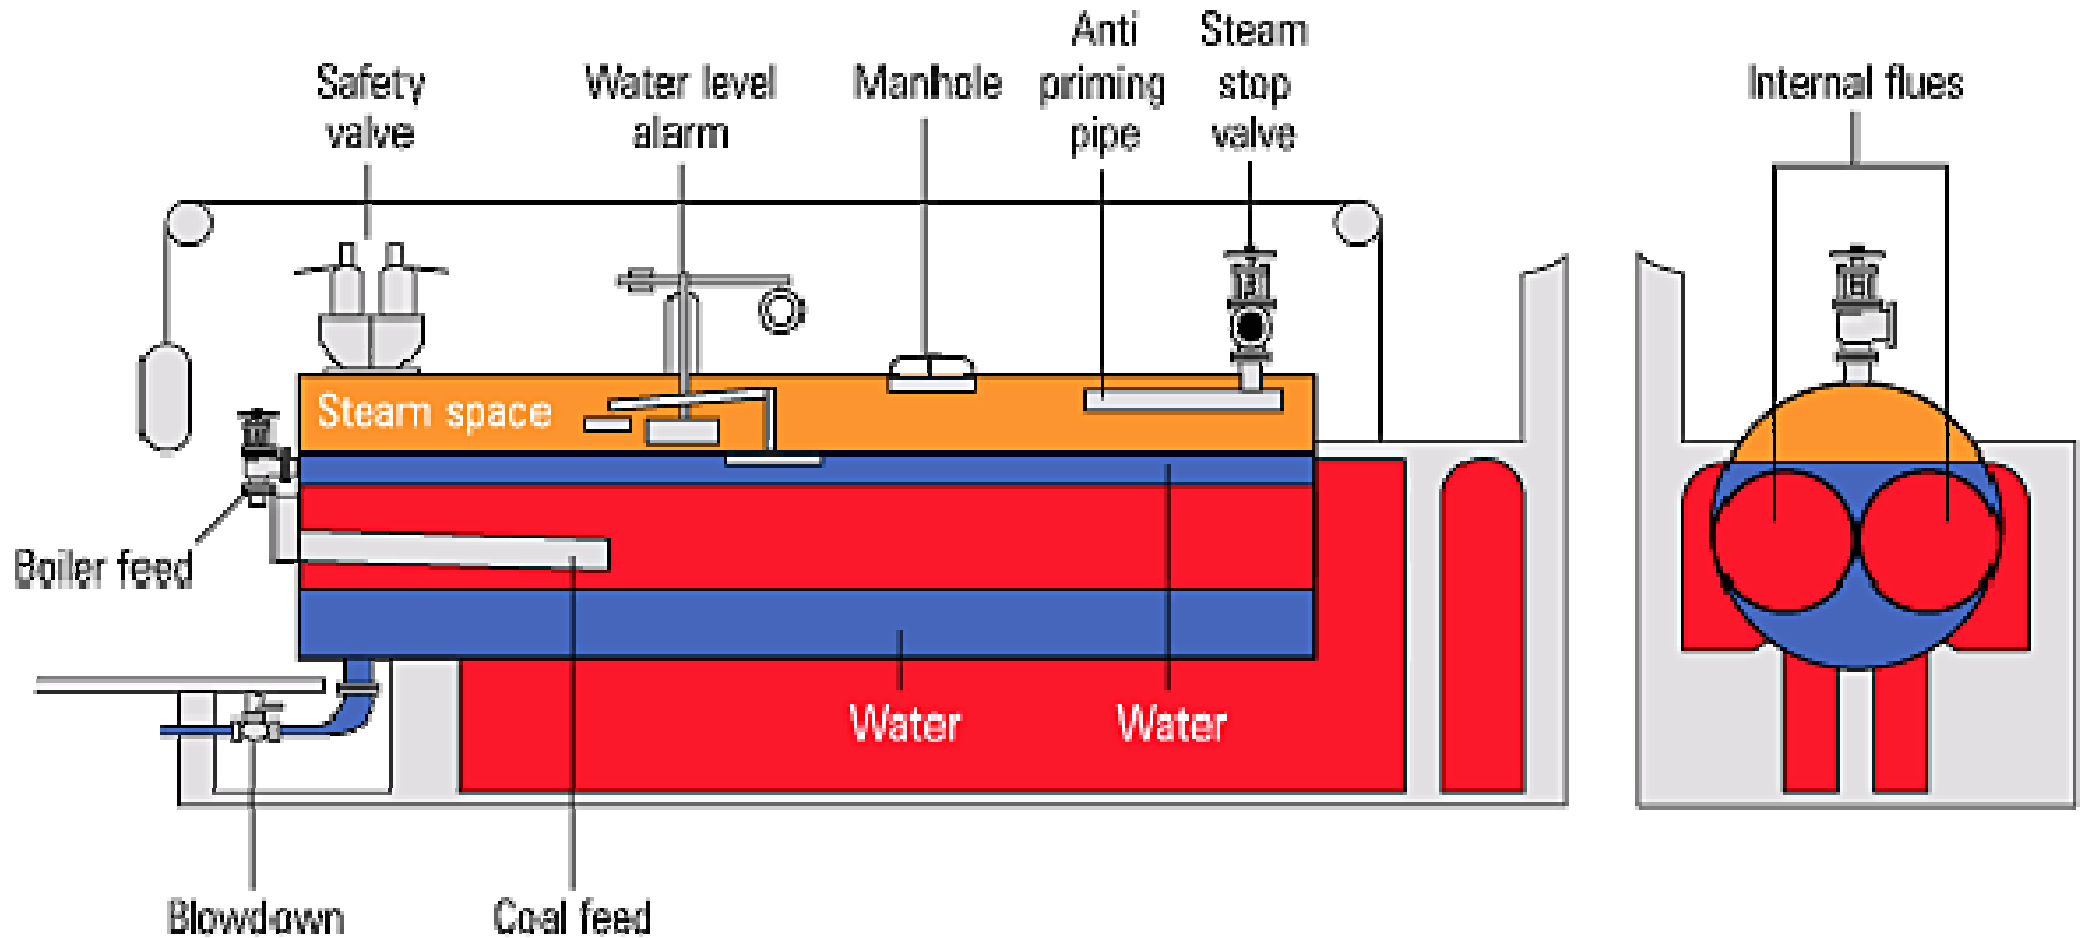

Capacity	Small	Large
Dimensions	5.5 m long x 2 m diameter	9 m long x 3 m diameter
Output	1 500 kg/h	6 500 kg/h
Pressure	Up to 12 bar g	up to 12 bar g


Economic boiler (two-pass, dry back)

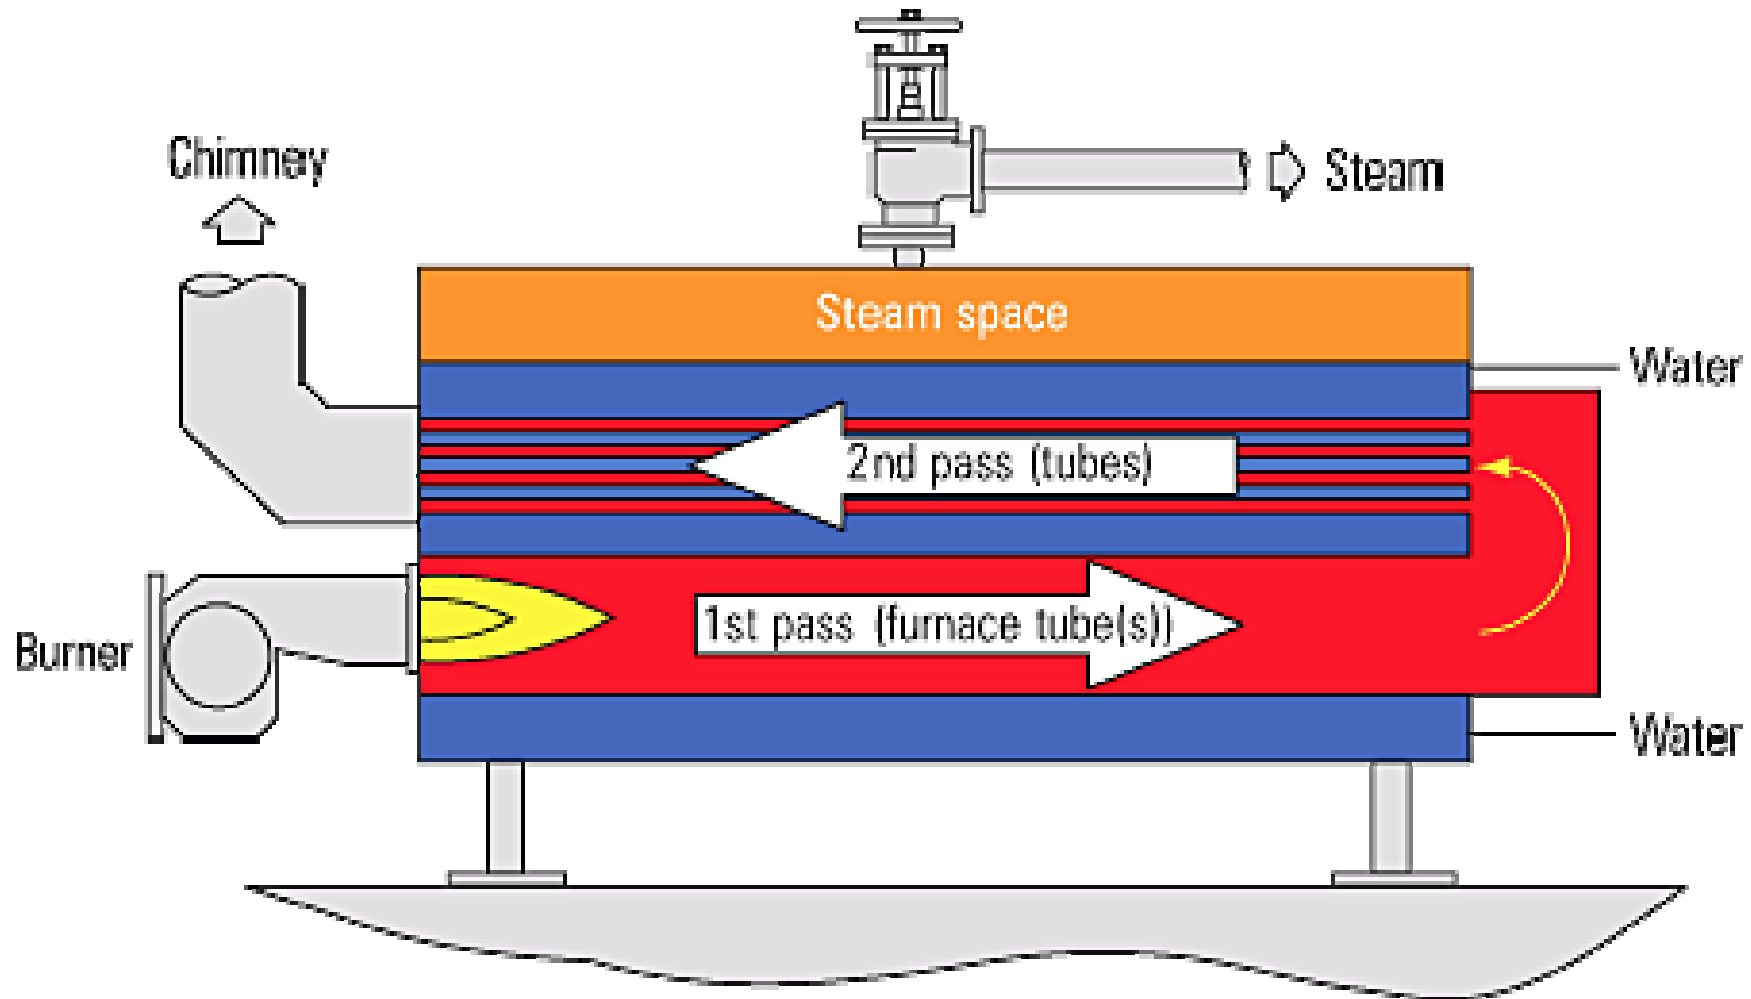

Capacity	Small	Large
Dimensions	3 m long x 1.7 m diameter	7 m long x 4 m diameter
Output	1 000 kg / h	15 000 kg / h
Pressure	Up to 17 bar g	up to 17 bar g


Economic boiler (three-pass, wet back)

Why Three Passes?

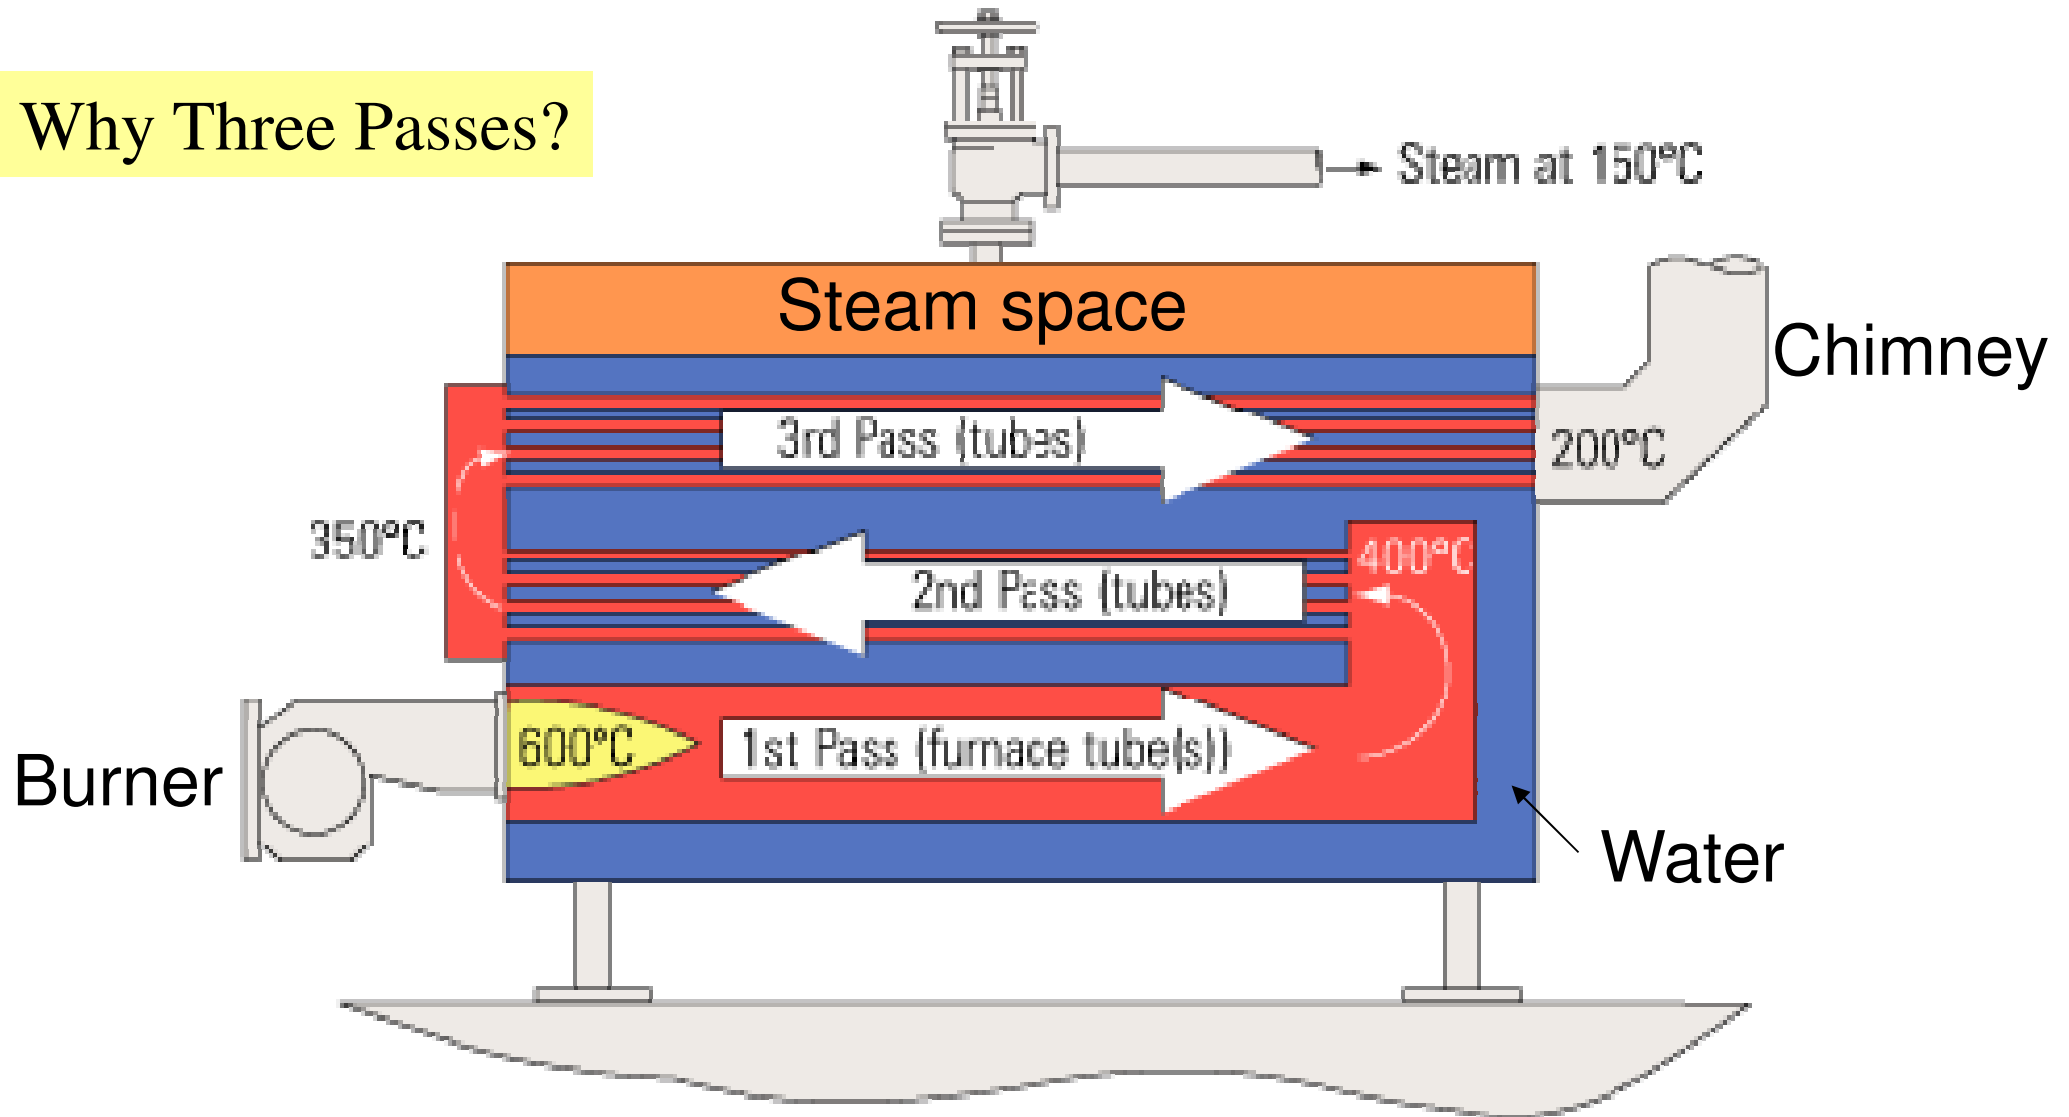

	Area of tubes	Temperature	Proportion of total heat transfer
1st pass	11 m ²	1 600°C	65%
2nd pass	43 m ²	400°C	25%
3rd pass	46 m ²	350°C	10%

Modern packaged boiler (comes as a complete package with burner, level controls, feedpump and all necessary boiler fittings and mountings)

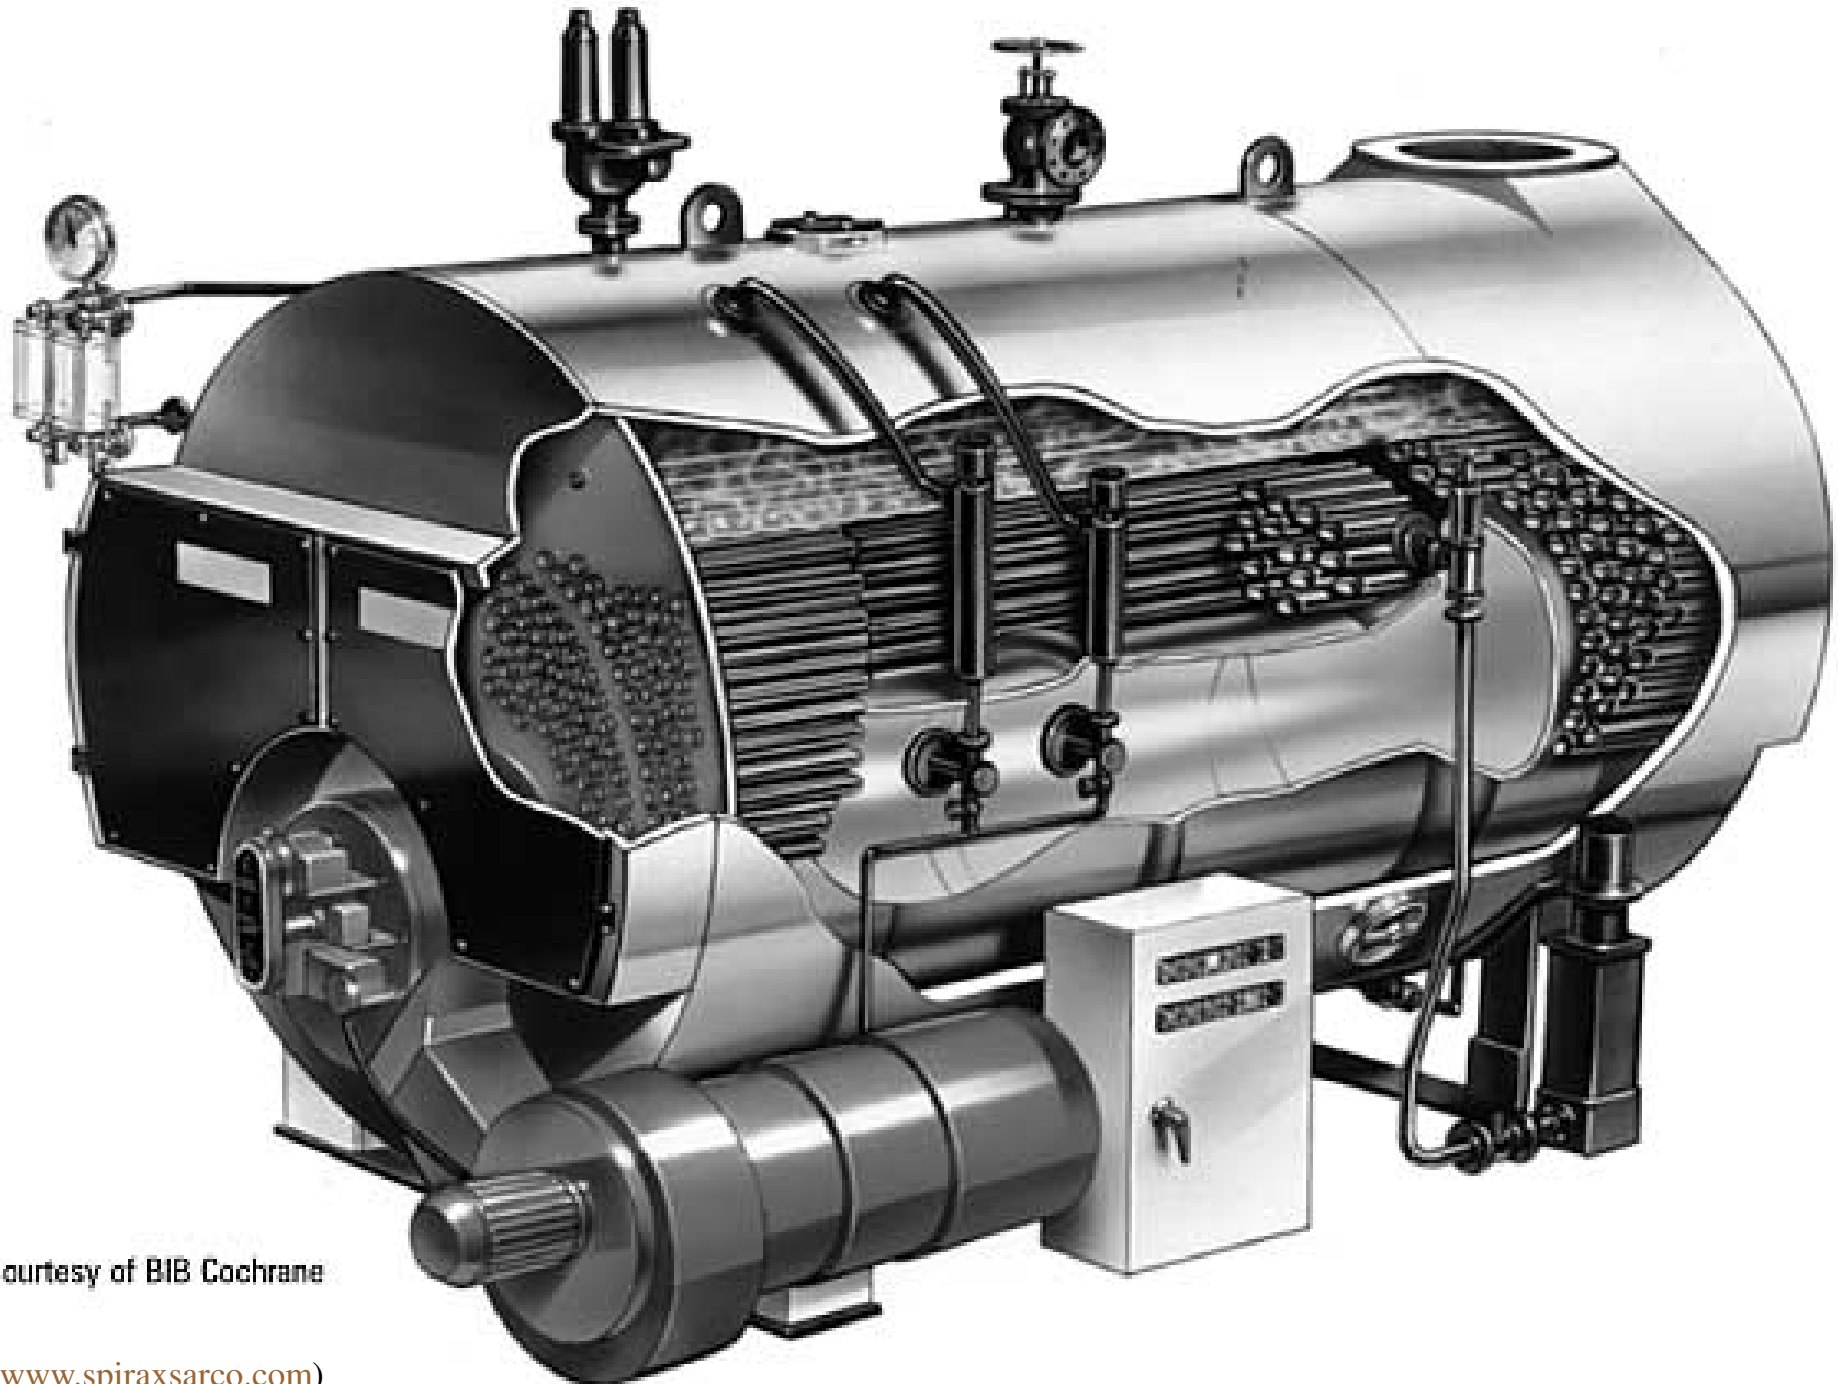


Courtesy of B&B Cochrane

(Source: www.spiraxsarco.com)

Boilers



- **Water-tube boilers**
 - The water is circulated inside the tubes, with the heat source surrounding them
 - Used in power station applications that require high pressure and high steam output
 - They are also manufactured in sizes to compete with shell boilers

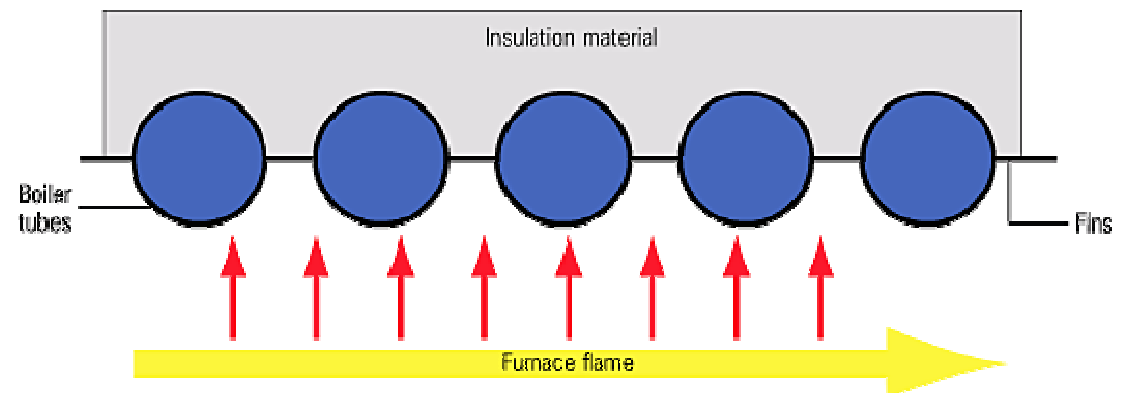

Boilers




- Three types of commonly used boiler ratings:
 - ‘From and at’ rating
 - Widely used as a datum by shell boiler manufacturers
 - Shows the amount of steam in kg/h which the boiler can create ‘from and at 100°C’, at atmospheric pressure
 - kW rating
$$\text{Steam output (kg/h)} = \text{Boiler rating (kW)} \times \frac{3600 \text{ s/h}}{\text{Energy to be added (kJ/kg)}}$$
 - To establish the actual evaporation by mass, need to know the feedwater temperature and steam pressure
 - Boiler horsepower (BoHP)
 - Used only in the USA, Australia, and New Zealand


An example of a boiler name-plate and a boiler safety valve

Serial Number	32217
Model Number	Shellbol Mk.II
Output	3,000 kg/h
Design pressure	19 bar
Maximum working pressure	18 bar
Hydraulic test pressure	28.5 bar
Date of test	26/03/91
Design standard	BS EN 12953
Class	1
Inspection authority	British Engine

**Manufactured by
Boilermakers Ltd.**

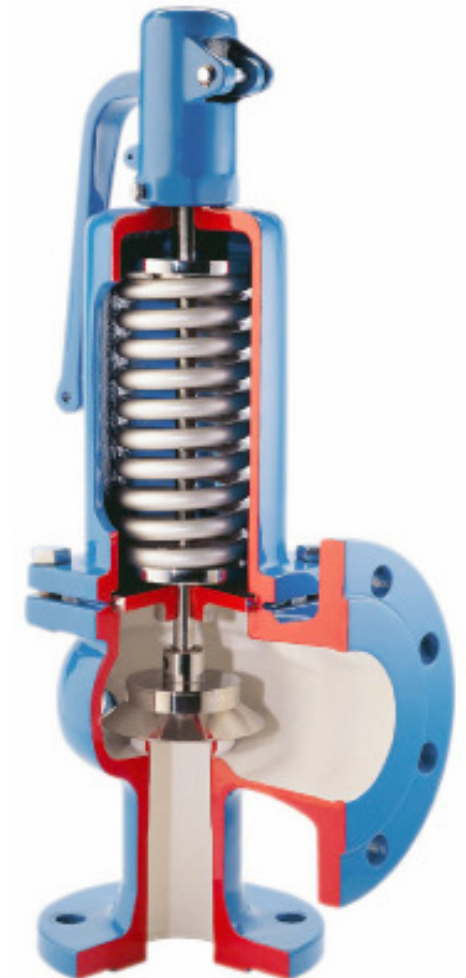

Boiler blowdown (to remove suspended solids)

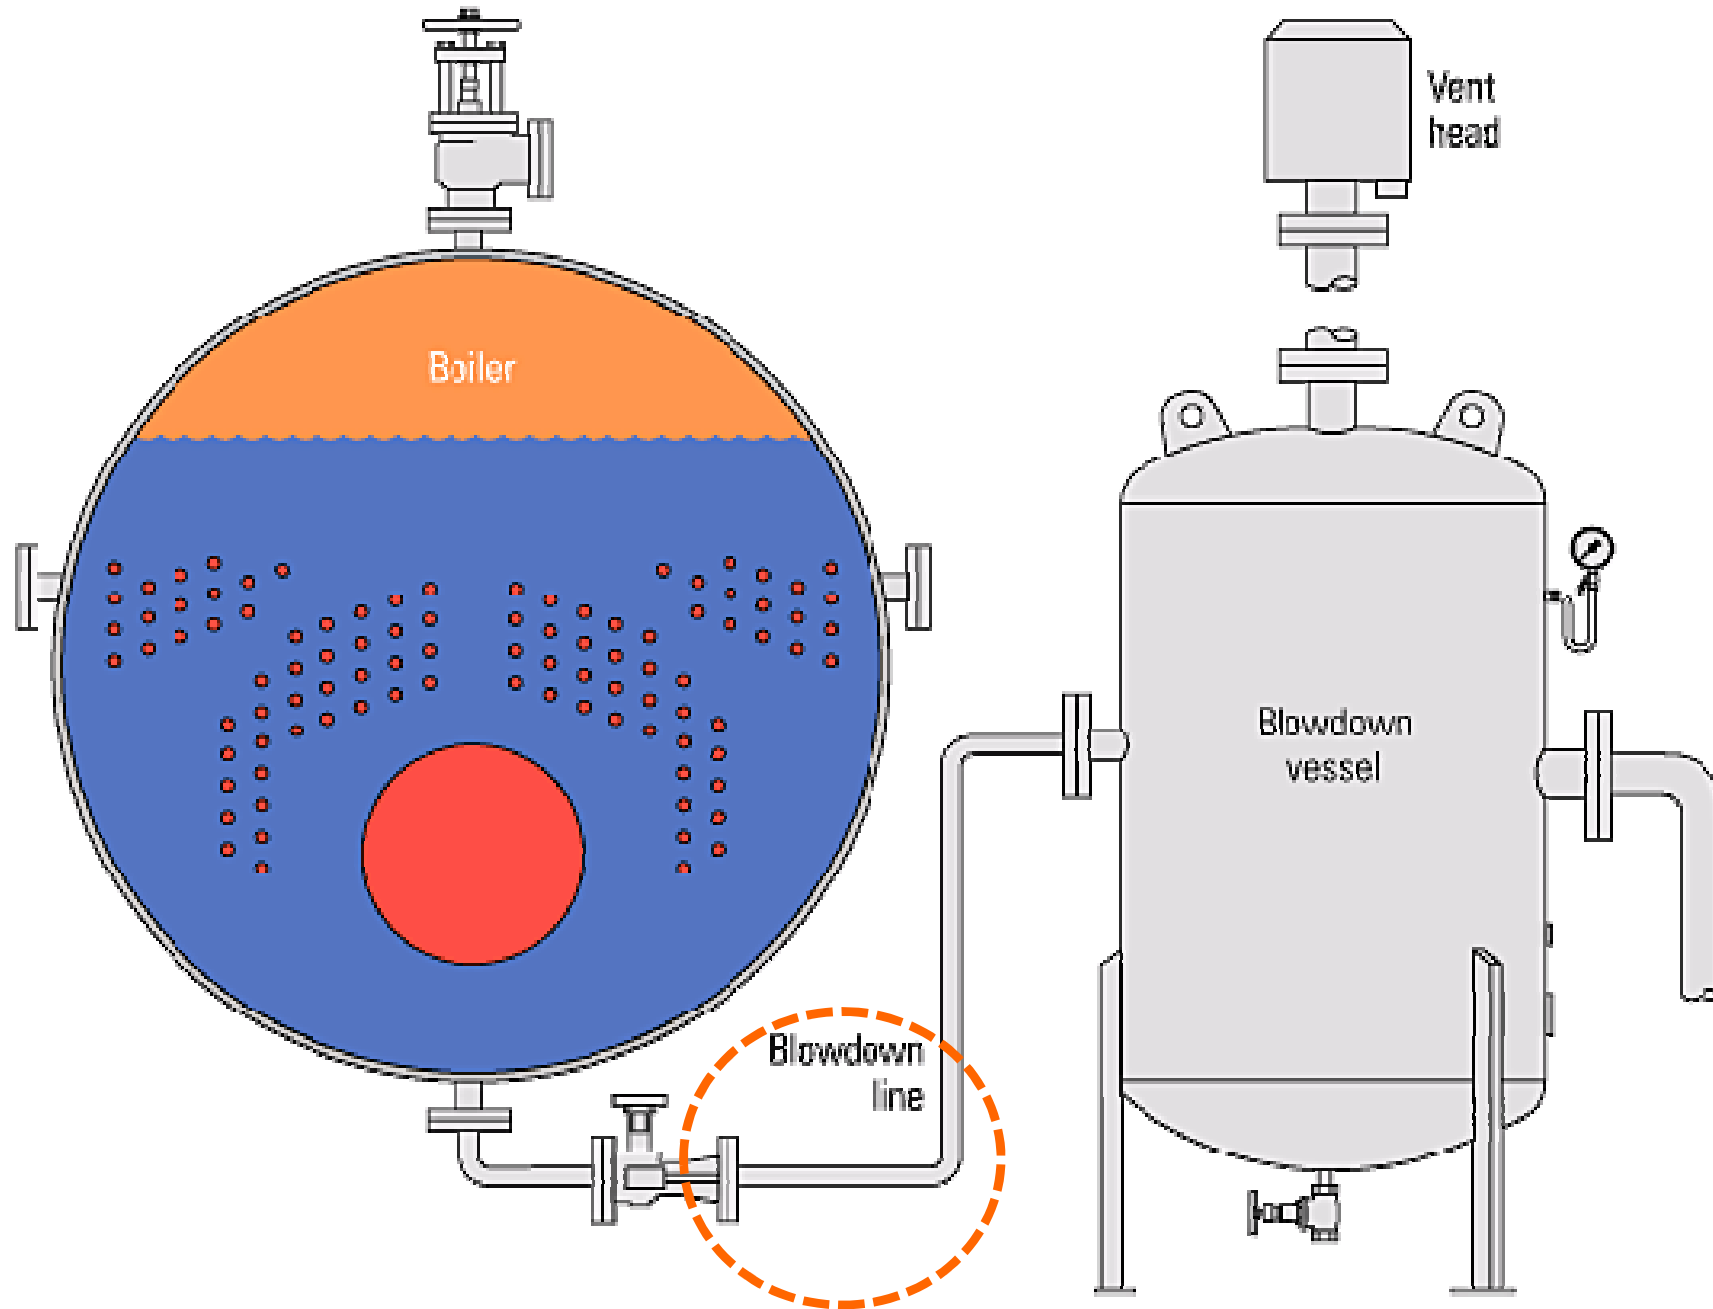





Design Considerations

- Design issues of steam-generating facility:
 - Type of application/load
 - Such as heating/cooling, process or combination
 - Operating conditions, requirements and constraints
 - Pressure, load profile & characteristics, steam quality, degree of superheat, condensate conditions
 - Facility requirements and limitations
 - Fuel type, stack gas, boiler room space, noise control
 - Codes and standards
 - Other government and local requirements

Summary of application/energy-use audit items for steam systems

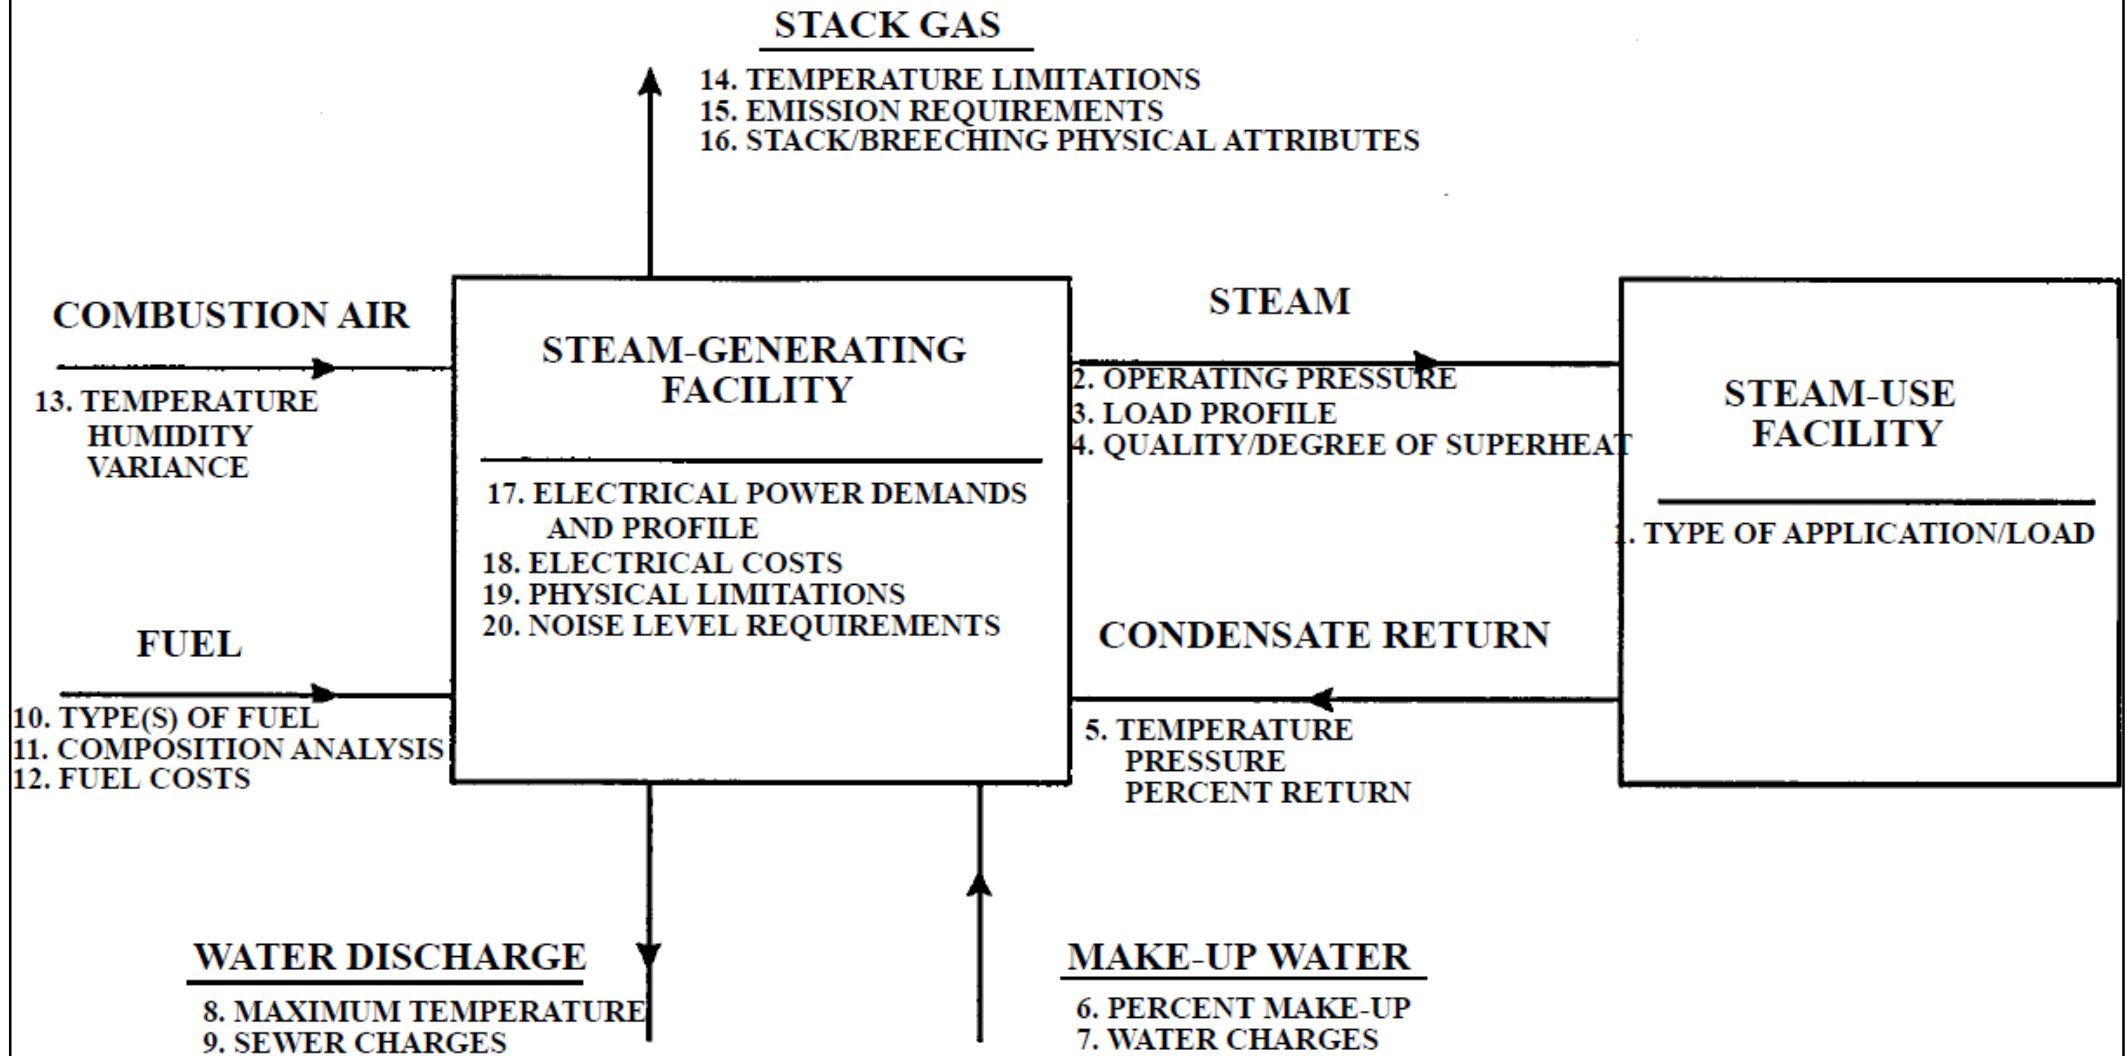

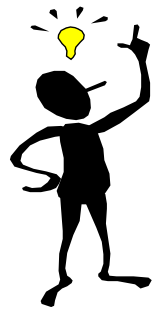

Design Considerations

- Methods of estimating steam consumption
 - To determine steam demand of the plant:
 - Calculation - By analysing the heat output on an item of plant using heat transfer equations
 - Measurement - Steam consumption may be determined by direct measurement, using flowmetering equipment
 - Thermal rating or design rating - It is often displayed on the name-plate of an individual item of plant, as provided by the manufacturers
 - For flow and non-flow applications. Including warm-up, heat losses and running load

Typical heat exchanger manufacturer's name-plate


⊕ XYZ Heat Exchanger Company ⊕			
Serial Number		HX12345	
Type and Size		AB12345	
Pressures		Design	Test
	Shell	10.0 bar g	15.0 bar g
	Tube	17.0 bar g	25.5 bar g
	NWP	14.0 bar g	
Main shell thickness		5 mm	
Date of hydraulic test		1985	
Design code - shell		BS 853	
Design code - tubes		BS 853	
Design rating		250 kW	

$$\text{Steam flowrate (kg/h)} = \frac{\text{Load in kW} \times 3\,600}{h_{fg} \text{ at operating pressure}}$$

Design Considerations



- Steam Engineering Principles and Heat Transfer
 - <http://www.spiraxsarco.com/Resources/Pages/Steam-Engineering-Tutorials/steam-engineering-principles-and-heat-transfer.aspx>
 - 6. Methods of Estimating Steam Consumption
 - 9. Energy consumption of tanks and vats
 - 10. Heating with coils and jackets
 - 11. Heating vats and tanks by steam injection
 - 12. Steam Consumption of Pipes and Air Heaters
 - 13. Steam Consumption of Heat Exchangers
 - 14. Steam Consumption of Plant Items

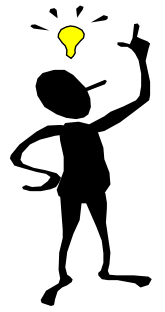


Design Considerations

- Efficient steam distribution system:
 - Steam of the right quality and pressure is to be supplied, in the right quantity, to the steam using equipment
- Major issues of steam system design
 - Sufficient pressure difference
 - Pipeline velocity
 - Condensate return
 - Safety issues
 - Testing & commissioning
 - Operation & maintenance



Design Considerations

- Steam pipe sizing
 - Info. required:
 - Initial or final steam pressure, temperature & quality
 - Steam flow rate
 - Length of the pipe
 - Permissible pressure drop
 - Permissible velocity of flow
 - The pipe size may be selected on the basis of:
 - Velocity (usually pipes less than 50 m in length)
 - Pressure drop (should not normally exceed 0.1 bar/50 m)

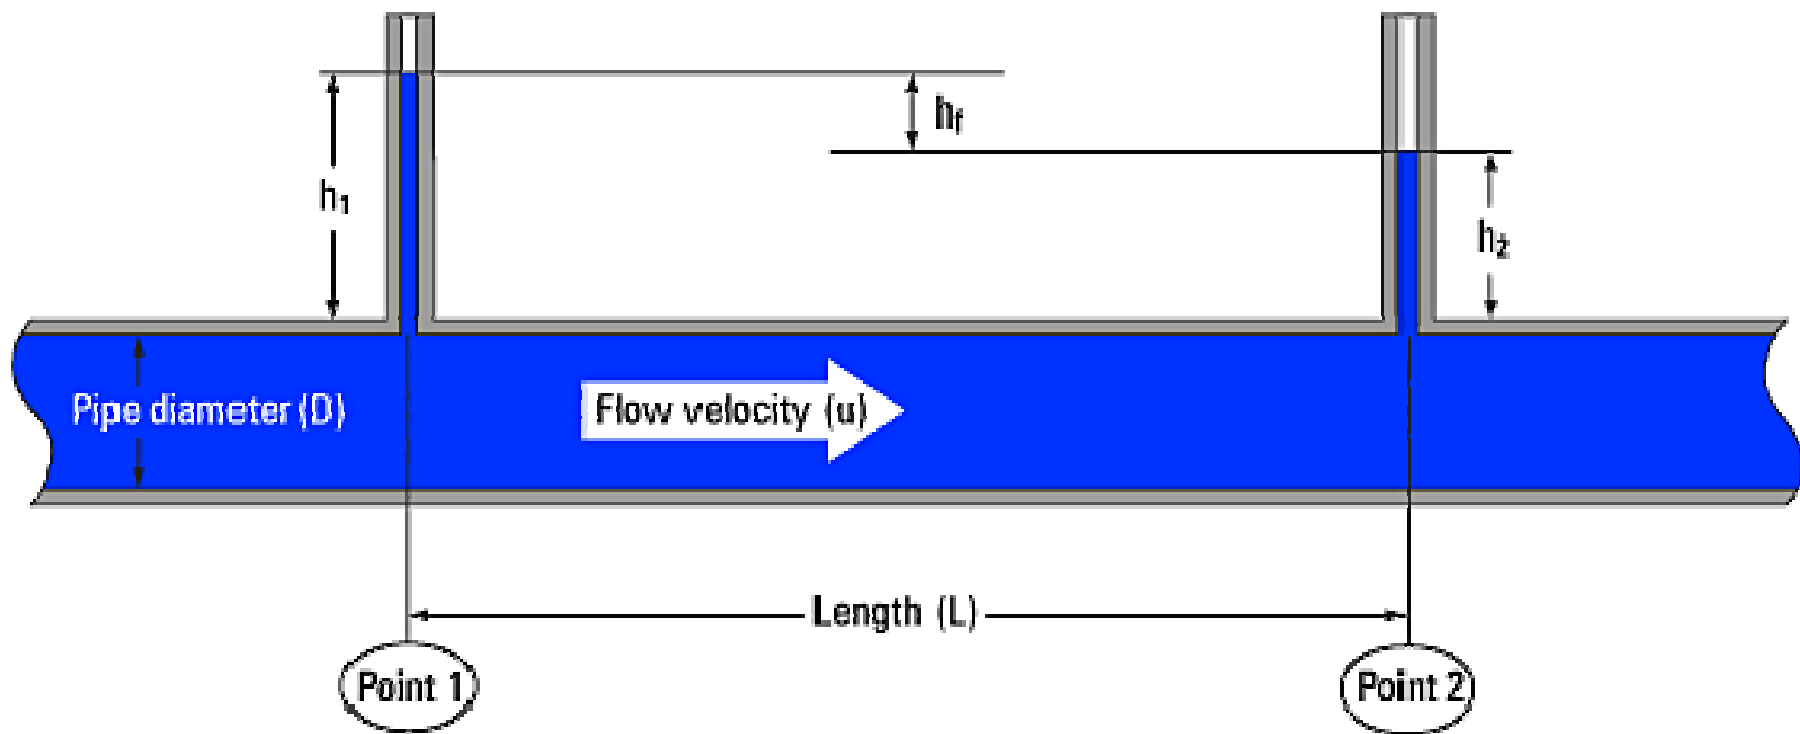

D'Arcy equation:
$$h_f = \frac{f \cdot L \cdot u^2}{2 \cdot g \cdot D}$$

where h_f = head loss to friction (m)

f = friction factor (dimensionless)

L = length (m)

u = flow velocity (m/s)

g = gravitational constant (9.81 m/s^2)

D = pipe diameter (m)




Design Considerations

- Steam pipe sizing (cont'd)
 - Friction factor can be difficult to determine, especially for turbulent steam flow. As a result, some graphs, tables and slide rules are produced to relate steam pipe sizes to flowrates and pressure drops, e.g. the “pressure factor” method:
 - $F = (P_1 - P_2) / L$
 - F = pressure factor
 - P_1 = factor based on the inlet pressure
 - P_2 = factor based on the pressure at a distance of L metres
 - L = equivalent length of pipe (m)

Design Considerations




- Permissible pressure drop & flow velocity are affected by several factors:
 - Relative direction of steam & condensate flow within the same pipe
 - Whether the pipe is vertical, horizontal or sloping down in the direction of steam flow or against it
 - Steam quality & erosive action of wet steam on valve seats
 - Possibility of carry-over of water droplets from boiler steam spaces & flash steam vessels
 - Permissible noise level

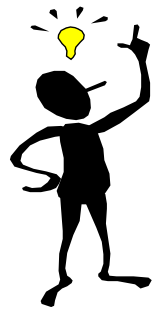


Design Considerations

- Best practices for condensate removal on steam lines
 - 1. Choose trap locations carefully
 - 2. Provide proper support & inclined steam piping
 - 3. Pay attention to drip leg (drain pocket) configuration
 - 4. Properly remove air and condensate at end of steam line

Typical steam main & branch line installation

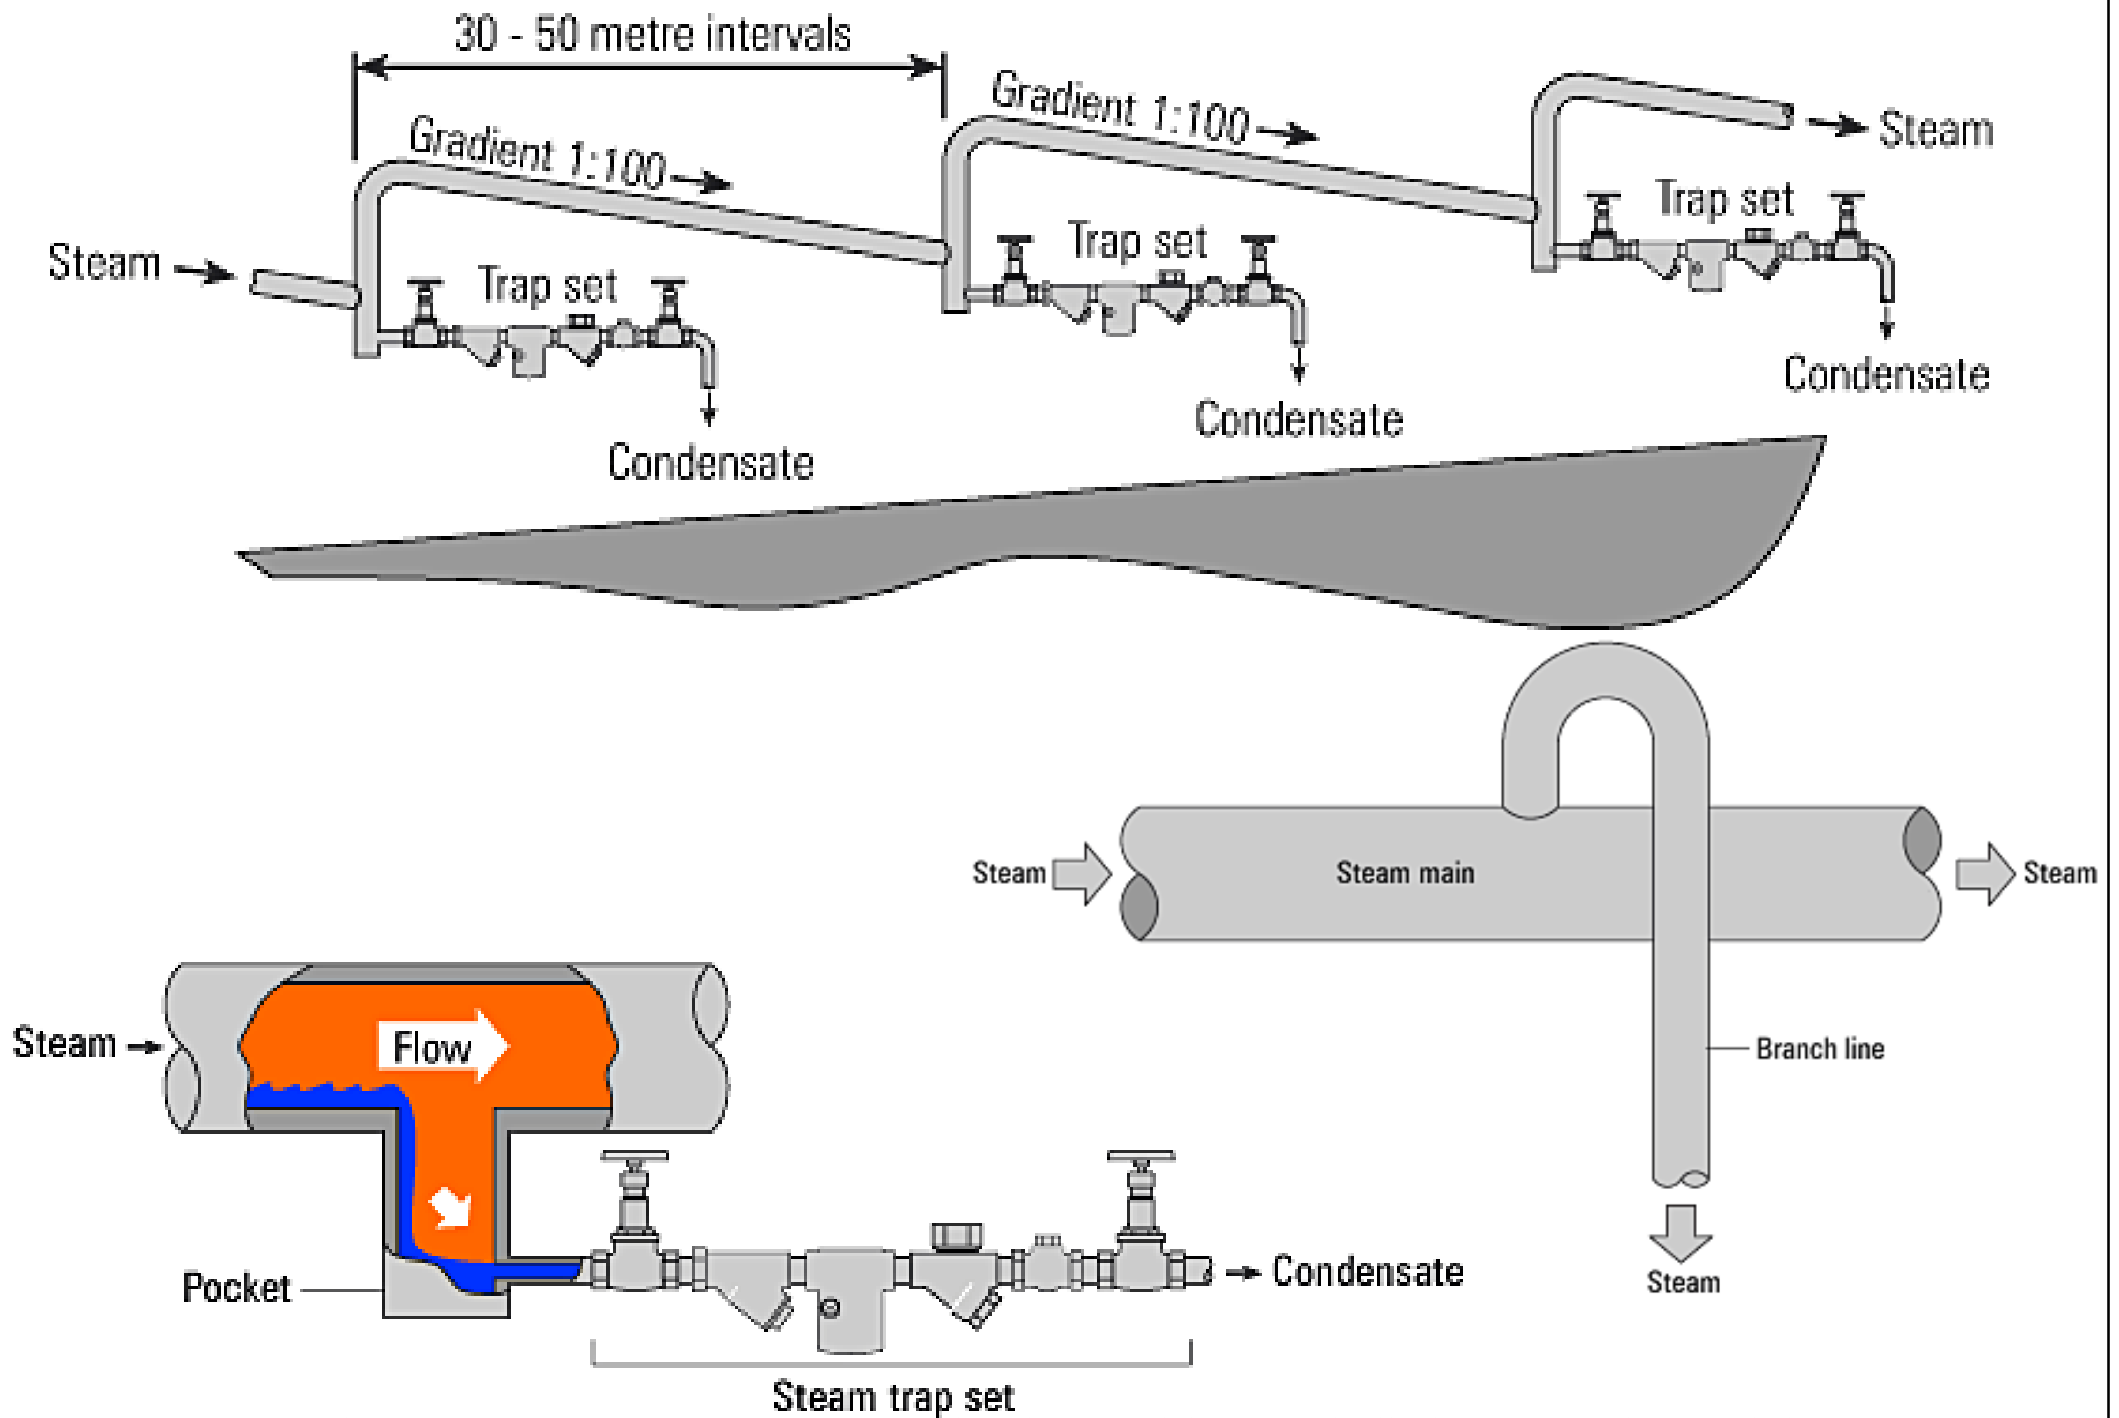


Installation tips for steam traps on steam mains

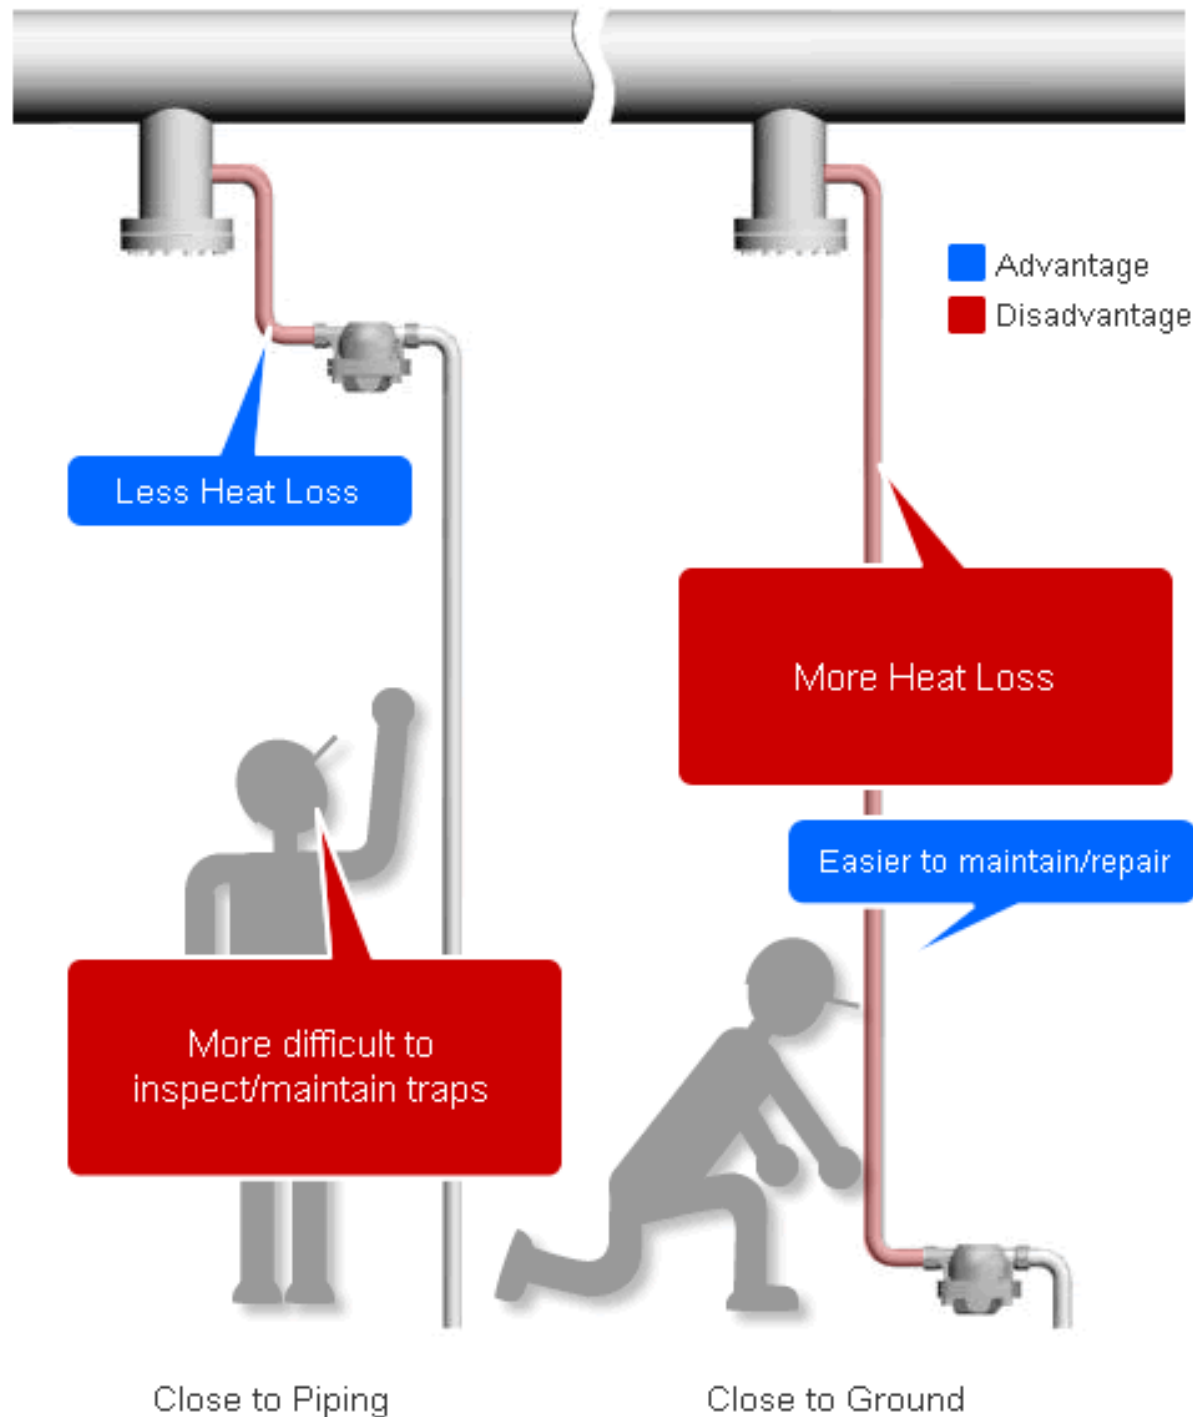

Close to Piping

Close to Ground

Installation tips for steam traps on steam mains (cont'd)

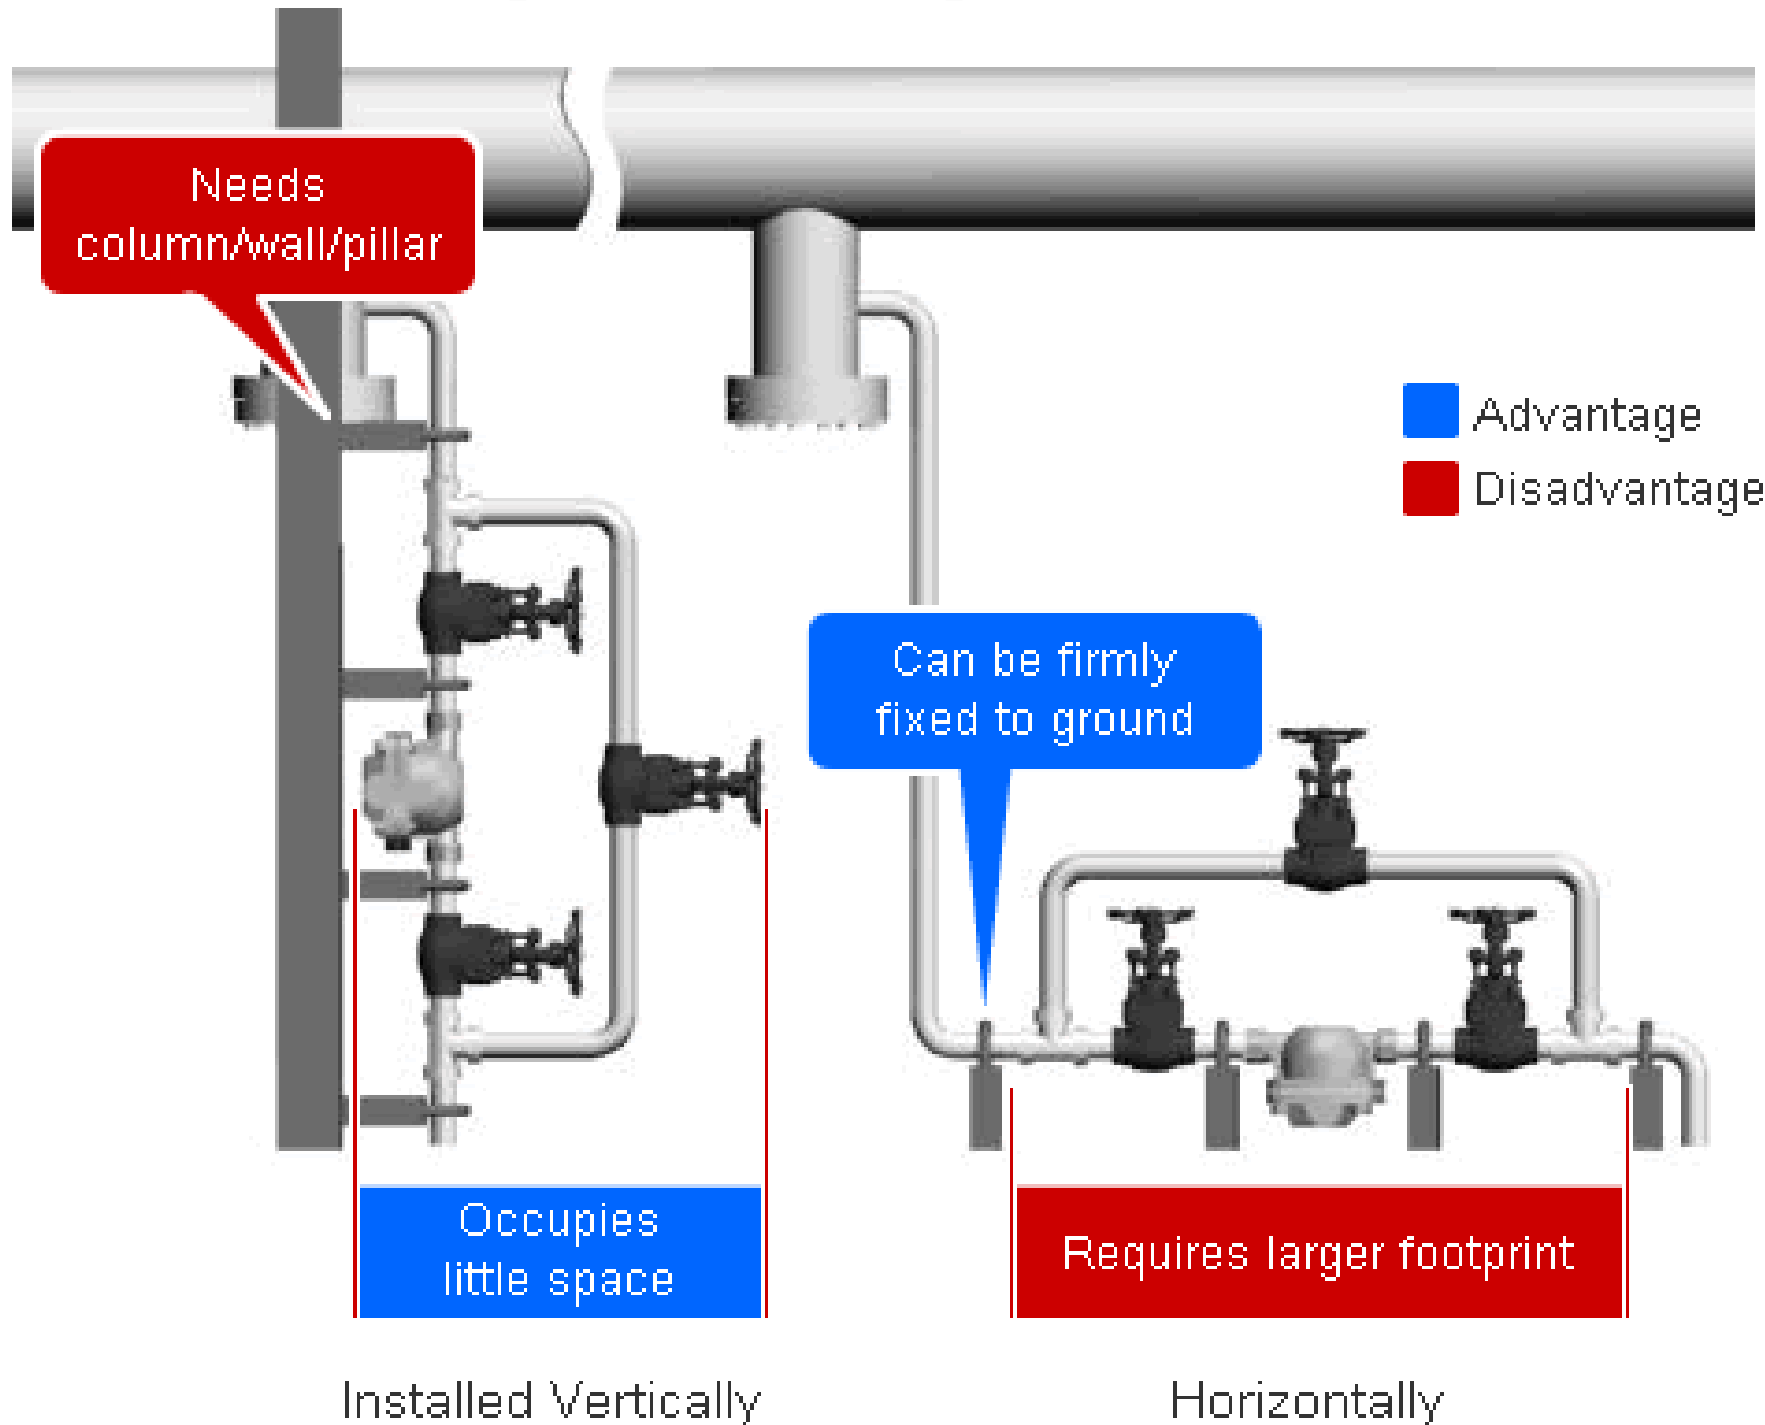

Installed Vertically


Horizontally




Design Considerations

- Installation of steam and condensate pipes
 - Analyse most economic thickness for pipe thermal insulation
 - Expansion joints or loops to relieve stresses due to expansion and contraction
 - Provided with a fall of about 1 in 300
 - Provided with drainage outlet at low points


Pipe expansion and support

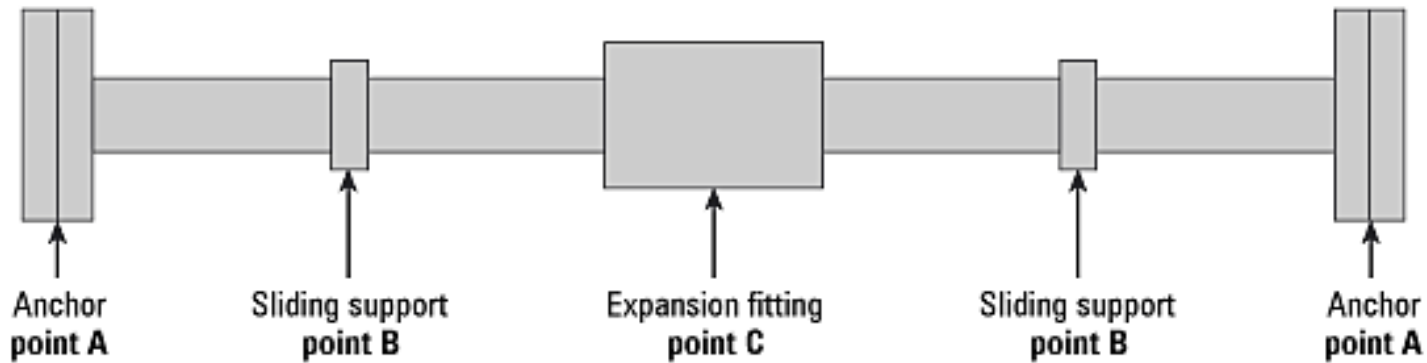


Pipeline with fixed point, variable anchor point and expansion fitting

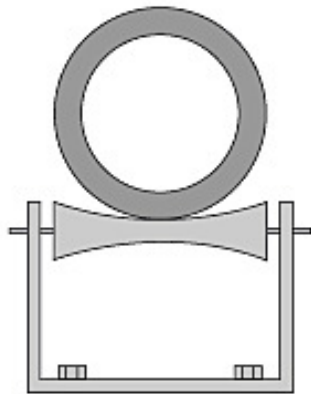

Chair and roller

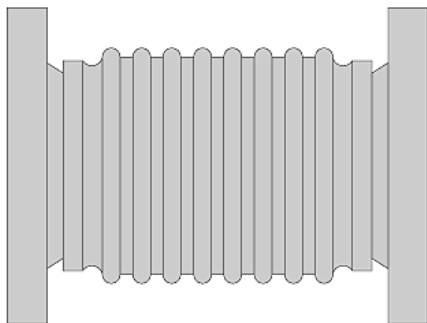

Expansion bellow

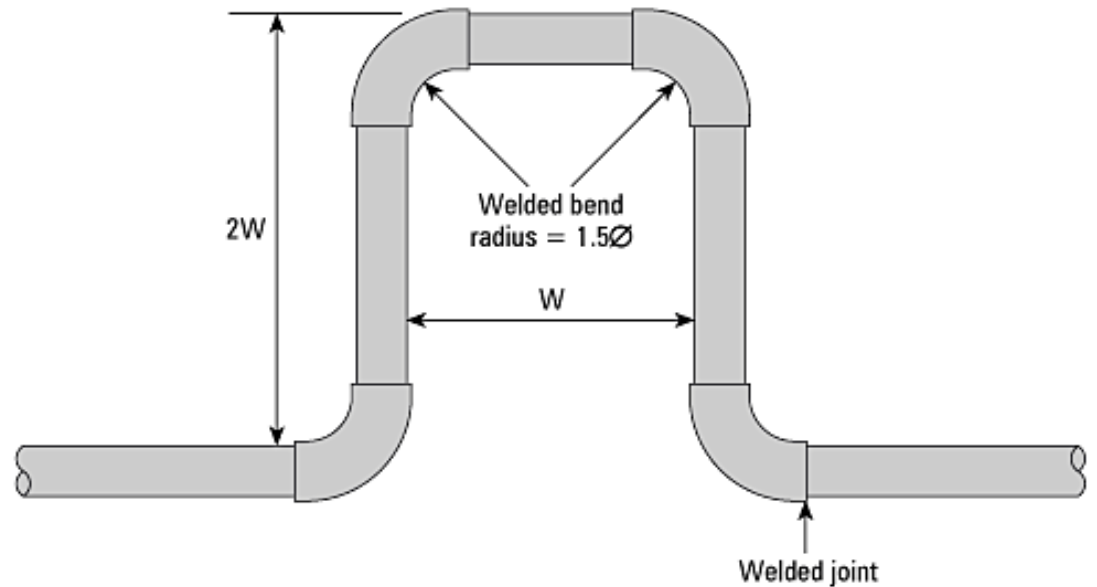

Expansion loop



Design Considerations

- Erosion and corrosion in the piping
 - Erosion -- gradual wearing away of a solid through abrasion
 - Physical degradation of a material due to the flow of water, wind, or debris; e.g. caused by liquid droplet impingement or high velocity dis-entrained condensate
 - <http://www.tlv.com/global/AU/steam-theory/piping-erosion.html>
 - Corrosion -- degradation of a material caused by chemical reactions
 - <http://www.tlv.com/global/AU/steam-theory/corrosion.html>

Examples of corroded pipes



Design Considerations




- Safety precautions [c.f. water heater at home]
 - 4 possible arrangements for burner safety control
 - Automatic recycling
 - Automatic non-recycling
 - Manual
 - Supervised manual
 - Purge and startup
 - Flame failure protection
 - Water level alarms and cut-off
 - Interlocks



Design Considerations

- Regulations in Hong Kong
 - Boilers and Pressure Vessels Ordinance (Cap 56)
 - Enforced by Boilers & Pressure Vessels Division, Labour Department
 - Relevant guide books and codes of practices
 - See Web Links
 - Accident cases of boilers and pressure vessels in Hong Kong
 - See reference book from Labour Department


Accidents did happen in HK before !

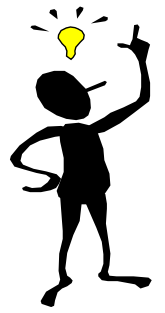

Design Considerations

- Regulations in Hong Kong (cont'd)
 - Basic requirements
 - Engage an “Appointed Examiner”
 - Engrave registration number on boiler/pressure vessel
 - Acquire a “Certificate of Fitness”
 - Employ a qualified person with “Certificate of Competency” to operate the boiler / steam receiver
 - Notify the Authority of any accidents and defects
 - Notify the Authority of sale or hiring of boiler/pressure vessel


Condensate Recovery

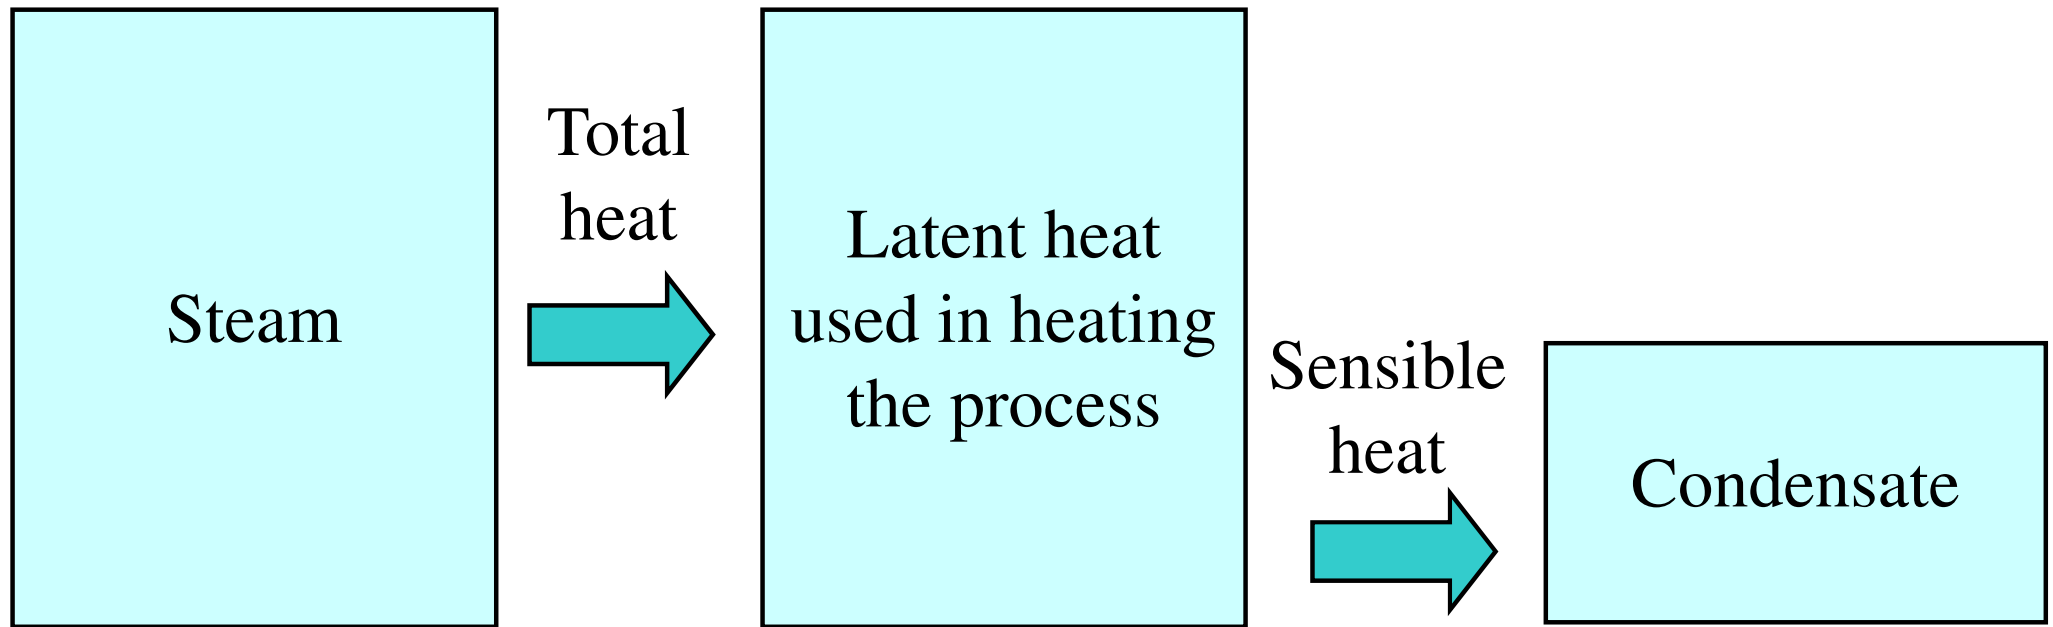

After giving up its latent heat to heat the process, steam turns to water containing only sensible heat




Condensate Recovery

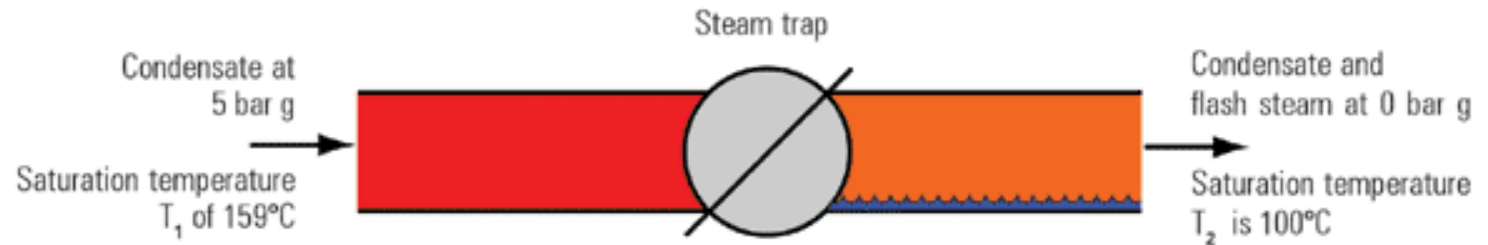

- Flash steam

- Formed when high pressure condensate is discharged to a lower pressure (“flash evaporation”) (same as live steam)
- Should be collected and led to a flash vessel (for reuse)
- Other important issues:
 - Suitable collecting legs or reservoirs for condensate
 - Minimum pressure differential across the steam trap
 - Choice of steam trap type and size
 - Proper trap installation

Example: Calculate the amount of flash steam from condensate.

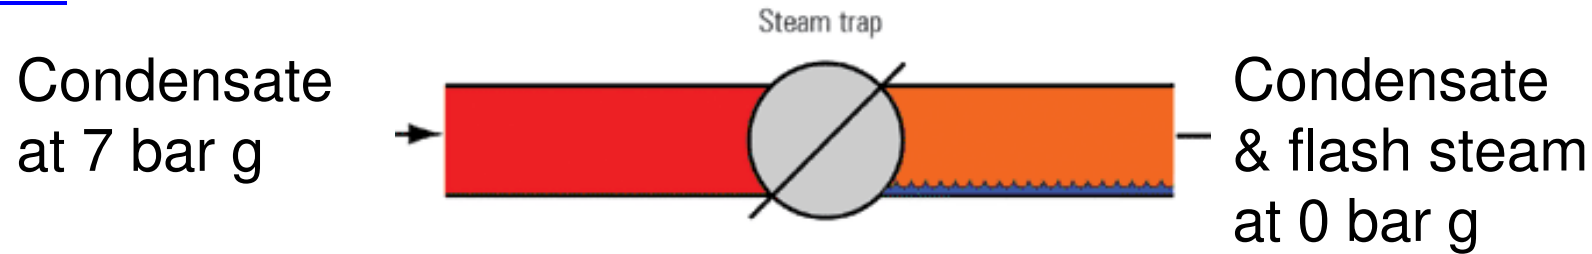

Hot condensate at 7 bar g has a heat content of 721 kJ/kg. When it is released to atmospheric pressure (0 bar g), each kilogram of water can only retain 419 kJ of heat.

The excess energy in each kg of the condensate is $721 - 419 = 302$ kJ
This excess energy is available to evaporate some of the condensate into steam.

If the enthalpy of evaporation at atmospheric pressure is 2258 kJ/kg, then the percentage of flash steam evaporated is $= 302 / 2258 \times 100\%$

Thus, flash steam evaporated = **13.4%**

(can be reused by flash steam recovery systems)

(See also: Engineering Calculator -- Flash Steam Generated by Hot Condensate

<http://www.tlv.com/global/AU/calculator/flash-steam-generation.html>)



Condensate Recovery


- **Condensate** can be reused in many different ways, for example:
 - As heated feedwater, by sending hot condensate back to the boiler's deaerator
 - As pre-heat, for any applicable heating system
 - As steam, by reusing flash steam
 - As hot water, for cleaning equipment or other cleaning applications
- **Condensate Recovery vs. No Recovery**




Condensate Recovery

- Importance of condensate recovery
 - Returned to the boiler for reuse as feed-water
 - Can increase heat efficiency of the cycle
 - Can reduce make-up water charges
 - Can reduce effluent charges and possible cooling costs
 - Can keep water-treatment problems to a minimum
 - Can reduce boiler blowdown (less energy is lost)
 - Start-up load: initial warm up of components
 - Highest steam consumption
 - Running load: fairly stable condition

A simple steam system with condensate returning to the boiler feedtank

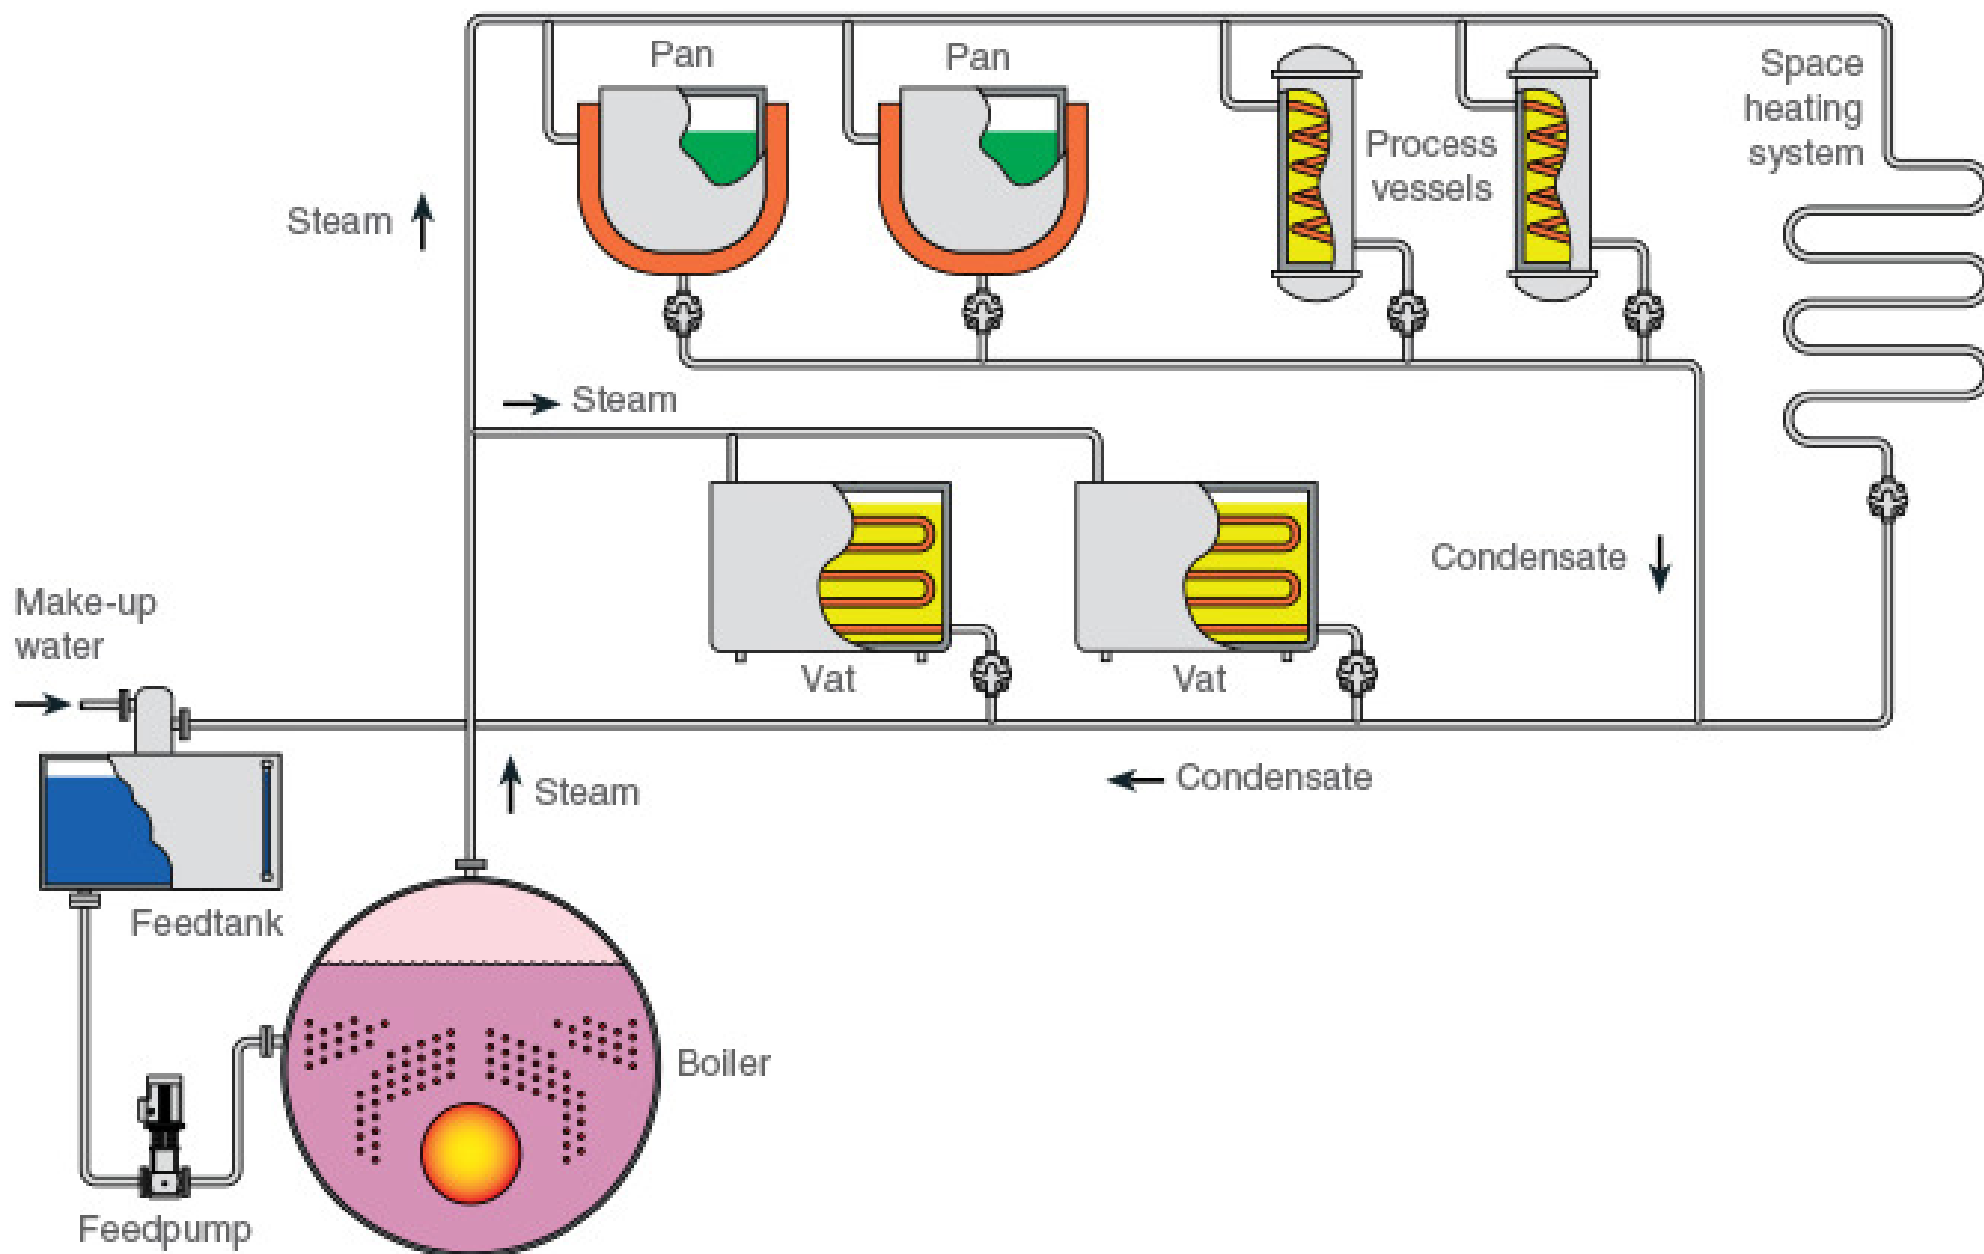


Four basic types of condensate piping and their considerations

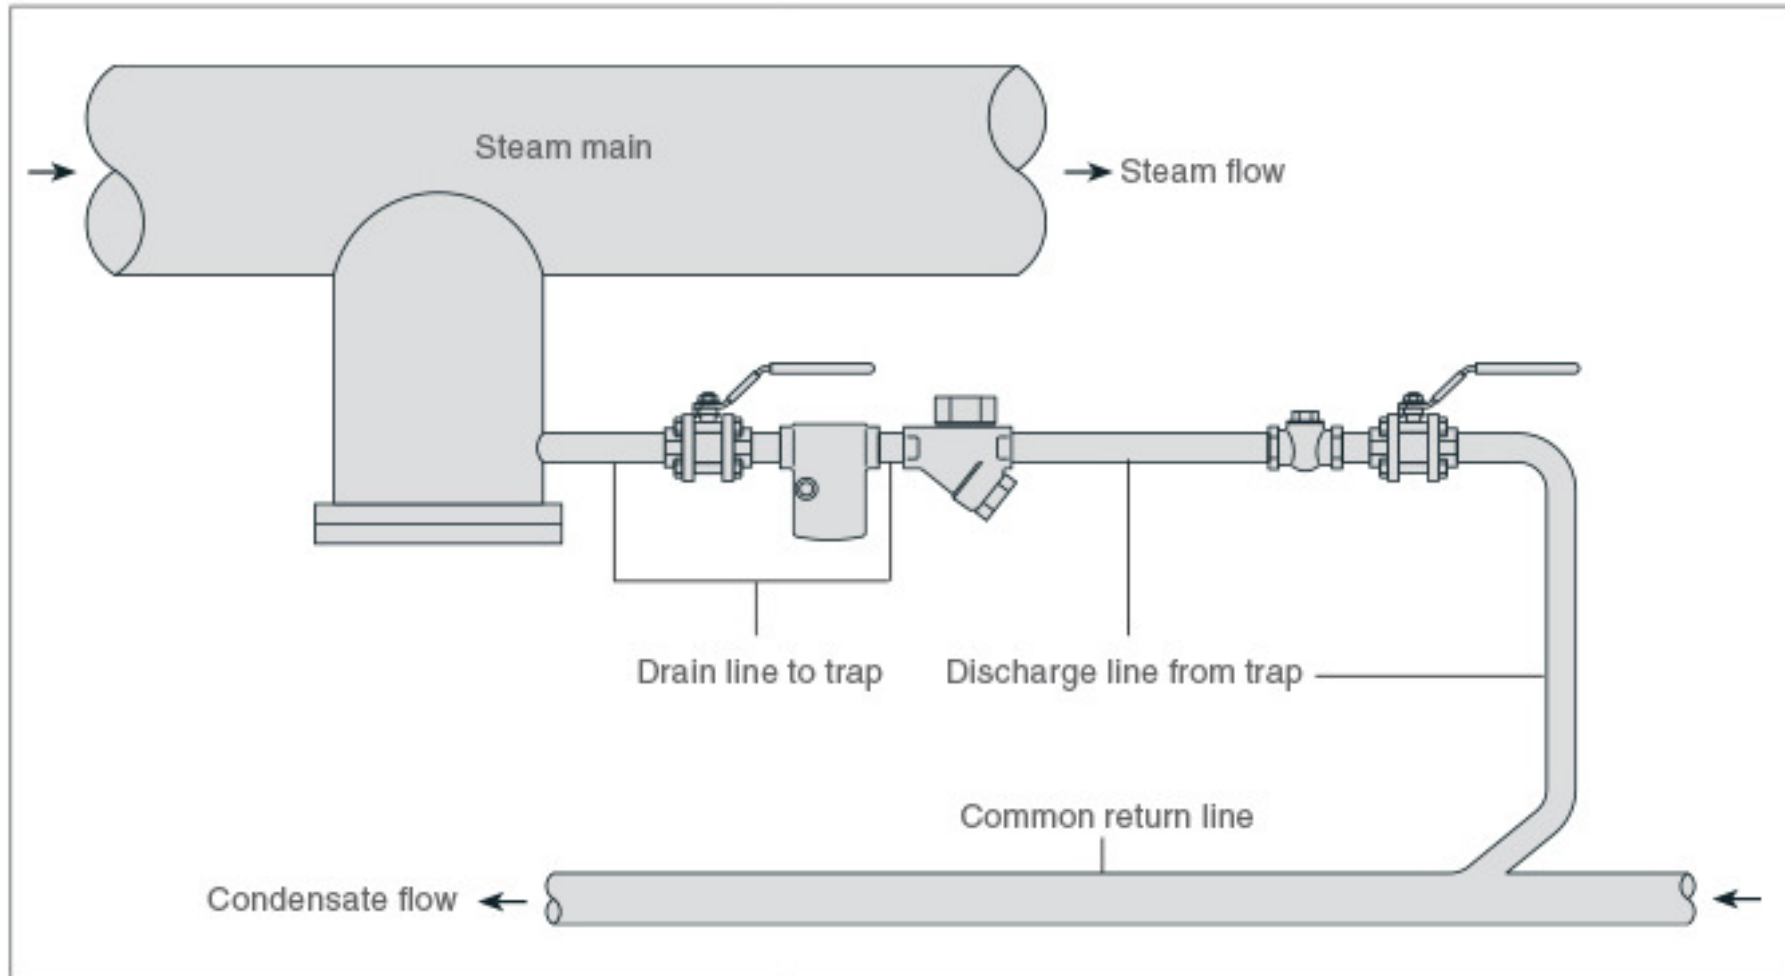

Type of condensate line	Condensate line is sized to carry the following:
Drain line to trap	Condensate
Discharge line from trap	Flash steam
Common return line	Flash steam
Pumped return line (not shown)	Condensate

Ideal arrangement when draining a steam main

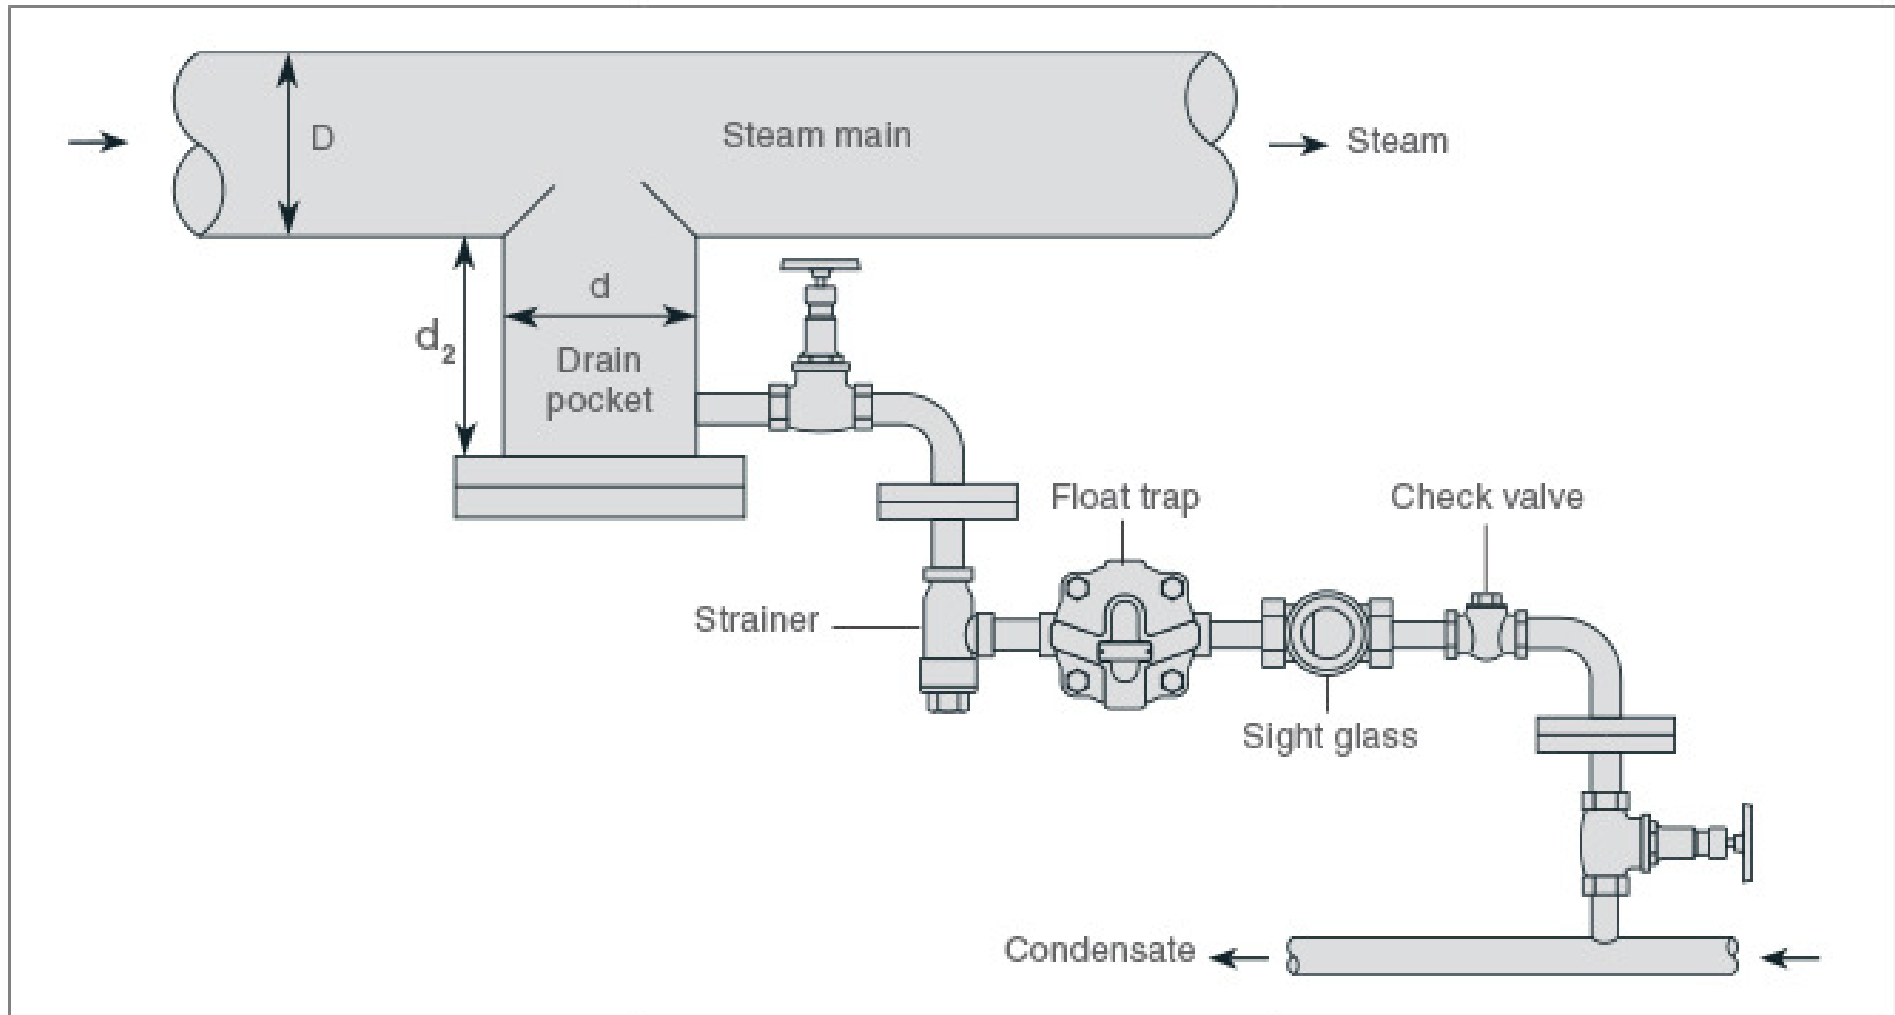

Main diameter D	Pocket diameter d_1	Pocket depth d_2
Up to 100 mm	$d_1 = D$	Minimum $d_2 = 100$ mm
125 mm - 200 mm	$d_1 = 100$ mm	Minimum $d_2 = 150$ mm
250 mm and above	$d_1 = D/2$	Minimum $d_2 = D$



Condensate Recovery

- Returning condensate and condensate pumps
 - Use trap inlet pressure
 - Gravity return
 - Elevated return
 - Use a pump to overcome return line backpressure
 - Electric centrifugal or turbine condensate pumps
 - Non-electric steam or air-powered mechanical condensate pumps
 - Using a specialized centrifugal pump for condensate recovery pumps




Condensate Recovery

- Condensate recovery: vented vs. pressurized
 - Vented
 - Return condensate to an open-to-atmosphere collection tank for use as boiler make-up water, pre-heat or other hot water applications
 - Pressurized
 - In a pressurized vessel/directly to the boiler
 - Recovered condensate is maintained above atmospheric pressure throughout the recovery process
 - It is generally used as boiler make-up water
 - Can also recover the associated flash or live steam

Typical range for vented / pressurized systems


Vented Recovery System

Condensate Pressure

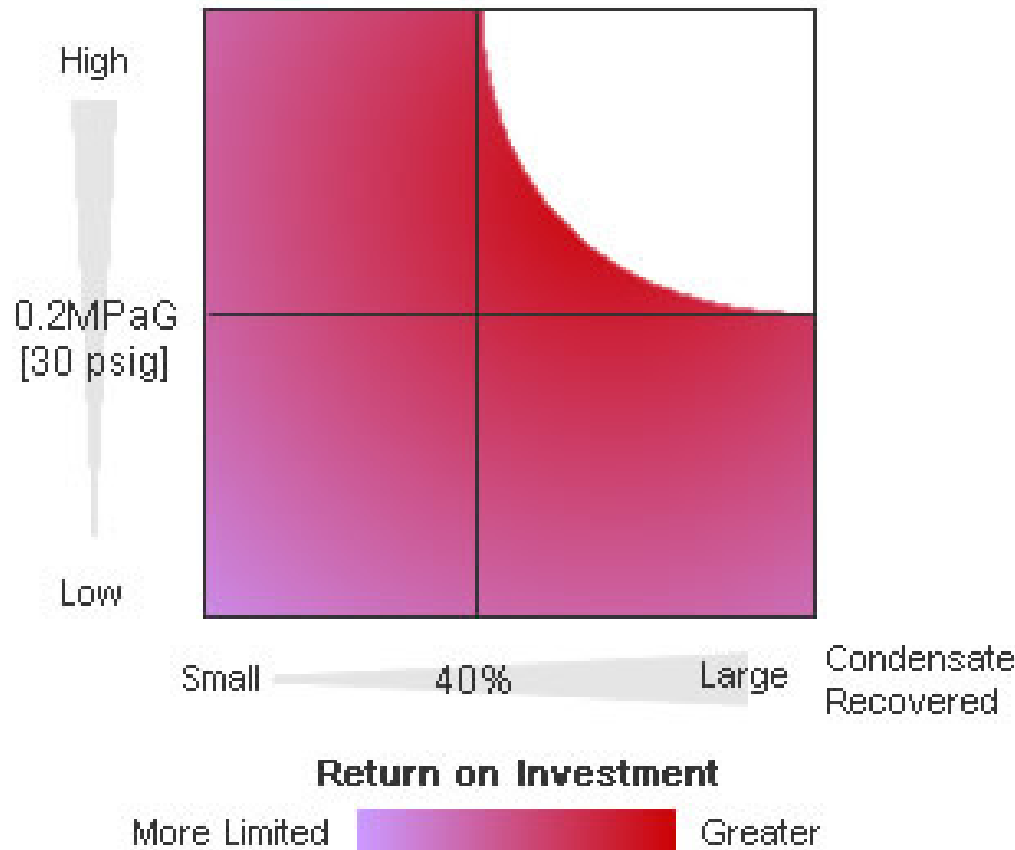

Pressurized Recovery System

Condensate Pressure

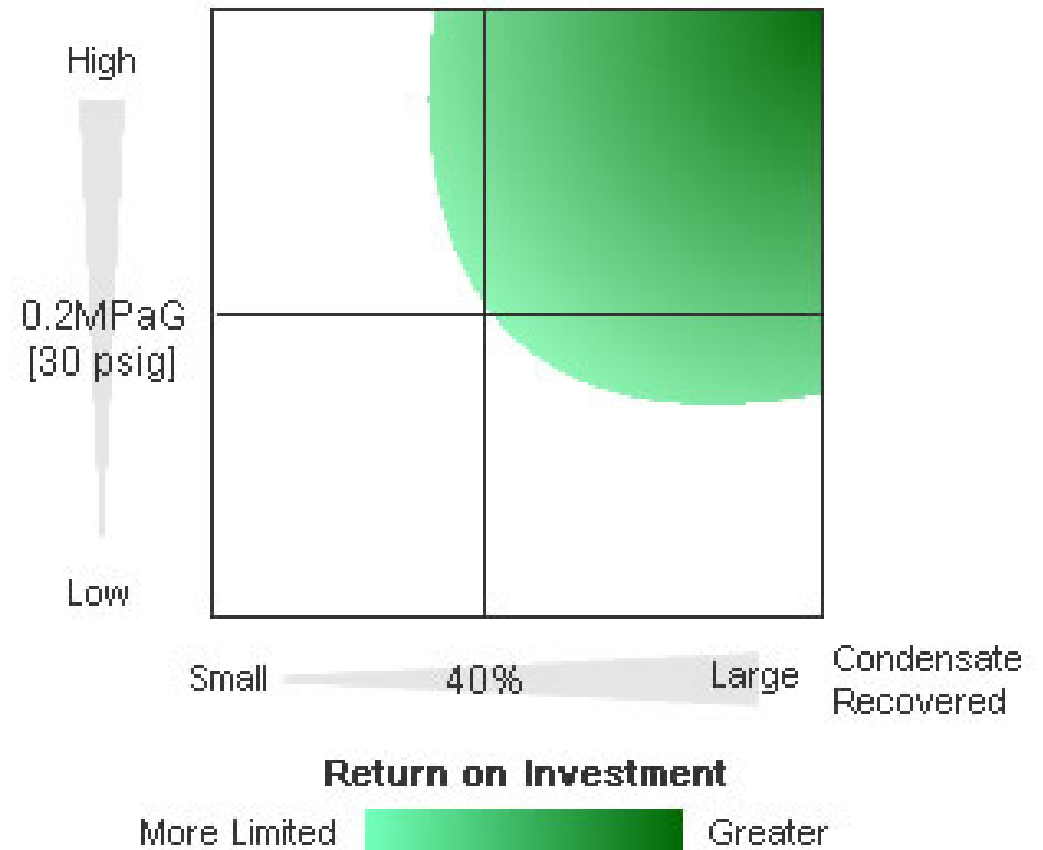

Condensate recovery: vented vs. pressurized systems

	Vented Recovery	Pressurized Recovery
Recovered Condensate Temperature	Up to 100 °C [212 °F]	Up to 180 °C [356 °F]*
System Configuration	Simple	Advanced
Initial Costs	Lower	Higher
Running Costs	Varies	Varies
Piping Corrosion	Significant (condensate comes into contact with air)	Slight (no contact with air)
Vapor Clouds	Large amount (if condensate temp. is high)	Minimal amount
Recovery Applications	Boiler make-up water Pre-heat Water for cleaning, etc.	Mainly for direct feed to boiler, and Flash Steam Recovery Applications



* May be higher. Limited by max operating temperature of pump and peripheral equipment.



Condensate Recovery


- Condensate recovery/return piping
 - Must be designed for “two-phase flow”
 - Vapour such as steam (either flash steam, live steam, or a mix of both) flows through piping together with liquid condensate
 - The design requires calculating the amount of flash steam and then sizing the pipe to accommodate both water and steam flow for the required velocity and pressure drop design parameters

Flash steam supply and demand in step (recover flash steam energy)

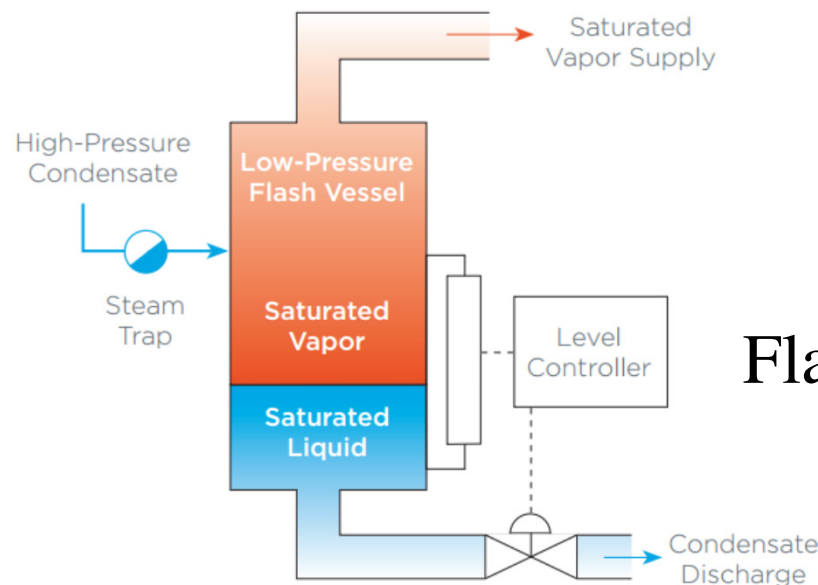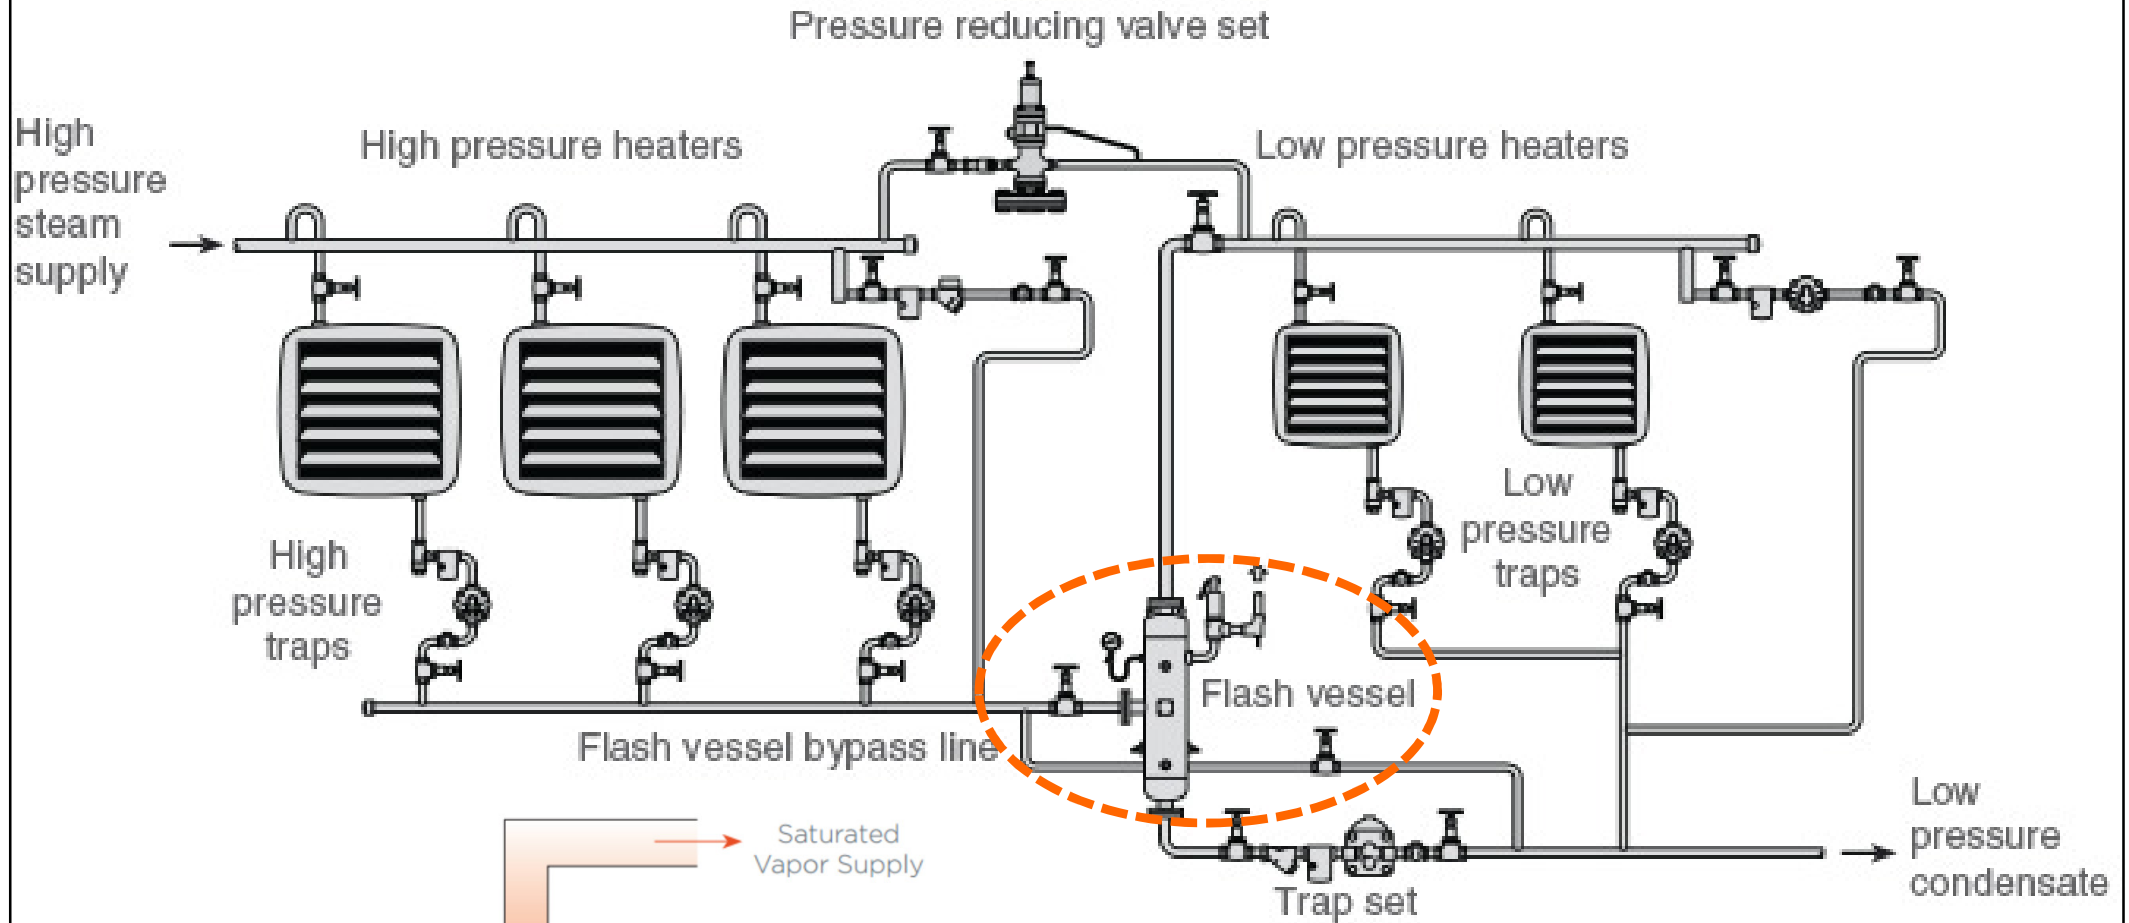

Flash steam recovery vessel

Typical heat recovery from boiler blowdown

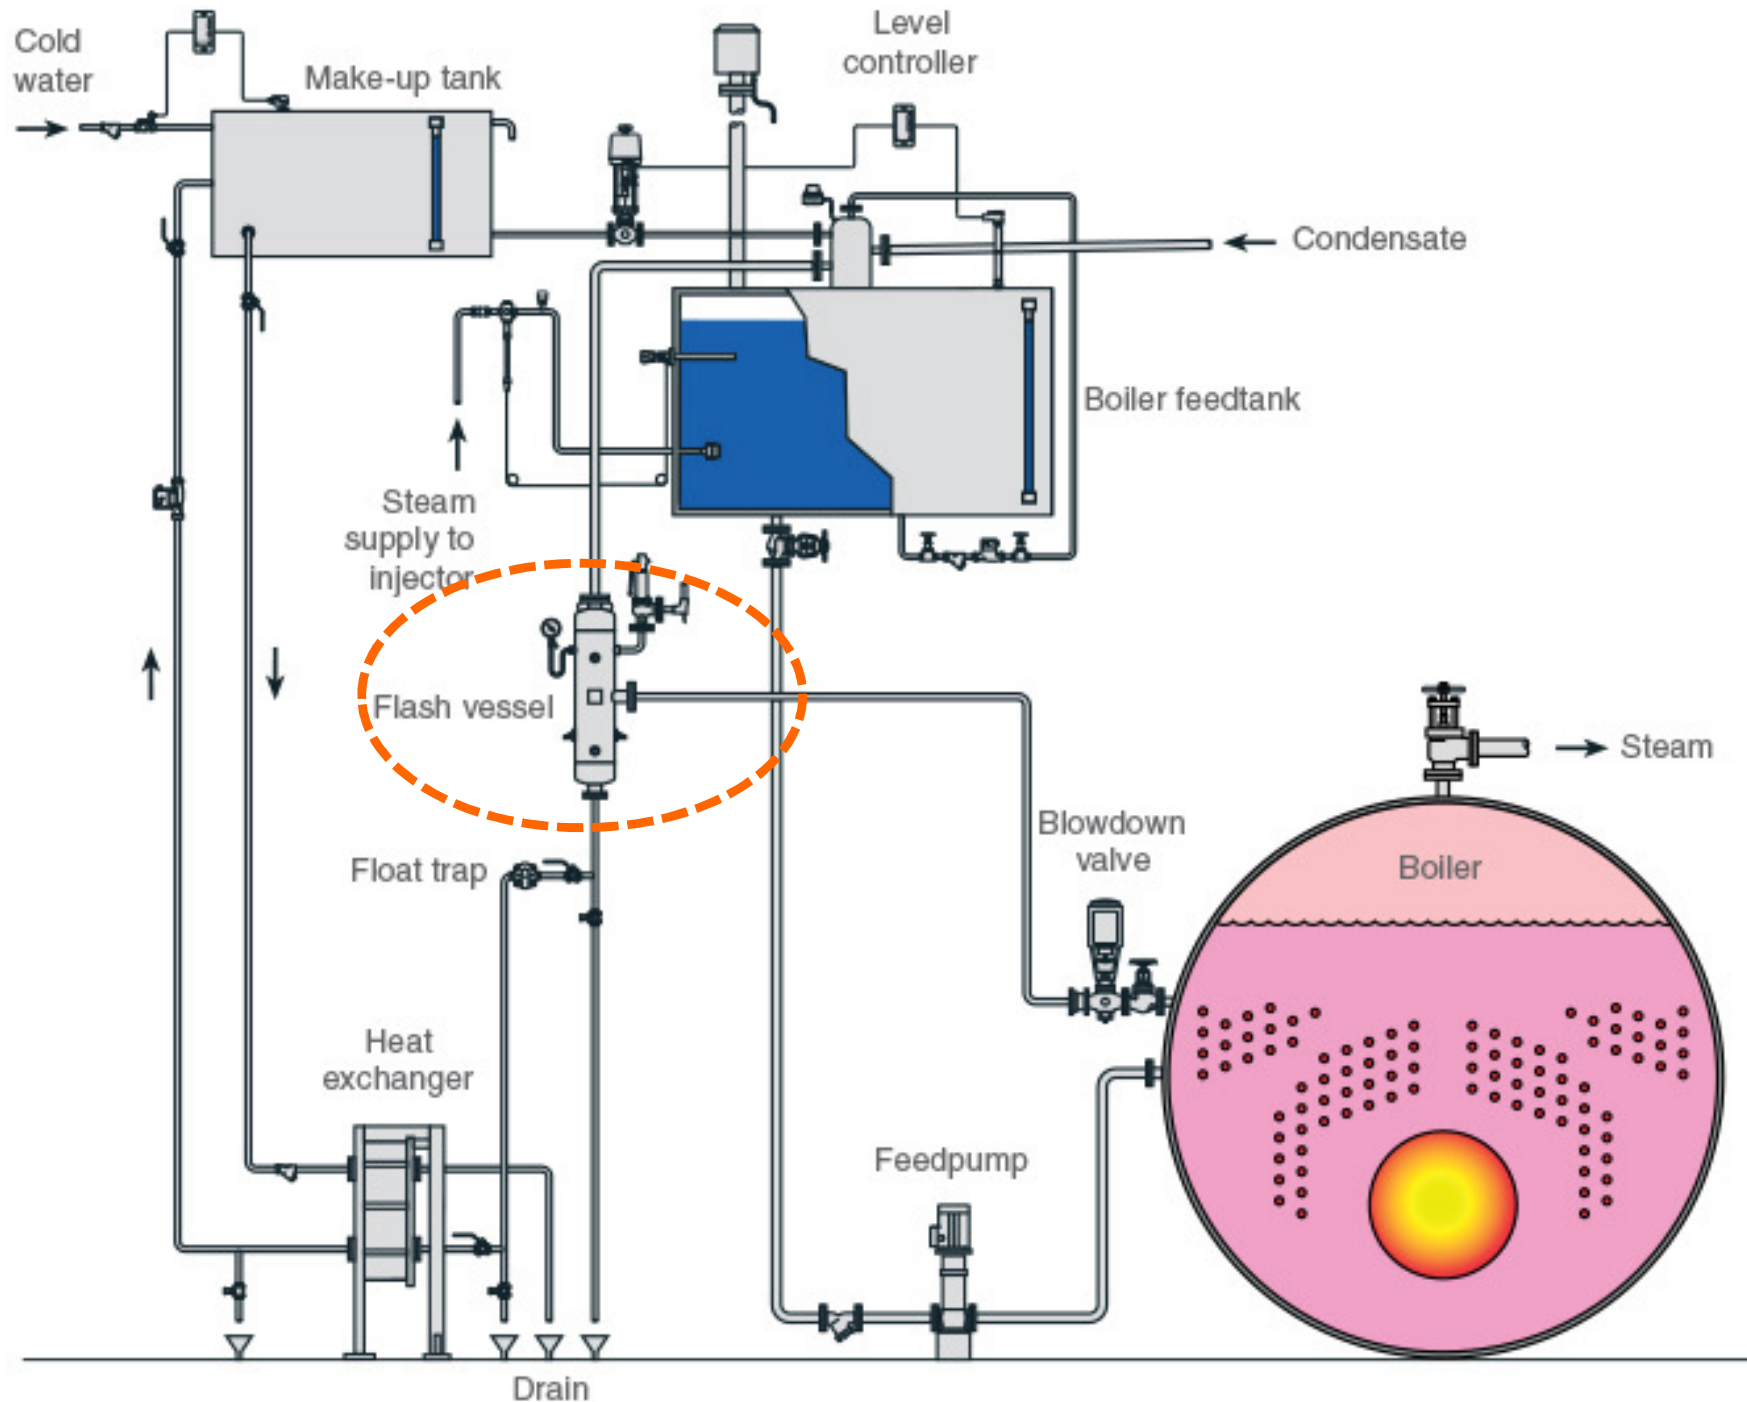



Condensate Recovery

- What is **Stall**?
 - A condition which occurs when the necessary pressure differential across a drainage device such as a trap becomes negative, causing condensate to no longer be discharged from the drainage device and instead to pool inside a heat exchanger
 - Stall can occur because:
 - Vacuum always present inside equipment
 - Constant negative pressure differential
 - Varying positive to negative pressure differential



Condensate Recovery

- Stall is often linked to the following problems:
 - Degraded or ruptured heaters
 - Can foul or damage equipment
 - Water hammer
 - Can damage tubes and channel head gaskets
 - Uneven heating temperatures
 - Can affect product quantity and quality
- Two ways to prevent stall:
 - Increase trap inlet (primary) pressure
 - Reduce trap outlet (secondary) pressure



Condensate Recovery

- Practical methods of preventing stall
 - 1. Ensure the steam pressure in the steam space can never drop below atmospheric pressure, and that the condensate can drain by gravity to and from a ball float steam trap
 - 2. Accept that the pressure in the steam space may be less than the backpressure, and provide an alternative means of removing condensate, by installing a pump-trap
 - 3. Ensure the pressure in the steam space is stable and higher than the backpressure. This will entail having the temperature control system on the secondary side of the system




Condensate Recovery

- Cavitation in condensate pumps
 - Flash steam cavities (like bubbles) formed within the liquid collapse, imploding rapidly with considerable force. The rapid implosions create shockwaves
 - The rapid formation and implosion of vapour cavities that form via cavitation damage the inner surfaces of pumps and piping, causing the erosion and thinning of impellers and pump casing




Condensate Recovery

- Cavitation coping methods
 - Calculate the Net Positive Suction Head Available (NPSHA) and careful select pumps with a compatible Net Positive Suction Head Required (NPSHR)
 - Use of a steam or air-powered mechanical pump as opposed to an electric-powered pump




Further Reading

- Spirax Sarco -- Steam Engineering Tutorials
 - <http://www.spiraxsarco.com/Resources/Pages/steam-engineering-tutorials.aspx>
 - 1. Introduction
 - 2. Steam Engineering Principles and Heat Transfer
 - 3. The Boiler House
 - 10. Steam Distribution
 - 11. Steam Traps and Steam Trapping
 - 14. Condensate Recovery



Further Reading

- TLV (a steam specialist company)
 - Engineering Calculator
<http://www.tlv.com/global/AU/calculator/>
 - Steam Theory (Sections 1 to 11)
<http://www.tlv.com/global/AU/steam-theory/>
 - Operation Animations
<http://www.tlv.com/global/AU/product-operation/>



Further Reading

- Steam and Condensate [Engineering ToolBox] (web sites)
- www.engineeringtoolbox.com/steam-condensate-properties-t_28.html
 - Classification of Steam Heating Systems
 - Design of Steam Heating Systems
 - Entropy of Superheated Steam
 - Flash Steam
 - Properties of Saturated Steam - SI Units
 - Sizing Steam and Condensate Pipes
 - Steam Pipes – Sizing
 - Steam Thermodynamics
 - Steam Trap Selection Guide