

MEBS6016 Energy Performance of Buildings


<http://me.hku.hk/bse/MEBS6016/>

Assignment 01: Fundamentals of Building Energy Performance

1. (a) Briefly explain the principles of energy efficiency in buildings as developed by CIBSE and described in the CIBSE Guide F. (7 marks)
- (b) Discuss the major barriers affecting the improvement of energy efficiency in existing buildings. (3 marks)
- (c) A government office building has a total gross floor area of 20,000 m² and consumed 3.2 x 10⁶ kWh of electricity in one year. The annual cost of electricity is \$3.5 millions and this includes both energy charge and demand charge. If the demand charge constitutes 15% of the annual electricity cost, determine the following indicators for assessing the energy performance. Assume the ratio of net floor area to gross floor area is 0.7.
 - i) Average cost of electricity in \$ per kWh
 - ii) Energy utilization index (kWh/m²/annum), based on net floor area
 - iii) Energy cost index (\$/m²/annum), based on net floor area

If this building is compared with the energy consumption benchmark shown on the following graph, find out the percentile of this building and comment on the performance level.

(10 marks)

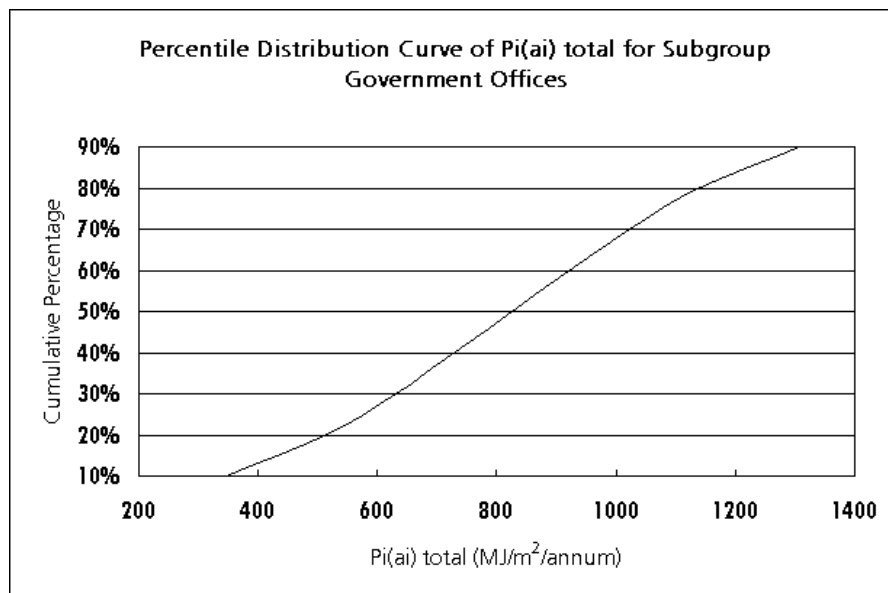

(Source: Electrical & Mechanical Services Department, Hong Kong)

[Ans.: i) \$1.09 per kWh, ii) 228.6 kWh/m²/year, iii) \$212.5 /m²/year; 54%]

2. (a) The EU Directive on Energy Performance of Buildings is an important energy policy affecting Europe and the world. Explain the four major requirements of the directive and their implications to energy efficiency in buildings. (10 marks)

- (b) An engineer has used a building energy simulation software to investigate two energy-efficient design options and the following results were obtained.

	Base case	Option A	Option B
Annual energy consumption (MJ)	360,000	180,000	252,000
Initial capital cost (\$)	0	\$200,000	\$100,000

Assume energy price is \$1 per kWh, the study period is 10 years, the interest rate is 10%, and all other costs are neutral. Calculate the following parameters for each design option and comment on which one is preferred.

- i) Annual energy cost savings in dollars
- ii) Simple payback (SPB)
- iii) Return on investment (ROI)
- iv) Net present value (NPV)

(10 marks)

[Ans.: i) A: \$50,000, B: \$30,000, ii) A: 4 years, B: 3.3 years, iii) A: 25%, B: 30%, iv) A: \$107,250, B: \$84,350]

3. (a) Explain the benefits of using energy saving performance contract for improving energy efficiency in an existing office building. (7 marks)
- (b) Draw a diagram to show the framework of the comprehensive building energy codes in Hong Kong. Discuss its major characteristics. (3 marks)
- (c) A variable speed drive (VSD) is proposed to be installed on a chilled water pump to save energy. The existing flow rate of the pump is 100 litre/second and the VSD can reduce average flow to 70 litre/second. The pump's energy consumption before installing the VSD is 8,000 kWh per year. The initial cost of the VSD is \$20,000 and additional maintenance cost for the VSD is \$200 per year. Assume energy price is \$1 per kWh and the pump energy is proportional to cubic of the flow rate. Estimate the following parameters:
- i) Annual energy savings in kWh
 - ii) Annual energy cost savings in dollars
 - iii) Net annual cost savings in dollars
 - iv) Simple payback (SPB) of the measure

(5 marks)

For a study period of 10 years, construct a table to show the cash flow analysis. Assume the interest rate is 8%, then calculate the discount factor for each year and determine the present value of the net annual cost savings for each year. Show the results on the table and estimate the total life cycle cost.

(5 marks)

[Ans.: i) 5,256 kWh, ii) \$5,256, iii) \$5,056, iv) 3.96 years; Total LCC: \$13,926]