
#### MEBS6000 Utility Services

http://ibse.hk/MEBS6000/



## Steam Systems (I)

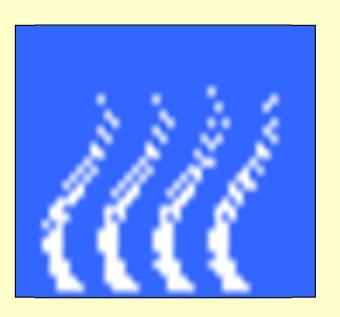

Ir Dr. Sam C. M. Hui
Department of Mechanical Engineering
The University of Hong Kong
E-mail: cmhui@hku.hk

## Contents




- Properties of steam
- Uses of steam
- Steam system
- Steam traps
- Other components








Basic principles

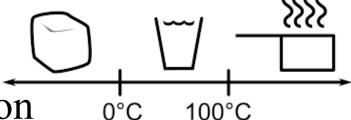


- Steam: water heated to vaporisation
- At atmospheric pressure, temperature = 100 °C
- Three types of heat in steam calculation:
  - Specific heat (capacity) of water  $(c_{pw}) = 4.2 \text{ kJ/kg.K}$
  - Specific enthalpy of evaporation  $(h_{fg})$
  - Specific enthalpy of steam  $(h_g)$

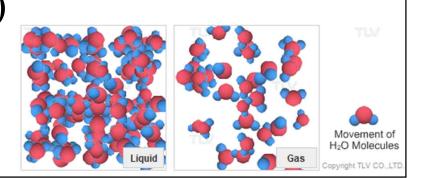



## Properties of steam


- Heat transfer
  - Latent heat of evaporation = 2257 kJ/kg at atm pressure (condensable energy content)
  - Sensible heat of water = 419 kJ/kg (0 to 100 °C)
- Flow at high velocity (24-36 m/s) and high temperature (100-198 °C)

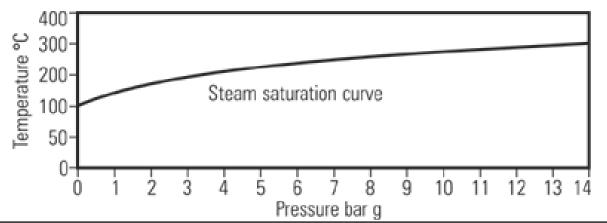





- Assume you understand the basics well
  - Such as pressure, specific volume, density, temperature, internal energy, enthalpy, entropy and specific heat
  - Review relevant textbooks if you have questions
- Key fundamental concepts
  - Steam tables
  - Dry steam and wet steam
  - Superheated steam

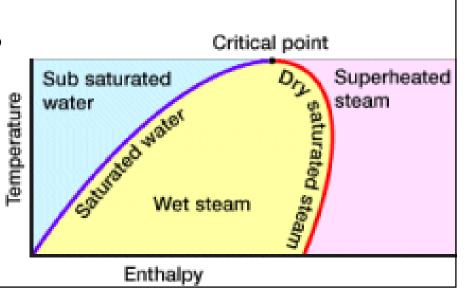



## **Properties of steam**

- Steam tables
  - To determine various steam properties
    - Pressure (absolute or gauge) [1 bar = 100 kPa = 14.5 psi]
    - Temperature [°C or K]
    - Specific enthalpy [kJ/kg]
    - Specific volume (inverse of density) [m³/kg]
    - Specific heat capacity [kJ/kg.K]
  - Published tables in databooks, such as CIBSE Guide C, Section 4, or IOP Guide
  - Total enthalpy,  $h_g = h_f$  (sensible) +  $h_{fg}$  (latent)

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steam-basics/how-to-read-a-steam-table)

#### Do you know how to use these steam tables?


#### Extract from the saturated steam tables

	Saturation	Enthalpy kJ/kg			Volume of dry
Pressure	temperature	Water	Evaporation	Steam	saturated steam
bar g	°C	hr	htg	hg	m³/kg
0	100	419	2 257	2 676	1.673
1	120	506	2 201	2 707	0.881
2	134	562	2 163	2 725	0.603
3	144	605	2 133	2 738	0.461
4	152	641	2 108	2 749	0.374
5	159	671	2 086	2 757	0.315
6	165	697	2 066	2 763	0.272
7	170	721	2 048	2 769	0.240

#### Extract from superheated steam tables

Absolute pressure	Units	Temperature (°C)					
bara		150	200	250	300	400	500
1.013	ν <sub>g</sub> (m³/kg)	1.912	2.145	2.375	2.604	3.062	3.519
	u <sub>g</sub> (kJ/kg)	2 583	2 659	2 734	2 811	2 968	3 131
	h <sub>g</sub> (kJ/kg)	2 777	2 876	2 975	3 075	3 278	3 488
	s <sub>g</sub> (kK/kg)	7.608	7.828	8.027	8.209	8.537	8.828

(Online steam tables: https://www.spiraxsarco.com/resources-and-design-tools; https://www.tlv.com/global/AU/calculator/)

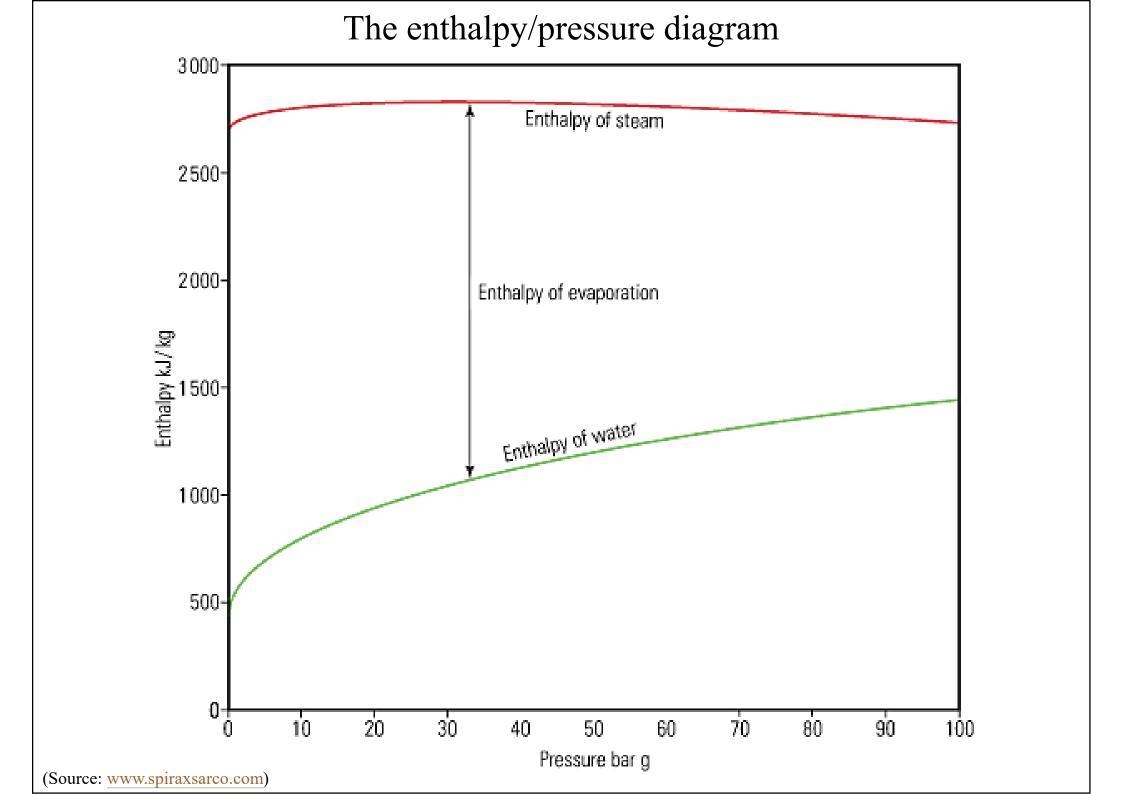




## **Properties of steam**

- Types of steam:
  - Saturated steam (Dry)
  - Unsaturated steam (Wet) (with non-vaporized water molecules)
  - Superheated steam (above the saturation curve)
  - Supercritical water (exceeds its critical point)
- Flash steam
  - The steam formed from hot condensate when the pressure is reduced

#### Pressure-temperature relationship of water & steam

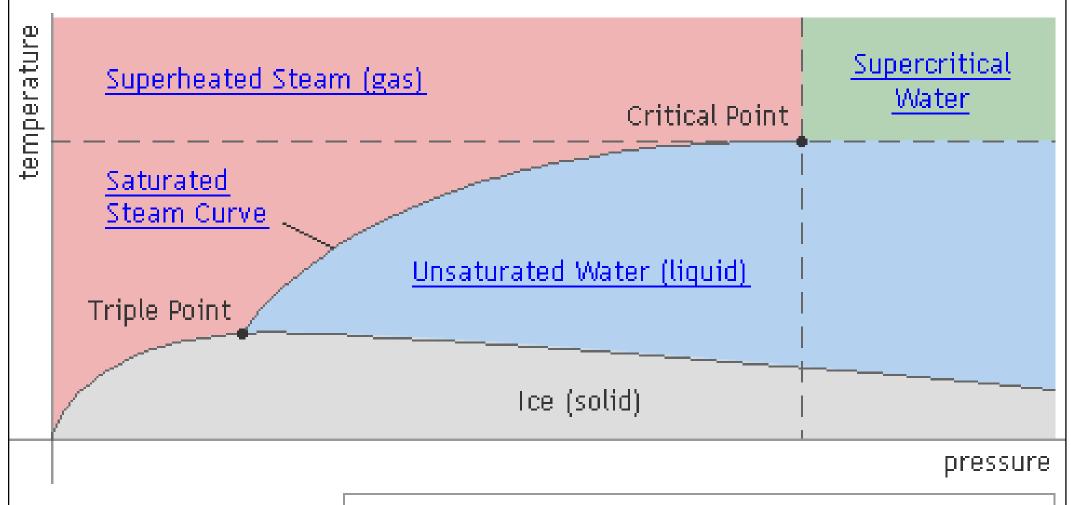

Can you explain the relationship & the points?

Triple Point : 0°C, 0.61 KPa abs (32°F, 0.09 psia)


Critical Point: 374°C, 22.1 MPa abs (705°F, 3208 psia)


(Source: https://www2.tlv.com/en-au/steam-info/steam-theory/steam-basics/types-of-steam)





- Dryness of steam
  - Steam often carries tiny droplets of water
  - Dryness fraction  $(\chi)$  = proportion of completely dry steam present in the steam-moisture mixture
  - Wet steam has a heat content much lower than that of dry saturated steam at the same pressure
    - Actual enthalpy of evaporation =  $h_{fg}$ .  $(\chi)$
    - Actual total enthalpy =  $h_f + h_{fg}$ . ( $\chi$ )

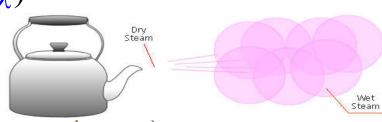

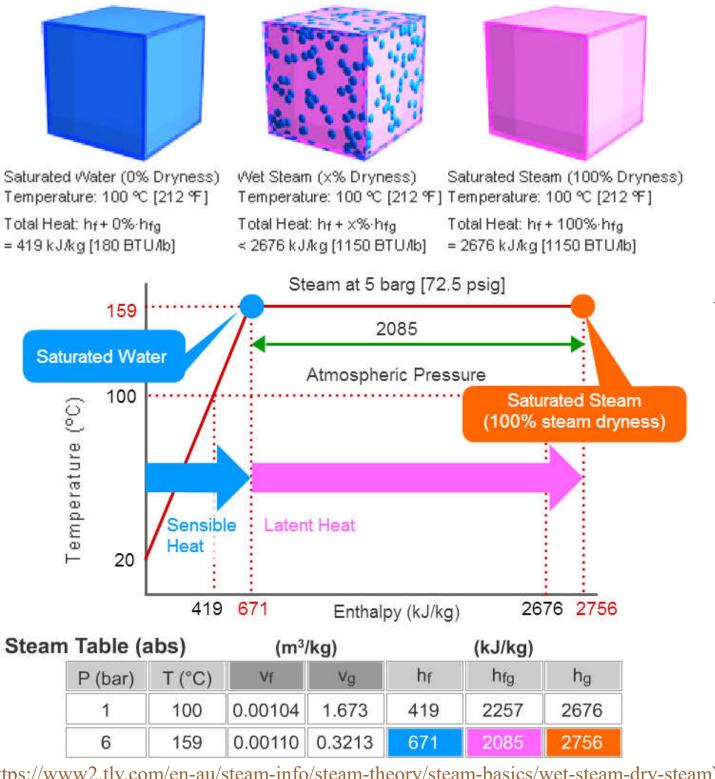


The relationship between steam dryness and enthalpy

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steam-basics/wet-steam-dry-steam)



## Properties of steam

- Superheated steam
  - If the saturated steam produced in a boiler is exposed to a surface with a higher temperature, its temperature will increase above the evaporating temperature → <u>Superheated</u>
  - When superheated steam gives up some of its enthalpy, a fall in temperature without condensation until the saturation temperature has been reached (condensation occurs in saturated steam)

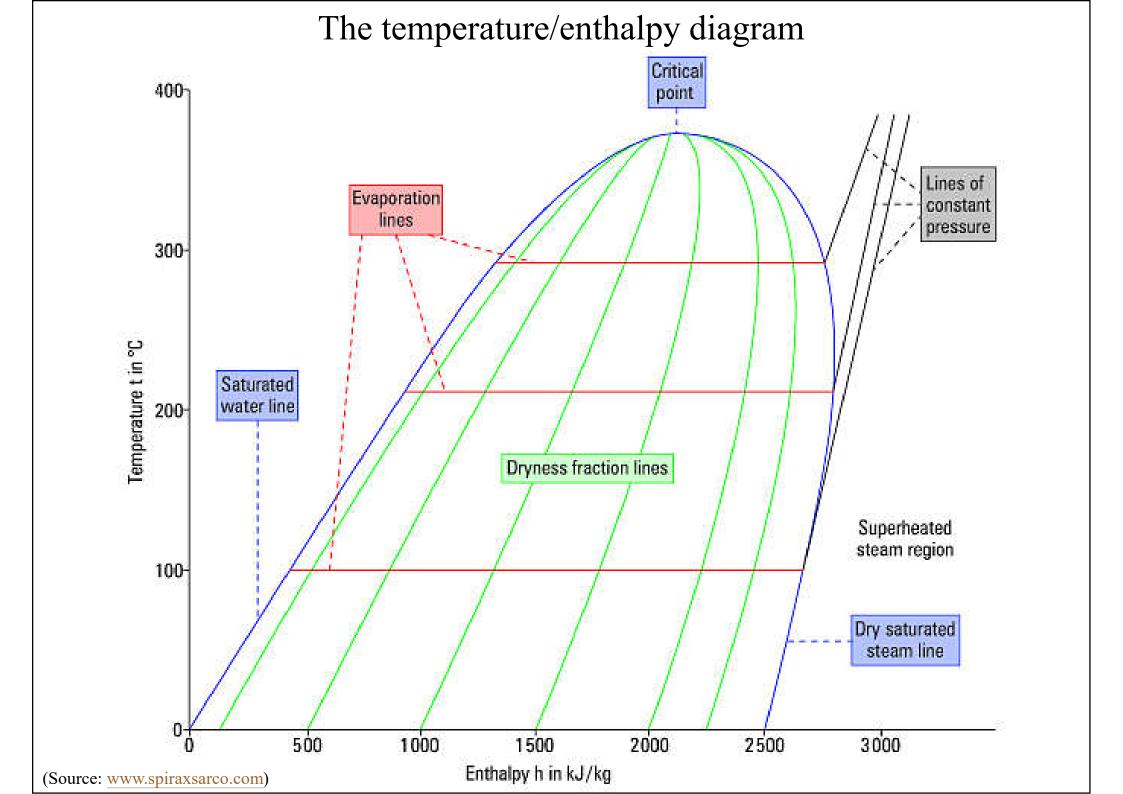



- Steam is used:
  - To produce electrical power in power plants
  - As a heating medium for industrial process, heating & hot water in buildings, cooking
  - To provide chilled water using waste heat
- Common applications in buildings:



- As a primary medium for distributing heat in factories, hospitals and hotels
- Means of sterilizing, cooking (Chinese restaurants)
- Space heating, humidifying air, hot water supply

Industries and processes which use steam

Heavy users	Medium users	Light users	
Food and drinks	Heating and ventilating	Electronics	
Pharmaceuticals	Cooking	Horticulture	
Oil refining	Curing	Air conditioning	
Chemicals	Chilling	Humidifying	
Plastics	Fermenting		
Pulp and paper	Treating		
Sugar refining	Cleaning		
Textiles	Melting		
Metal processing	Baking		
Rubber and tyres	Drying		
Shipbuilding			
Power generation			

(Source: https://www.spiraxsarco.com/Learn-about-steam)





Steam as a source of heat:



- Processes where steam is in direct contact with the product being heated, e.g. steam Chinese dumplings
- Indirect steam heating
  - Processes where steam is not in direct contact with the product being heated; widely used in industry (with a heat exchanger) because it provides rapid, even heating
  - The water droplets formed during heating will not affect the product



1 st

Jacketed kettle


#### Direct and indirect steam heating

Process in which steam is in direct contact with the product being heated

Wet steam forms when steam comes into contact with the cooler surrounding atmosphere


Chinese dumplings being steamed directly

Product being heated indirectly

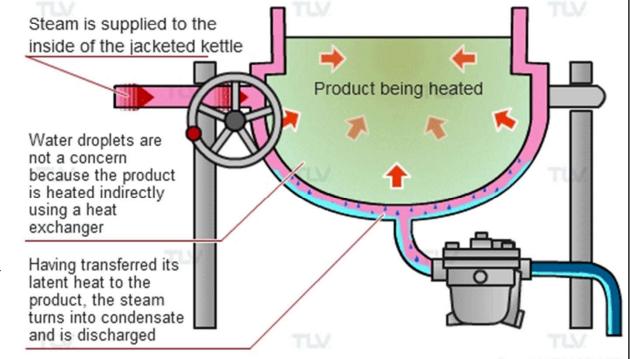

Copyright TLV CO.,LTD


#### Heating application of steam using a shell and tube heat exchanger

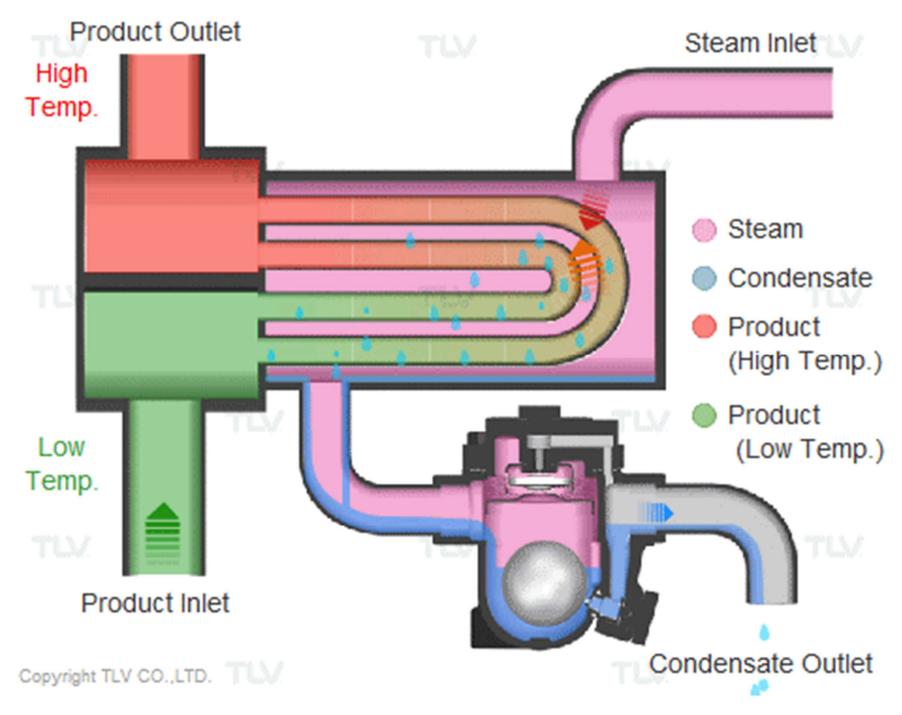

(Source: https://www2.tlv.com/en-au/steam-info/steam-theory/steam-basics/principal-applications-for-steam)


# Ducted air system with air heater batteries Steam Air flow Air heater batteries Condensate (Source: www.spiraxsarco.com)

#### Heat transfer equations for steam heating

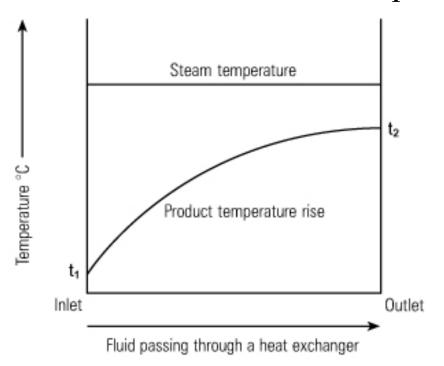

Log mean temperature difference (LMTD)

$$\Delta T_{LM_{i}} \, = \, \frac{T_{2} \, - \, T_{1}}{In \left( \frac{T_{s} \, - \, T_{1}}{T_{s} \, - \, T_{2}} \right)} \label{eq:deltaTLM}$$

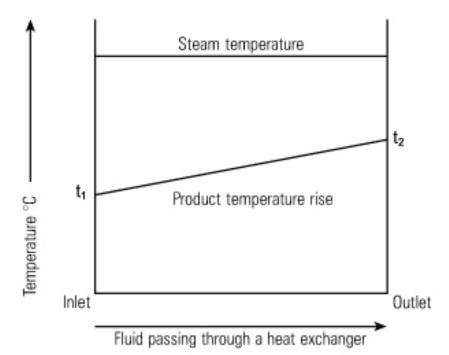


Arithmetic mean temperature difference (AMTD)

$$\Delta T_{AM} = T_s - \left(\frac{T_1 + T_2}{2}\right)$$

(Source: https://www.spiraxsarco.com/Learn-about-steam)

#### Temperature gradients across heat transfer layers

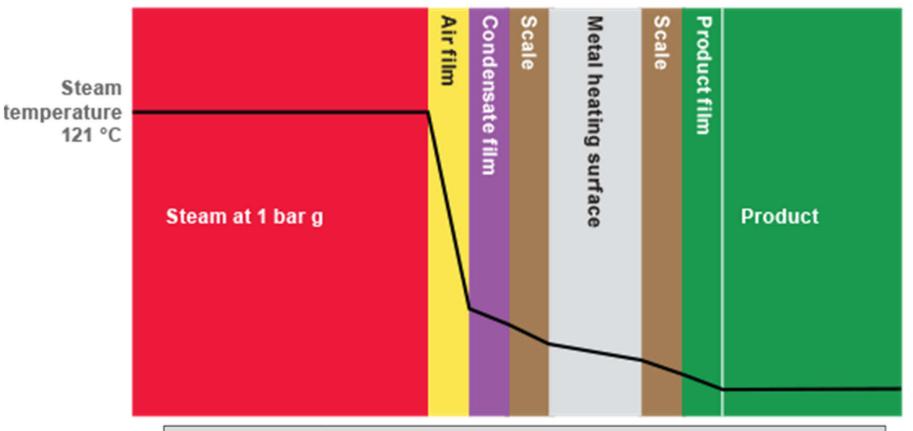

99 °C Product temperature

Equation  $U = \frac{1}{R_1 + R_2 + R_3 + R_4 + R_6 + R_6}$ 

#### Where:

R<sub>1</sub> = Resistance of the air film

R<sub>2</sub> = Resistance of the condensate film

R<sub>3</sub> = Resistance of the scale film on the steam side

R<sub>4</sub> = Resistance of the of the metal wall

 $R_{\rm 5}$  = Resistance of the scale film on the water side

R<sub>6</sub> = Resistance of the product film


(Source: www.spiraxsarco.com)

Steam	Hot water	High temperature oils	
High heat content Latent heat approximately 2 100 kJ/kg	Moderate heat content Specific heat 4.19 kJ/kg °C	Poor heat content Specific heat often 1.69-2.93 kJ/kg °C	
Inexpensive Some water treatment costs	Inexpensive Only occasional dosing	Expensive	
Good heat transfer coefficients	Moderate coefficients	Relatively poor coefficients	
High pressure required for high temperatures	High pressure needed for high temperatures	Low pressures only to get high temperatures	
No circulating pumps required Small pipes	Circulating pumps required Large pipes	Circulating pumps required Even larger pipes	
Easy to control with two way valves	More complex to control - three way valves or differential pressure valves may be required	More complex to control - three way valves or differential pressure valves may be required	
Temperature breakdown is easy through a reducing valve	Temperature breakdown more difficult	Temperature breakdown more difficult	
Steam traps required	No steam traps required	No steam traps required	
Condensate to be handled	No condensate handling	No condensate handling	
Flash steam available	No flash steam	No flash steam	
Boiler blowdown necessary	No blowdown necessary	No blowdown necessary	
Water treatment required to prevent corrosion	Less corrosion	Negligible corrosion	
Reasonable pipework required	Searching medium, welded or flanged joints usual	Very searching medium, welded or flanged joints usua	
No fire risk	No fire risk	Fire risk	
System very flexible	System less flexible	System inflexible	

Comparison of heating media with steam



- Typical applications for steam in industry: \*
  - Heating/Sterilization
  - Propulsion/Drive
  - Motive
  - Atomization
  - Cleaning
  - Moisturization
  - Humidification

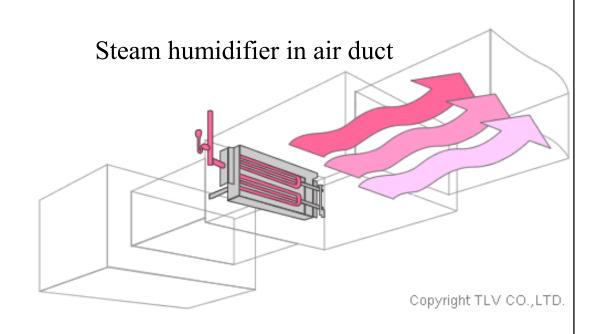





- Unique properties of steam for applications:
  - Sterility sterilizing in hospitals & food industry
  - High heat content means smaller pipes than a water-based system
  - High heat transfer value (w/ change of state) –
     means smaller heat exchangers
  - Ease of distribution no pumps are required
  - <u>Flexibility</u> can provide the means to heat, cool (absorption chillers) and humidify

#### Comparison between steam and water for humidification

Factor	Steam	Water
Cleanliness	Clean and sterile. Can be used in clean areas	Disinfection needed. Care must be taken to avoid formation of stagnant pools. Not suitable for clean areas
Efficiency	Easily absorbed	Carryover normal. Eliminator plates necessary
Heating	No change in air temperature	Reheat battery needed
Cooling	No cooling effect	Can provide evaporative cooling
Controllability	Easily controlled	Difficult to control

(Source: CIBSE, 2015. Design and Operation of Modern Steam Systems, CIBSE TM58: 2015)



- Advantages of steam over hot water systems:
  - No pumps needed: steam flows through system unaided
  - Smaller heat emitters
  - Low density: steam can be used in tall buildings where water systems create excessive pressure
  - Terminal units can be added/removed easily
  - Steam components can be repaired or replaced just by closing the steam supply (no associated draining and refilling a water system)
  - Steam system temperature can be controlled by varying either steam pressure or temperature
- Disadvantages:
  - More complicated, more maintenance & supervision



• Utilizing latent heat (steam heating) for heat transfer is more effective than utilizing sensible heat (hot water or oil heating), as a much higher amount of energy is released in a shorter period of time


Property	Advantage	
Rapid even heating through latent heat transfer	Improved product quality and productivity	
Pressure can control temperature	Temperature can be quickly and precisely established	
High heat transfer coefficient	Smaller required heat transfer surface area, enabling reduced initial equipment outlay	

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steam-basics/heating-with-steam)



- Use steam directly for heating
  - Low pressure (LP): up to 35 kPa
  - Medium pressure (MP): 140 to 550 kPa
  - High pressure (HP): 550 to 1400 kPa
- Low pressure steam
  - It has a higher heat content
  - Causes less risk of noise and wear
- Medium or high pressure steam
  - For large installations with long steam mains
  - Requires pressure-reducing set for appliances

#### Operating principle of steam heating

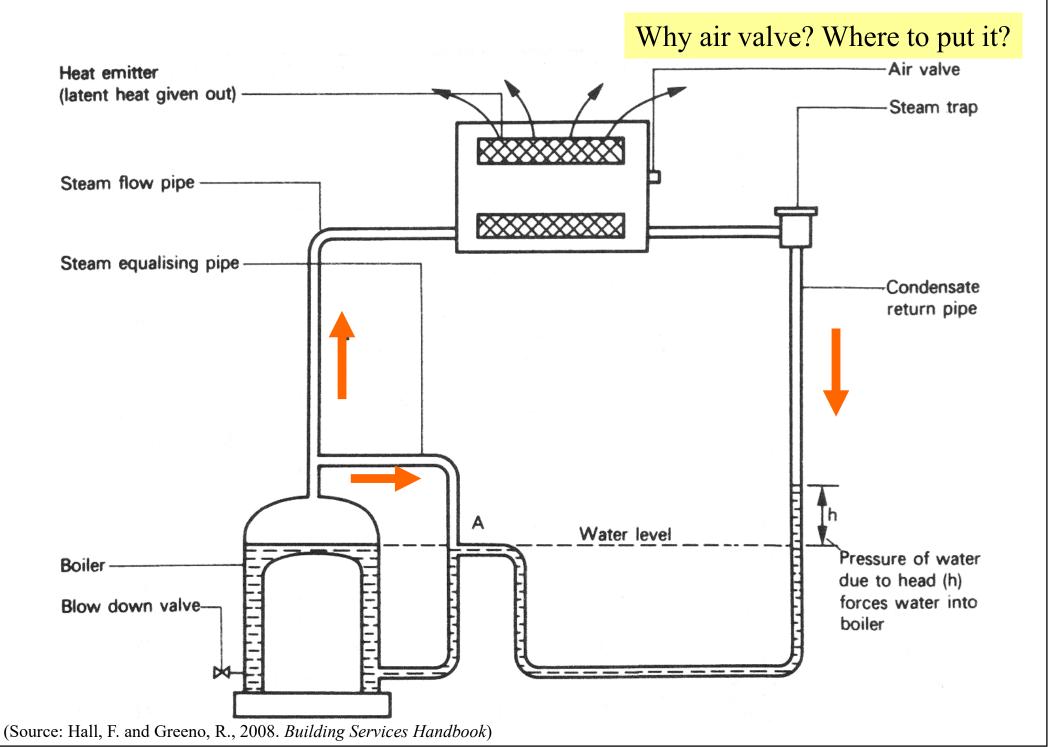


## Steam system



- Basic arrangements: boiler plant using steam pressurisation
  - Hot water boiler (w/ steam maintained inside)
  - Boiler feed pump & cistern
  - Circulating pump & pipework
  - Cooling water bypass (mixing to control the pressure)
  - Blow down pipe & valve
- Steam & water are at saturation temperature

#### Boiler plant using steam pressurisation

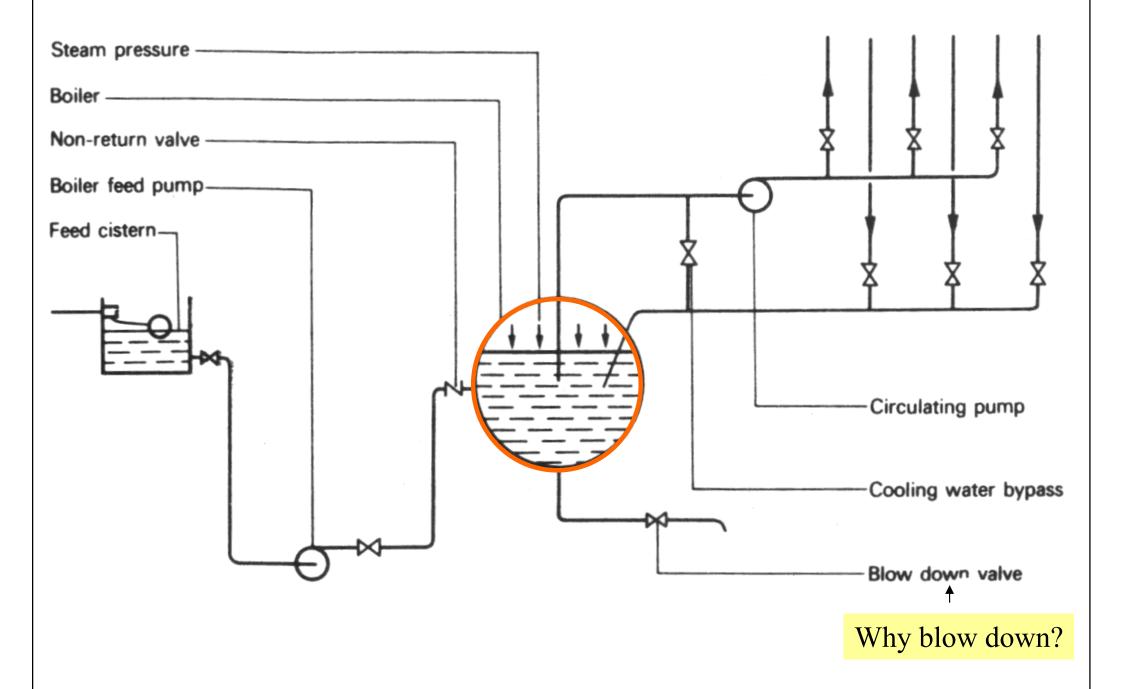

(Source: Hall, F. and Greeno, R., 2008. Building Services Handbook)

## Steam system




- Classification of steam systems:
- By method of condensate return
  - 1) By gravity (runs back to boiler)
  - 2) By automatic pump (pumped back to boiler)
  - 3) By condensate lifting trap
- By pipe layout
  - One pipe or two pipe
  - Up-feed or down-feed

## One-pipe gravity steam heating system Heat emitter Control valve -Equalising pipe **Boiler** Air valve Water level Check valve Wet condensate return

(Source: Hall, F. and Greeno, R., 2008. Building Services Handbook)

#### Two-pipe mechanical steam heating system

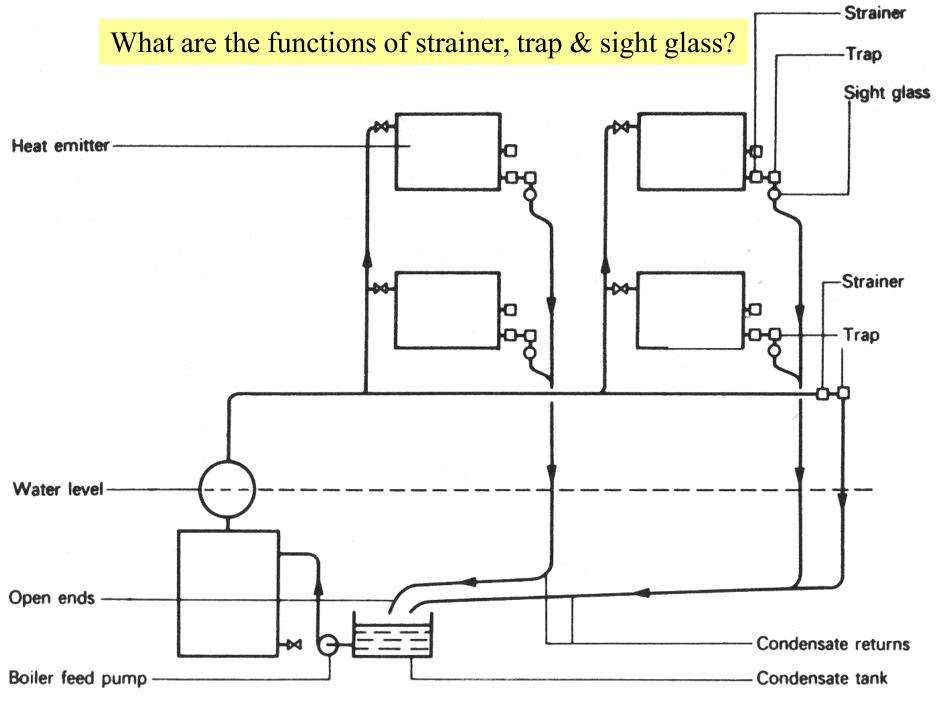


(Source: Hall, F. and Greeno, R., 2008. Building Services Handbook)

## Steam system



- A steam system consists of:
  - Steam-supply/generating facility
    - Boilers, feedwater systems, heat exchangers (e.g. economizers), boiler and system controls, fuel and gas handling equipment (e.g., fuel trains, stacks), and steam/water treatment equipment and piping
  - Steam and condensate return/water piping system
    - The steam and condensate loop
  - Steam-use facility
    - For industrial and commercial needs, such as comfort heating, food processing, paper corrugation

#### Typical steam system

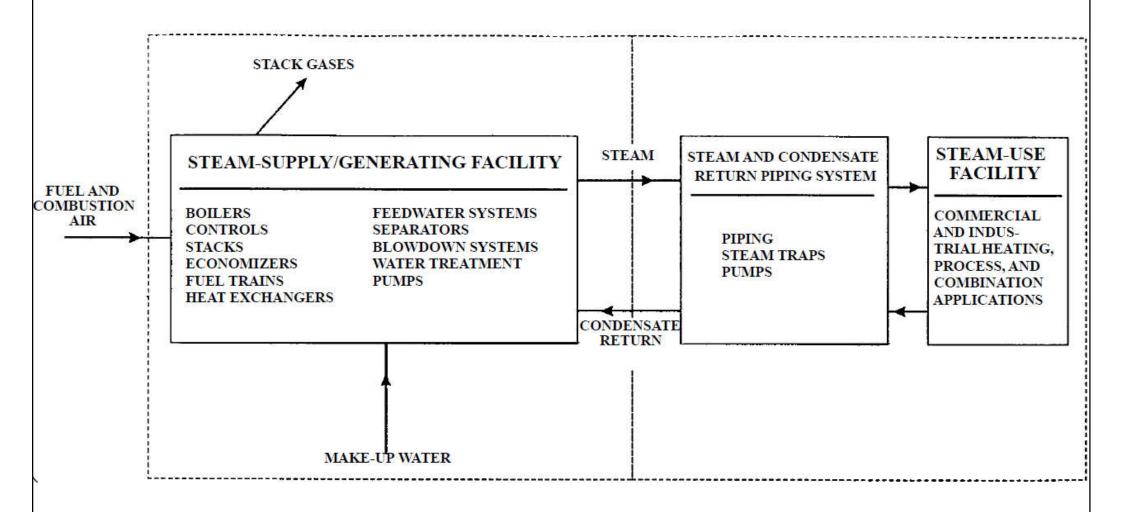


Four steps of the steam and condensate loop:

1. Generation, 2. Distribution, 3. Usage, and 4. Condensate return


(Source: Cleaver-Brooks http://www.cleaverbrooks.com/)

## Schematic diagram of a generic steam-generating facility

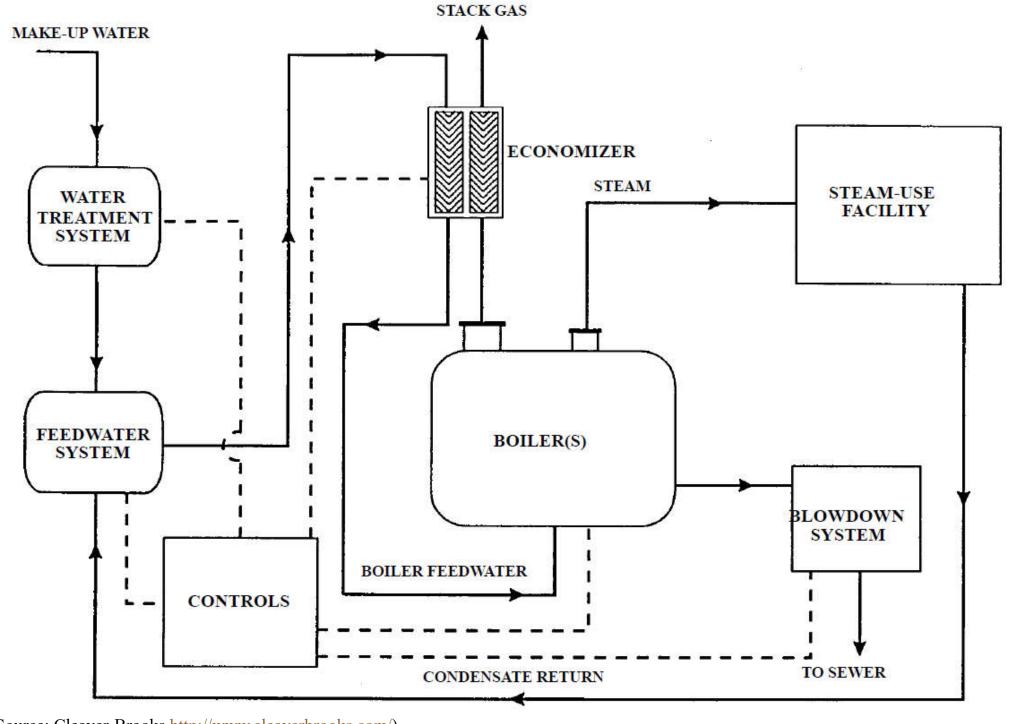

(Source: Cleaver-Brooks http://www.cleaverbrooks.com/)

#### Four principal areas of a steam system

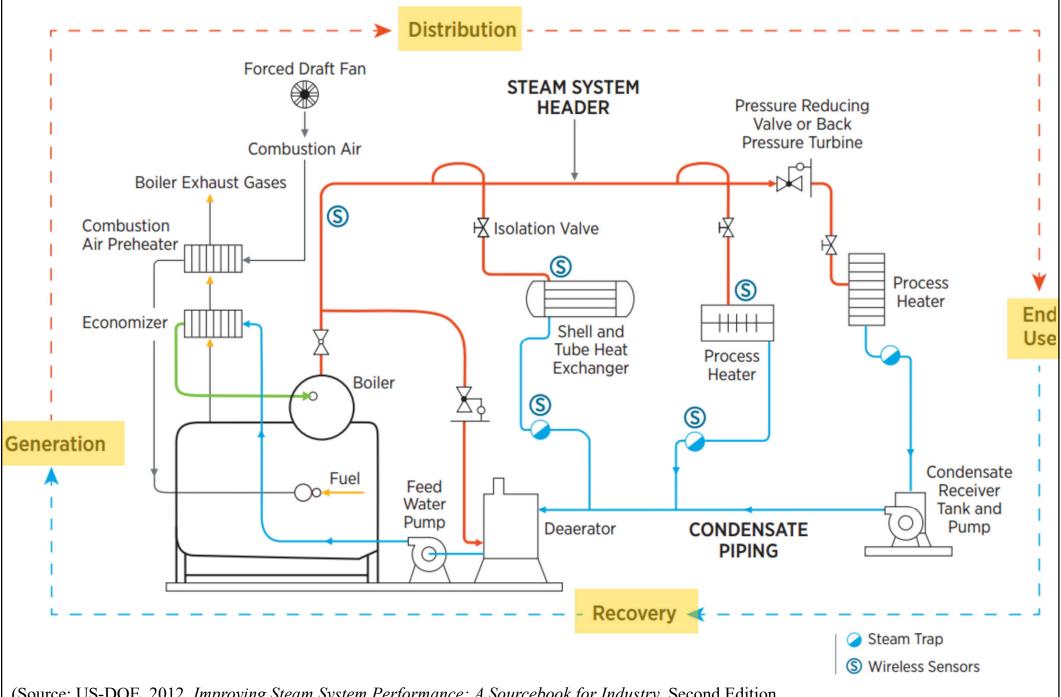


(Source: US-DOE, 2012. *Improving Steam System Performance: A Sourcebook for Industry*, Second Edition https://www.energy.gov/sites/prod/files/2014/05/f15/steamsourcebook.pdf)


# Steam system



- Steam quality: steam should be available at the point of use:
  - In the correct quantity
  - At the correct temperature and pressure
  - Free from air and incondensable gases
  - Clean
  - Dry

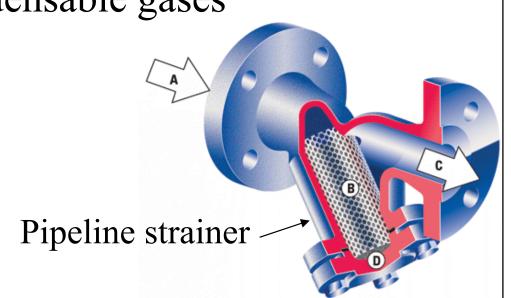

#### A typical basic steam circuit (the steam and condensate loop)

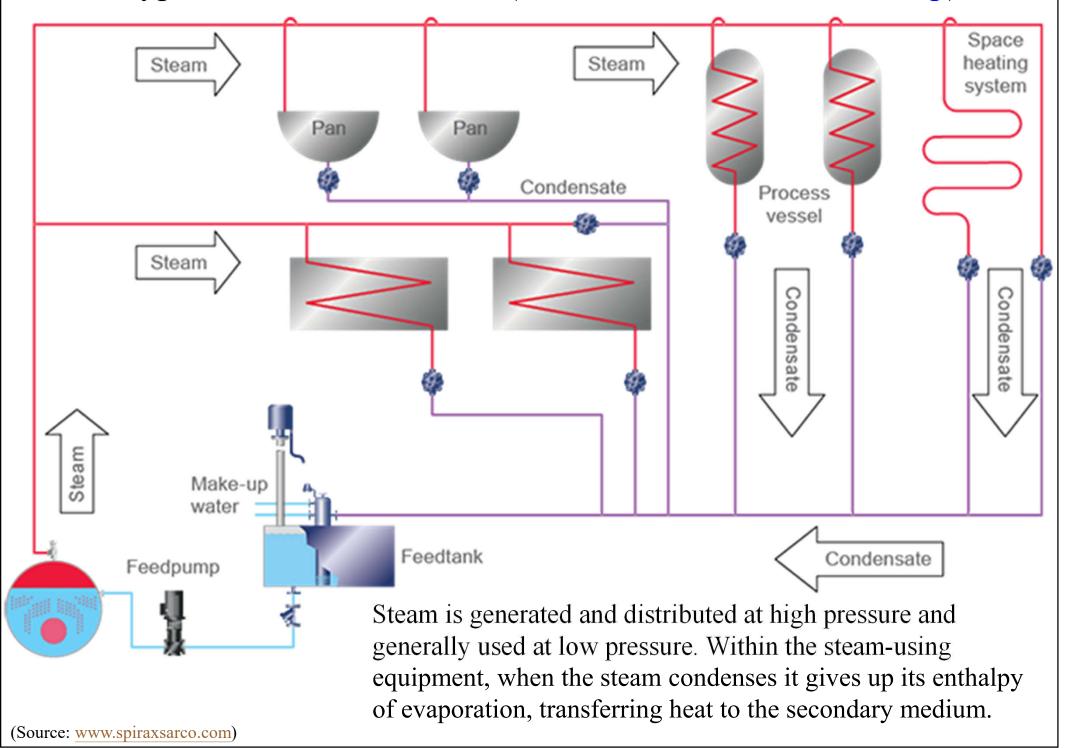



## Steam traps

- Steam traps
  - Purpose: automatic valve to "trap" the steam and filter out condensate (i.e. condensed steam) and non-condensable gases (e.g. air)
  - Definition by ANSI (American National Standard Institute):
    - "Self contained valve which automatically drains the condensate from a steam containing enclosure while remaining tight to live steam, or if necessary, allowing steam to flow at a controlled or adjusted rate. Most steam traps will also pass non-condensable gases while remaining tight to live steam."

(See also: <a href="https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/what-is-a-steam-trap">https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/what-is-a-steam-trap</a>)





- Why are steam traps installed?
  - When steam has given up its latent heat, steam condenses and becomes condensate
  - Heating efficiency will suffer if condensate is not removed as rapidly as possible
- Three main groups of steam traps:
  - (a) Thermostatic
  - (b) Mechanical
  - (c) Thermodynamic

#### Typical types of steam traps



"The duty of a steam trap is to discharge condensate while not permitting the escape of live steam"


New functions in modern steam traps: e.g. automatic air venting and scale removal

(See also: The History of Steam Traps

https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/history-of-steam-traps-pt1 https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/history-of-steam-traps-pt2)

(Source: www.spiraxsarco.com)

#### **Thermostatic**

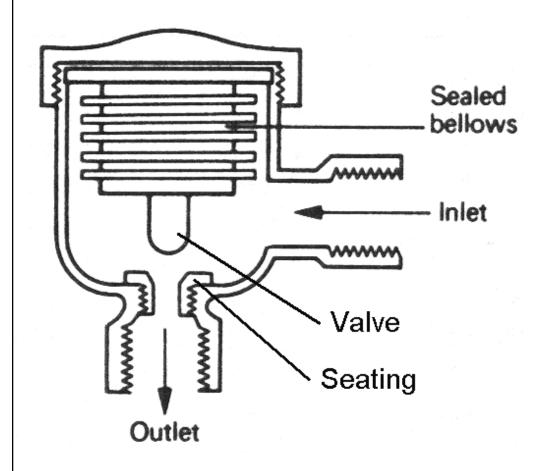


Thermostatic steam trap

#### Operating principle:

- The closed bellows contains a volatile spirit which has a boiling point suiting the temperature
- When steam enters the traps, the volatile spirit expands → open the bellows, close the valve
- Water (condensate) enters the traps at a temperature lower than steam, the spirit contracts and closes the bellows → open the valve + allow water to flow back to boiler

#### Mechanical

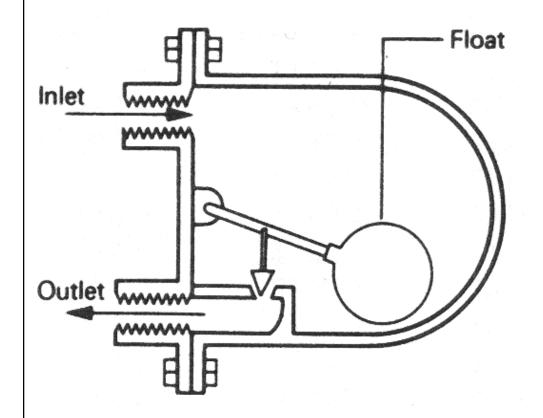


#### Operating principle:

- Steam enters the trap → ball float valve suspended → weight of float keeps outlet valve close
- Water (condensate) enters trap
- → float buoyant → opens valve → allow water flowing back to boiler

Ball float steam trap

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/mechanical-steam-traps)

#### Mechanical

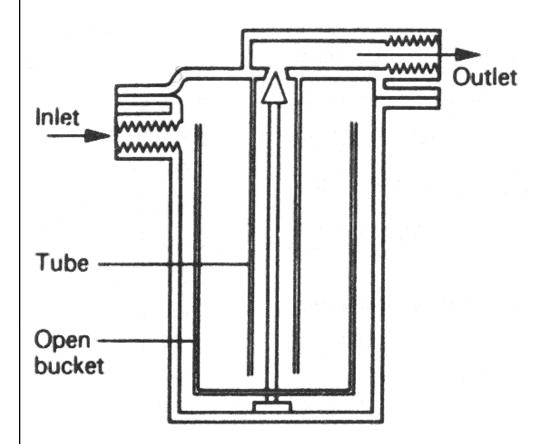


Open bucket steam trap

### Operating principle:

- Bucket floats → outlet valve close
- Water (condensate) enters trap
  →overflows into bucket → bucket
  to sink → open the valve
- Steam forces water out of bucket through the tube → bucket is buoyant → closing the valve

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/mechanical-steam-traps)

#### Mechanical

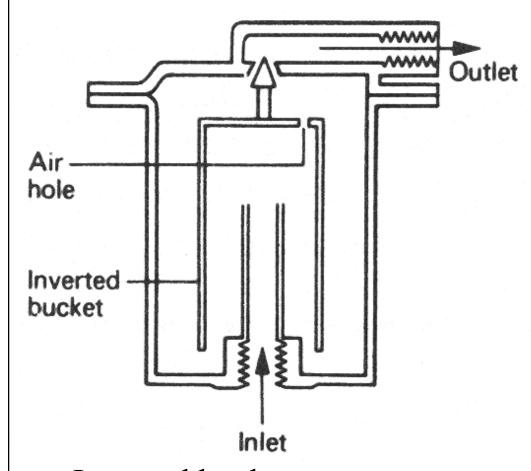


#### Operating principle:

- Steam enters the trap → bucket is lifted → valve is closed
- Water (condensate) enters trap
   → bucket fails under its own
   weight → valve opens → steam
   pressure forced water out

Inverted bucket steam trap

(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/mechanical-steam-traps)

## **Thermodynamic**

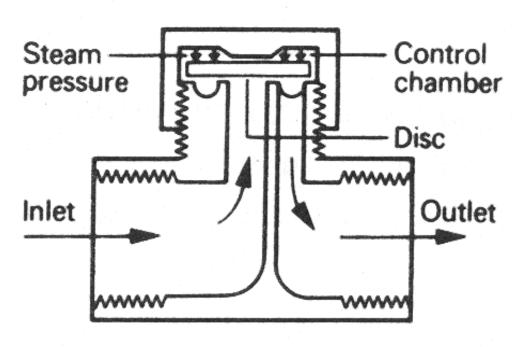

Thermodynamic steam trap

#### Bernoulli principle:


kinetic pressure + potential energy

= constant

#### Operating principle:

- Steam flows through trap → increase kinetic energy between disc & seating → reduce pressure energy at this point → disc moves nearer the seating until kinetic energy decreases
- Reduction in kinetic energy → increase pressure energy → lift the disc from seating (prevented from doing so by the steam pressure acting upon the top of the disc in the control chamber)
- Area at the top of the disc > area at inlet underneath → the upper pressure forces the disc firmly on to its seat

## **Thermodynamic**

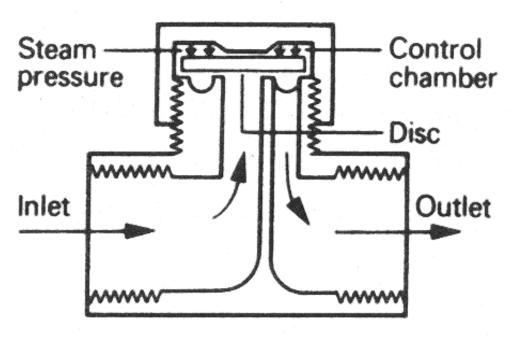

Thermodynamic steam trap

### Bernoulli principle:

kinetic pressure + potential energy

= constant

#### Operating principle (cont'd):

- Water (condensate) enters trap → steam above disc condenses → reduce pressure
  → disc forced up → water flow through trap
- Water (condensate) flows through trap at a lower velocity than steam → insufficient reduction in pressure below the disc → traps remains open until steam enters


(See also: <a href="https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/how-disc-traps-work">https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/how-disc-traps-work</a>)



## Steam traps

- Steam trap selection -- key considerations:
  - Pressure and temperature ratings, discharge capacity, trap type, body material, etc.
  - Selection process:
    - 1. Determine discharge requirements of the steam trap application (e.g. hot or subcooled discharge), and select the matching trap type
    - 2. Select trap model according to operating pressure, temperature, orientation, and any other relevant conditions
    - 3. Calculate application load requirements and apply the trap manufacturer's recommended safety factor
    - 4. Base the final trap selection on lowest Life Cycle Cost (LCC)

#### Steam trap selection: Understanding specifications

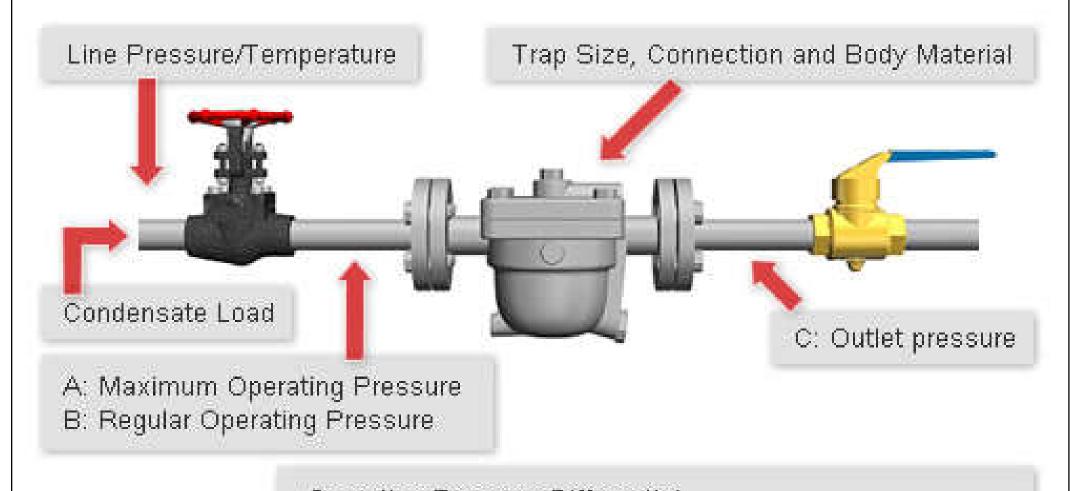


Operating Pressure Differential

Largest pressure differential = A - Atmospheric Pressure

Regular pressure differential = B - C


(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/steamtrap-basics/steam-trap-selection-part-2)

#### Recommended steam trap piping

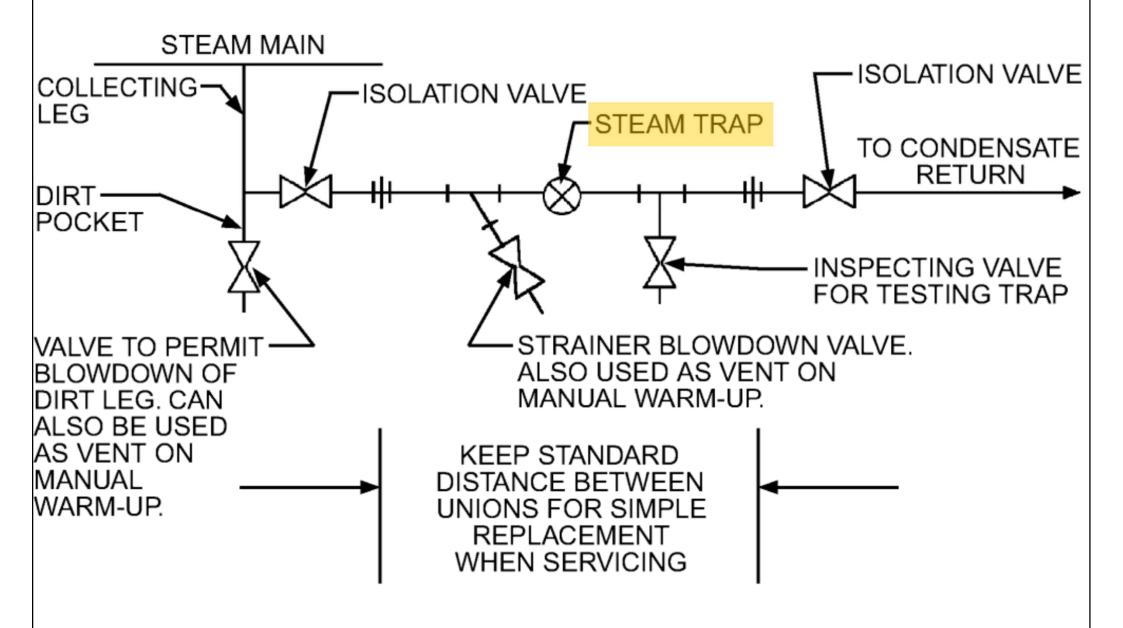

(Source: ASHRAE, 2020. ASHRAE HVAC Systems and Equipment Handbook 2020, SI edition, Chp. 11 Steam Systems)

### Group trapping with different process pressures

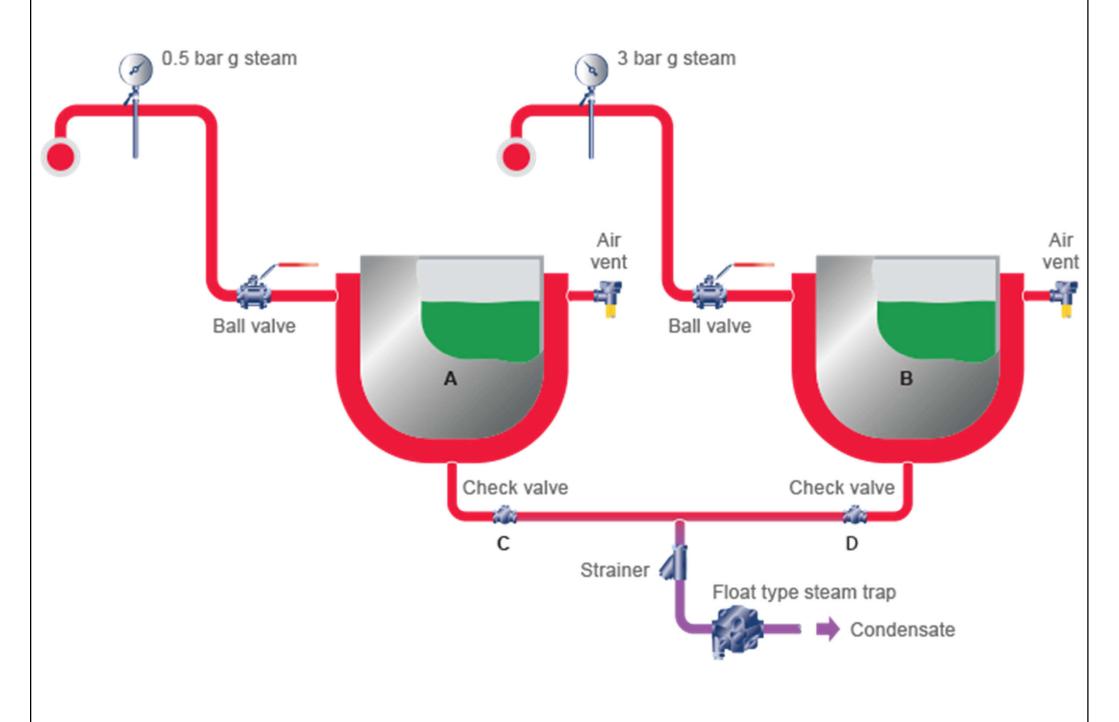

(Source: www.spiraxsarco.com)






- Steam traps and steam trapping (Learn about steam)
  - https://www.spiraxsarco.com/Learn-about-steam
  - Considerations for Selecting Steam Traps
  - Selecting Steam Traps:- (examples & applications)
    - Canteen Equipment; Oil Transfer/Storage; Hospital Equipment
    - Industrial Dryers
    - Laundries and Presses
    - Process Equipment
    - Space Heating Equipment
    - Steam Mains; Tanks and Vats; Pressure Reducing Valves
  - Testing and Maintenance of Steam Traps
  - Energy Losses in Steam Traps




## Steam traps

- Steam trap and piping problems (typical):
  - Trap leaking live steam
  - Temperature control trap (to avoid overheating)
  - Trap installation orientation
  - Trap back pressure
  - Double trapping, group trapping
  - Steam locking, air binding
  - Water/Steam hammer (pressure shock/impact)

#### Water hammer -- Formation of a solid slug of water

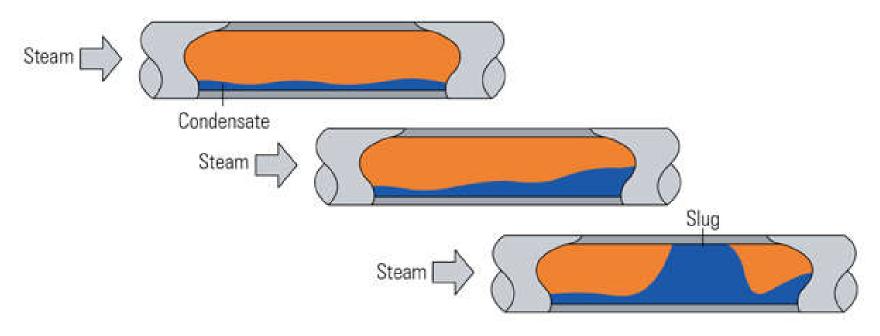

#### Potential sources of water hammer

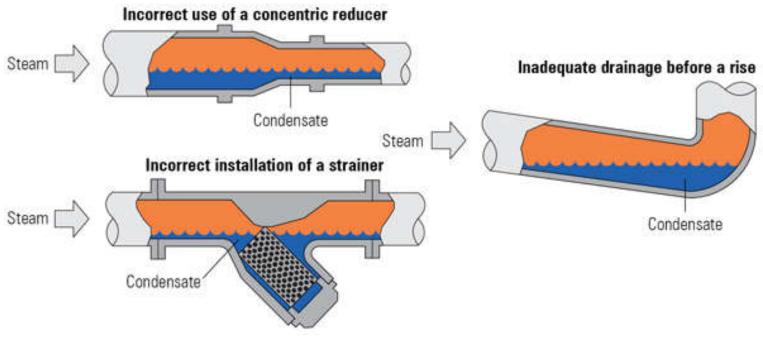


(Source: www.spiraxsarco.com) (See also: <a href="https://www2.tlv.com/en-au/steam-info/steam-theory/problems/waterhammer-mechanism">https://www2.tlv.com/en-au/steam-info/steam-theory/problems/waterhammer-mechanism</a>)





- Steam trap management
  - Steam trap losses what it costs you
    - e.g. calculate the cost of losses from one trap, calculate steam leakage amounts from holes in piping <a href="https://www2.tlv.com/en-au/steam-info/steam-theory/energy-saving/cost-of-steam-trap-losses">https://www2.tlv.com/en-au/steam-info/steam-theory/energy-saving/cost-of-steam-trap-losses</a>
  - Steam trap testing
    - Through visual observation
    - Using temperature
    - Using sound

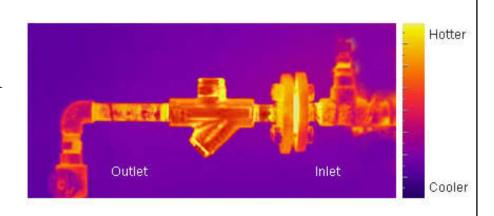





- Steam separator
  - Radiant heat loss from piping causes part of the steam to lose some of its latent heat and revert back to water, thereby decreasing steam dryness
    - Steam traps cannot remove moisture entrained in the steam flow
  - Wet steam not only affects heat transfer efficiency, but also causes erosion of piping and critical equipment e.g. turbine blades
    - Should take preventative measures e.g. using a steam separator to remove the entrained condensate






- Steam separator (cont'd)
  - Four basic separating principles/mechanisms:
    - 1. Mechanical impediment
    - 2. Flow velocity achieved
    - 3. Directional changes
    - 4. Impingement
  - Higher separation efficiency can be achieved by utilizing several of these techniques as opposed to just one
  - Separators can come in models either with or without a built-in trap


(See also: https://www2.tlv.com/en-au/steam-info/steam-theory/other/separators)






- Typical components:
  - Strainers
  - Automatic air vent
  - Check valves
  - Isolation valves
  - Pressure reducing valves
  - Gauges, sight glasses
- Typical steam equipment:
  - Steam heated cooking vessel (jacketed)

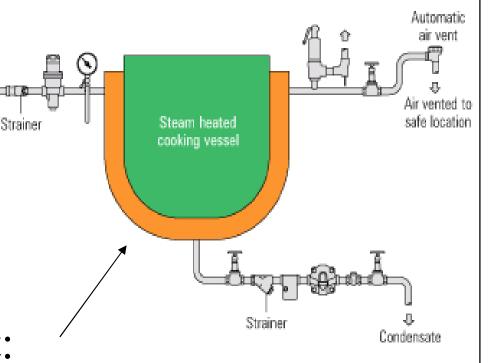

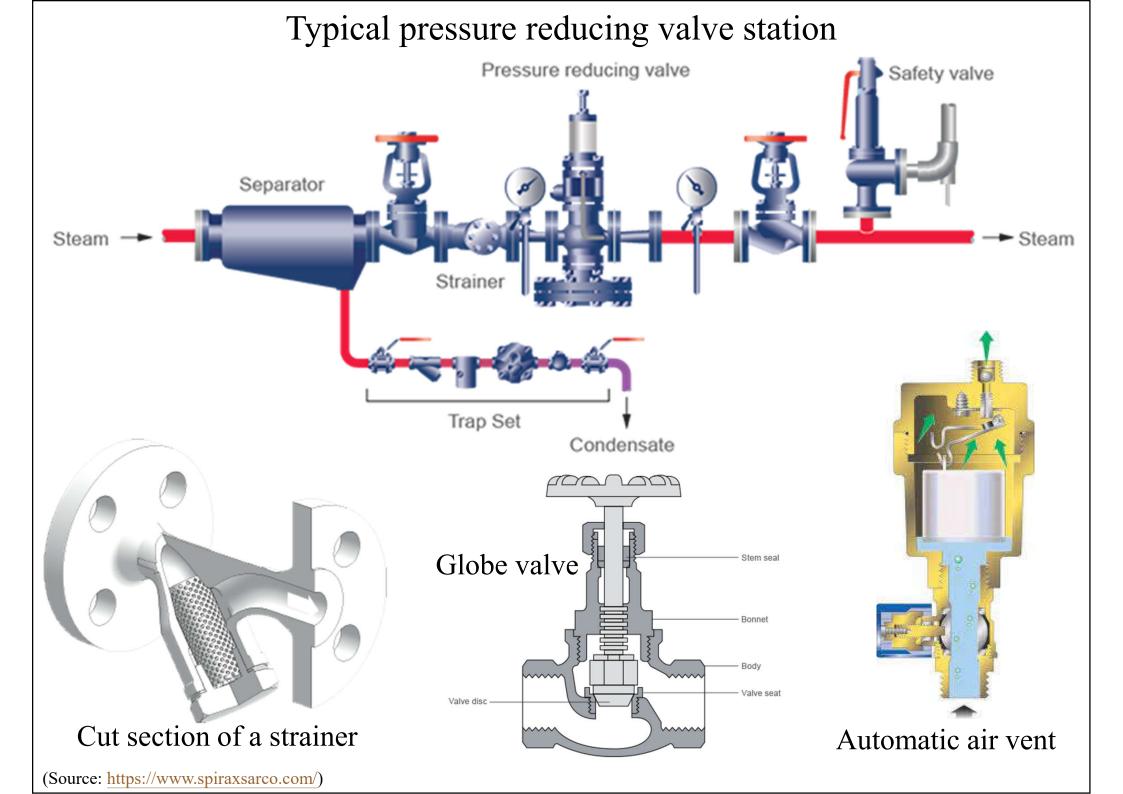

#### Correct orientation of strainers

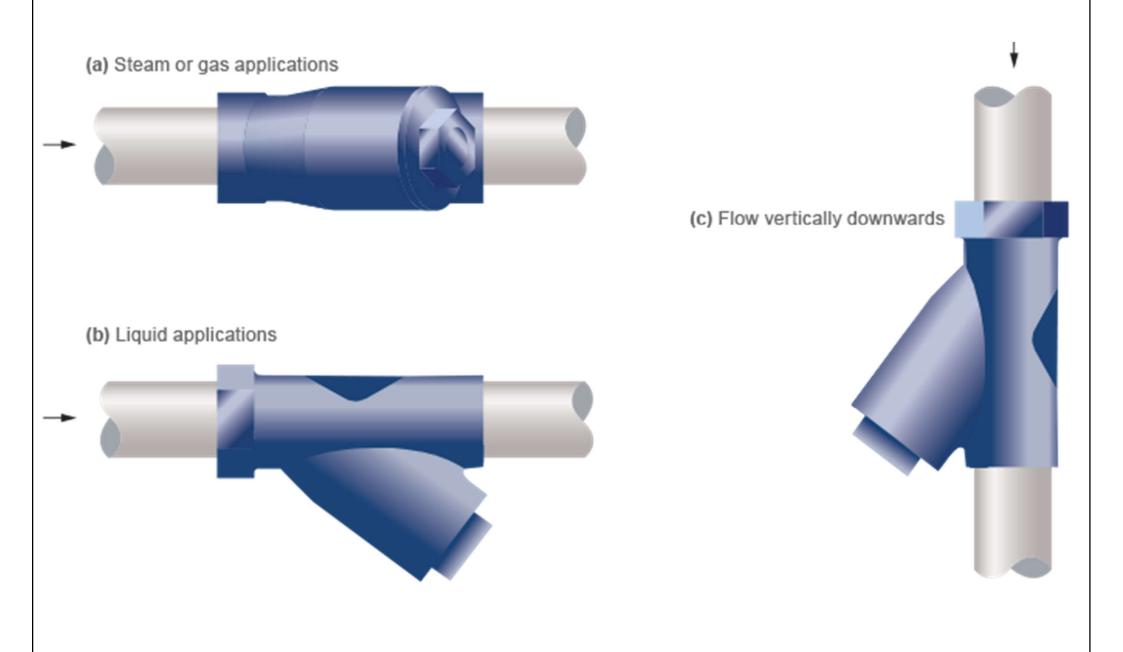


(Source: www.spiraxsarco.com)

# **Further Reading**



Training videos:



- What Is Steam? (15:14) <a href="https://youtu.be/T9jWTtyYLUs">https://youtu.be/T9jWTtyYLUs</a>
- Armstrong University Steam Basics Course (16:19)
   <a href="https://youtu.be/3vr8vlEJY3c">https://youtu.be/3vr8vlEJY3c</a>
- Guidelines for Steam System Efficiency (15:18)
   https://youtu.be/6AkTNNqwtaE
- Learn about steam (Spirax Sarco)
  - https://www.spiraxsarco.com/Learn-about-steam
    - 1. Introduction
    - 2. Steam Engineering Principles and Heat Transfer
    - 10. Steam Distribution
    - 11. Steam Traps and Steam Trapping





- TLV (a steam specialist company)
  - Engineering Calculator
     http://www.tlv.com/global/AU/calculator/
  - Steam Theory (Sections 1 to 11)
    <a href="https://www2.tlv.com/en-au/steam-info/steam-theory">https://www2.tlv.com/en-au/steam-info/steam-theory</a>
  - Product Operation Animation https://www2.tlv.com/en-au/products/operation





- CIBSE, 2015. Design and Operation of Modern Steam Systems, CIBSE TM58: 2015, Chartered Institution of Building Services Engineers (CIBSE), London.
- Hall F. & Greeno R., 2017. *Building Services Handbook*, 9th ed., Routledge, Oxon & New York.
- IOP, 2002. *Plumbing Engineering Services Design Guide*, [New ed.], Institute of Plumbing, Hornchurch, Essex, UK.
- McCauley, J. F., 1995. *The Steam Trap Handbook*, Fairmont Press, Lilburn, GA.
- Spirax-Sarco, 2007. *The Steam and Condensate Loop*, Spirax-Sarco, Cheltenham.